




PROBLEM SUMMARY

Sample Rating Trend


ISO

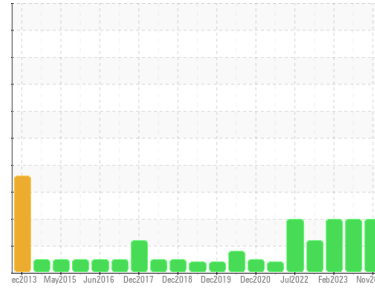

Area
426
 Machine Id
105-106 MILL MOTOR
 Component
Outboard Journal Bearing
 Fluid
ESSO NUTO H ISO 68 (1 QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

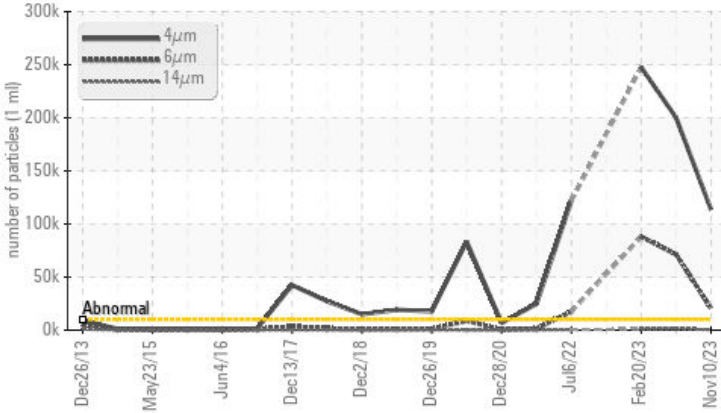

RECOMMENDATION

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>10000	▲ 113734	▲ 200146	▲ 247624
Particles >6µm	ASTM D7647	>2500	▲ 20419	▲ 71436	▲ 88011
Particles >14µm	ASTM D7647	>160	▲ 421	▲ 1263	▲ 1003
Particles >21µm	ASTM D7647	>40	▲ 79	▲ 186	▲ 113
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 24/22/16	▲ 25/23/17	▲ 25/24/17

Customer Id: BRIDES
 Sample No.: WC0838841
 Lab Number: 06009538
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

05 Jul 2023 Diag: Angela Borella

ISO



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



20 Feb 2023 Diag: Angela Borella

ISO



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Dec 2022 Diag: Angela Borella

VISUAL METAL



The oil change at the time of sampling has been noted. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. We were unable to perform a particle count due to metal particles present in this sample. Moderate concentration of visible metal present. All component wear rates are normal. No other contaminants were detected in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

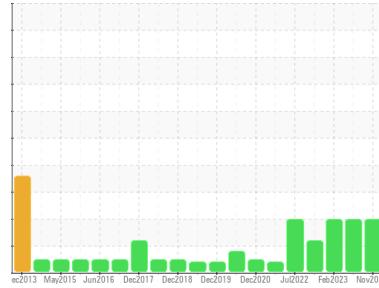

ISO



Area
426
Machine Id
105-106 MILL MOTOR
Component
Outboard Journal Bearing
Fluid
ESSO NUTO H ISO 68 (1 QTS)

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0838841	WC0397544	WC0640608
Sample Date	Client Info		10 Nov 2023	05 Jul 2023	20 Feb 2023
Machine Age	mths	Client Info	6	0	3
Oil Age	mths	Client Info	0	6	0
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		13	19	18
Iron	ppm	ASTM D5185m >60	2	6	3
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >4	<1	<1	<1
Lead	ppm	ASTM D5185m >250	1	1	<1
Copper	ppm	ASTM D5185m >125	10	11	6
Tin	ppm	ASTM D5185m >80	38	79	43
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	6	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	<1	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 5	2	0	1
Calcium	ppm	ASTM D5185m 50	52	67	52
Phosphorus	ppm	ASTM D5185m 330	400	420	318
Zinc	ppm	ASTM D5185m 420	500	559	423
Sulfur	ppm	ASTM D5185m 3100	3799	3628	2763

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	3	3	2
Sodium	ppm	ASTM D5185m	0	0	<1
Potassium	ppm	ASTM D5185m >20	<1	1	0


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 113734	▲ 200146	▲ 247624
Particles >6µm	ASTM D7647	>2500	▲ 20419	▲ 71436	▲ 88011
Particles >14µm	ASTM D7647	>160	▲ 421	▲ 1263	▲ 1003
Particles >21µm	ASTM D7647	>40	▲ 79	▲ 186	▲ 113
Particles >38µm	ASTM D7647	>10	2	2	8
Particles >71µm	ASTM D7647	>3	1	0	1
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 24/22/16	▲ 25/23/17	▲ 25/24/17




OIL ANALYSIS REPORT


Particle Trend

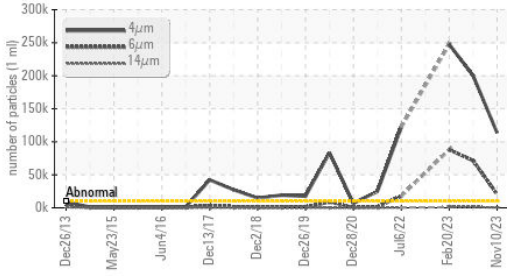


PQ

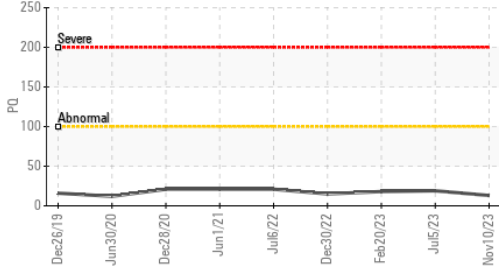


Acid Number

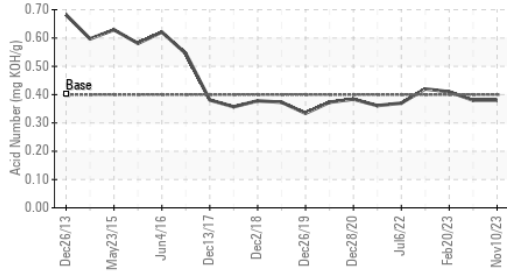

Viscosity @ 40°C

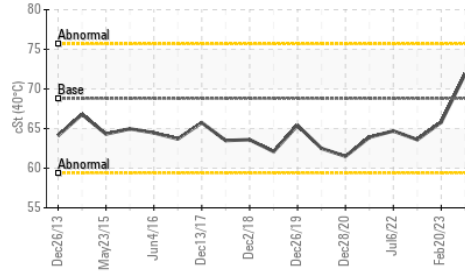

PQ

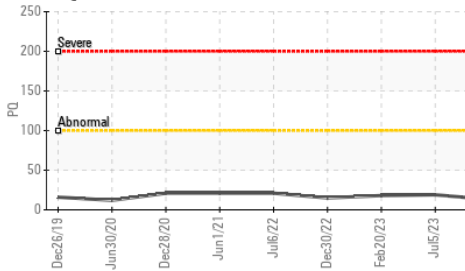


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 .40	0.38	0.38	0.41
VISUAL				
method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	VLITE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>2	NEG	NEG
Free Water	scalar *Visual		NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445 68.8	65.3	71.9	65.8

SAMPLE IMAGES

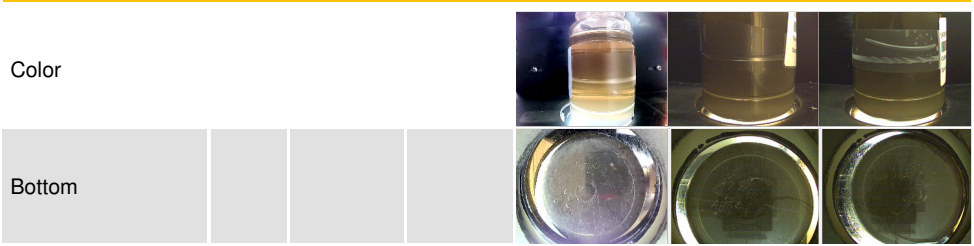


GRAPHS


Ferrous Alloys

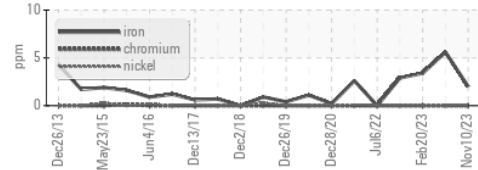


Non-ferrous Metals

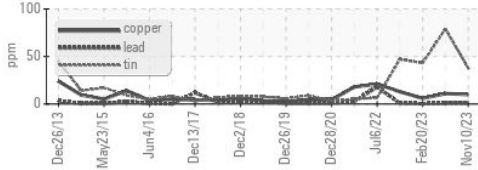


Viscosity @ 40°C

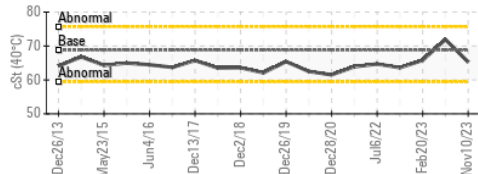

Particle Count

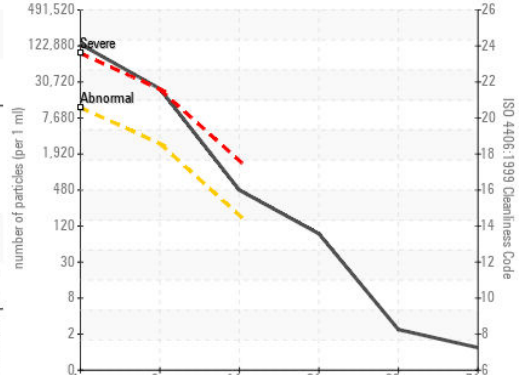

Acid Number

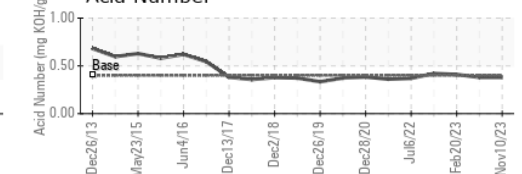

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0838841
 Lab Number : 06009538
 Unique Number : 10743300
 Test Package : IND 2 (Additional Tests: PQ, PrtCount)

BRIDGESTONE FIRESTONE - DES MOINES
 4600 NW 2ND AVE
 DES MOINES, IA
 US 50313
 Contact: SCOTT CARTER
 CarterScottA@FirestoneAg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
F: x: