

## **OIL ANALYSIS REPORT**

#### Sample Rating Trend





#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.


### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


			Jun2023	Nov2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0828500	WC0828471	
Sample Date		Client Info		15 Nov 2023	15 Jun 2023	
Machine Age	hrs	Client Info		1140	545	
Oil Age	hrs	Client Info		1140	545	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	6	4	
Chromium	ppm	ASTM D5185m	>10	<1	<1	
Nickel	ppm	ASTM D5185m	>10	<1	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>75	4	3	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		7	2	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		1	1	
Calcium	ppm	ASTM D5185m	87	73	101	
Phosphorus	ppm	ASTM D5185m	727	594	656	
Zinc	ppm	ASTM D5185m	900	788	878	
Sulfur	ppm	ASTM D5185m	1500	1698	1971	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	3	2	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	2	2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	485	736	
Particles >6µm		ASTM D7647	>1300	123	217	
Particles >14µm		ASTM D7647	>160	13	27	
Particles >21µm		ASTM D7647	>40	3	11	
Particles >38µm		ASTM D7647	>10	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/14/11	17/15/12	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.69	0.71	



# **OIL ANALYSIS REPORT**





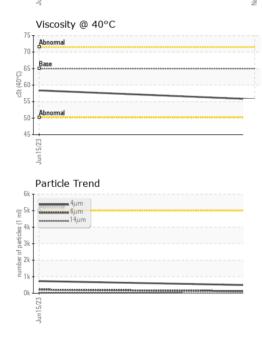

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
ppearance	scalar	*Visual	NORML	NORML	NORML	
Ddor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
ree Water	scalar	*Visual		NEG	NEG	
FLUID PROPERT	<b>FIES</b>	method	limit/base	current	history1	history2
/isc @ 40°C	cSt	ASTM D445	65	55.7	58.4	
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color					a year a	no image
ottom						no image
GRAPHS						
Ferrous Alloys				Particle Count	ī.	
iron			491,52	<sup>o</sup> T		T <sup>26</sup>
chromium			122,88	0		-24
nickel			-	Severe		
			30,72	0		-22
			7,68	0 Abnormal		-20
5/23			5/23 - 1 ml)			-20 -18 -16 -14 -12
Jun 15/23			Nov15/23 s (per 1 ml	0	•	+18
Non-ferrous Meta	ls		apiti 48	0		-16
			rofp			
copper			1.92 Nov15/23. 10 10 12 12 12 12 12 12 12 12 12 12 12 12 12			+14
tin				0-		-12
						10
				ö-		+10
5/23			5/23	2-		-8
Jun 15/23			Nov15/23	0		
Viscosity @ 40°C			_	$4\mu$ $6\mu$	14μ 21μ	38µ 71µ
Abnormal			~1.2	Acid Number		
Base			()) ()) ()) ()) ()) ()) ()) ()) ()) ())	Base		
		******	Ĕ 0.7	2-		
				8-		
Abnormal			N p 0.2	4		
m						
Jun 15/23			Nov15/23	Jun 15/23		Nov15/23
-	-01 14- "				<b></b>	
VearCheck USA - { VC0828500	501 Madi: <b>Receive</b>		ry, NC 2751 Nov 2023	3		<b>KE LAZZAR/</b> TTEVILLE RI
	Diagnos		Nov 2023			RALEIGH, NO
	Diagnos		s Davis			US 2760
CONST ( Additional					Contact	NICK DIXON
tact Customer Serv				NICK	.DIXON@DUKEI	
utaida of the ISO 1	7025 000	no of accros	litation		Τ. /	010)760 7707

 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 NICK.

 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package

C+ IAN°CI

F:

T: (919)760-7797