




# OIL ANALYSIS REPORT

Sample Rating Trend

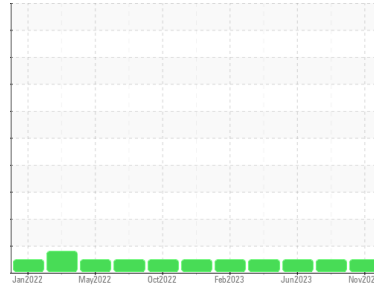

**NORMAL**



Area  
**MP-101 [10023680592]**  
 Machine Id  
**B71457 - VACUUM PUMP BUSCH RA0630 SOUTH RETAIL BACON B71457 (S/N USM121330077)**  
 Component  
**Vacuum Pump**  
 Fluid  
**PETRO CANADA PURITY FG SYNTHETIC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0856070</b>	WC0842519	WC0683803
Sample Date	Client Info		<b>10 Nov 2023</b>	17 Sep 2023	20 Jun 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>2</b>	0	2
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>7</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	3	0
Calcium	ppm	ASTM D5185m	<b>1</b>	3	0
Phosphorus	ppm	ASTM D5185m	<b>468</b>	408	189
Zinc	ppm	ASTM D5185m	<b>3</b>	12	0
Sulfur	ppm	ASTM D5185m	<b>1332</b>	1023	654

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>8</b>	4	6
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	<1

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>676</b>	3621	9806
Particles >6µm	ASTM D7647	>2500	<b>175</b>	761	1249
Particles >14µm	ASTM D7647	>320	<b>12</b>	46	23
Particles >21µm	ASTM D7647	>80	<b>3</b>	11	7
Particles >38µm	ASTM D7647	>20	<b>0</b>	1	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>17/15/11</b>	19/17/13	20/17/12


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.5	<b>0.16</b>	0.17	0.07




# OIL ANALYSIS REPORT


Particle Trend

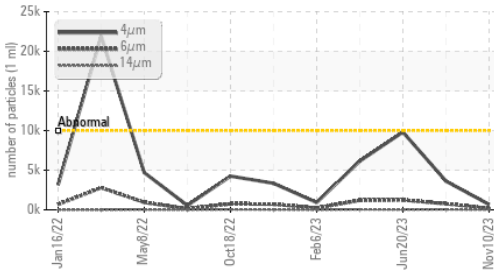


Acid Number

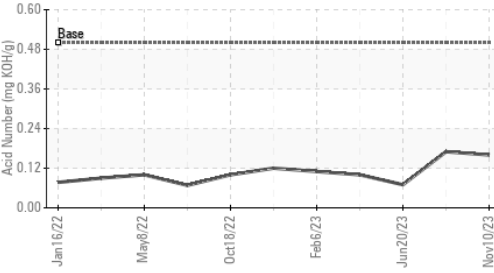

Viscosity @ 40°C

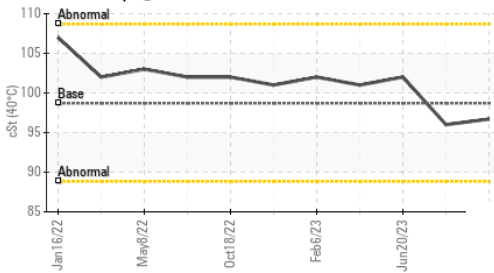

Particle Trend

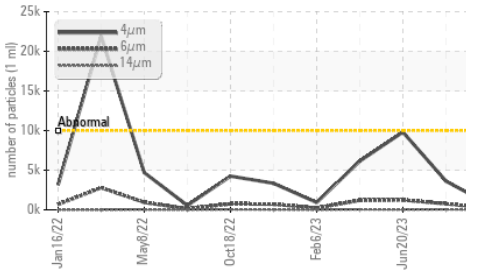

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7	96.0	102

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


Ferrous Alloys

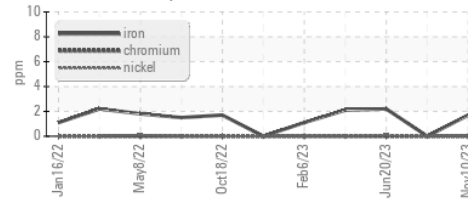


Non-ferrous Metals

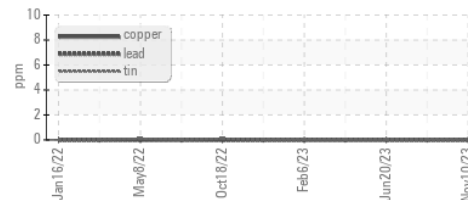


Viscosity @ 40°C

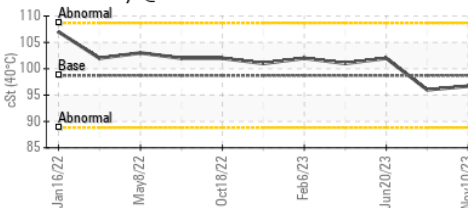

Particle Count

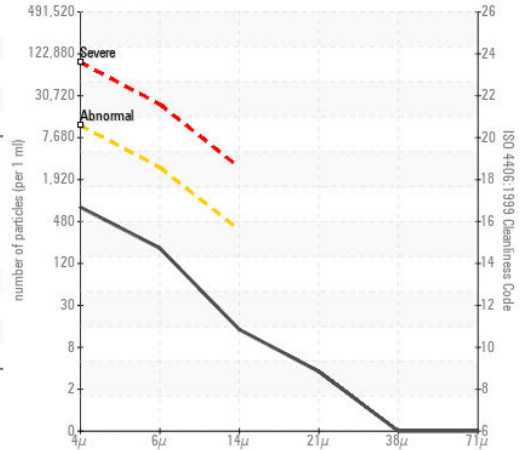

Acid Number

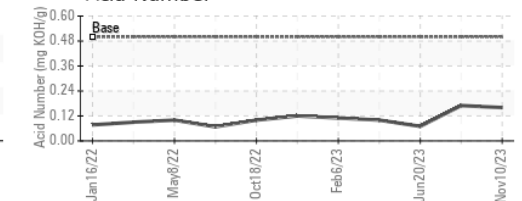

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0856070 Received : 16 Nov 2023  
 Lab Number : 06009613 Diagnosed : 19 Nov 2023  
 Unique Number : 10743375 Diagnostician : Don Baldrige  
 Test Package : IND 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**HORMEL FOODS - AUSTIN**  
 1101 NORTH MAIN ST  
 AUSTIN, MN  
 US 55912  
 Contact: RYAN LOWE  
 rslowe@hormel.com  
 T: (507)437-5674  
 F: (507)437-9805