


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

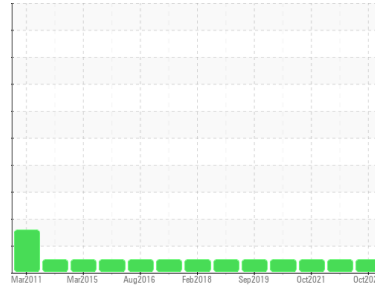

Machine Id  
**A501**  
Component  
**Hydraulic System**  
Fluid  
**MOBIL DTE 10 EXCEL 32 (43 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>MHI026279</b>	MHI017002	MHI017015
Sample Date	Client Info			<b>31 Oct 2023</b>	29 Sep 2022	04 Oct 2021
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>43379</b>	36754	30762
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>3</b>	3	2
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>20	<b>4</b>	4	3
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	2
Barium	ppm	ASTM D5185m		<b>7</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	120	<b>102</b>	113	121
Phosphorus	ppm	ASTM D5185m	475	<b>414</b>	448	462
Zinc	ppm	ASTM D5185m		<b>19</b>	0	24
Sulfur	ppm	ASTM D5185m	1275	<b>1756</b>	1898	1760

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304	>0.1	<b>0.010</b>	0.007	0.003
ppm Water	ppm	ASTM D6304	>1000	<b>101.5</b>	77.4	25.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>1021</b>	856	2067
Particles >6µm		ASTM D7647	>1300	<b>255</b>	229	692
Particles >14µm		ASTM D7647	>160	<b>18</b>	32	94
Particles >21µm		ASTM D7647	>40	<b>5</b>	11	33
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>17/15/11</b>	17/15/12	18/17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.07</b>	0.18	0.073


# OIL ANALYSIS REPORT

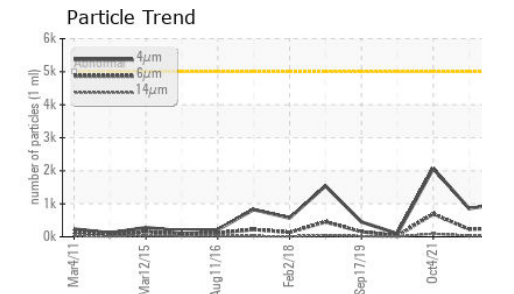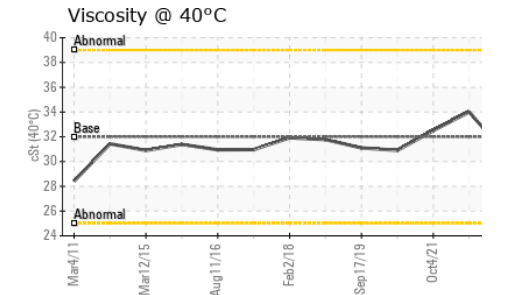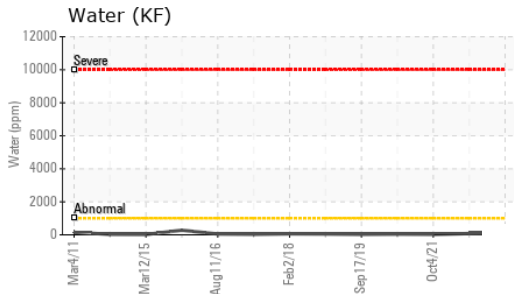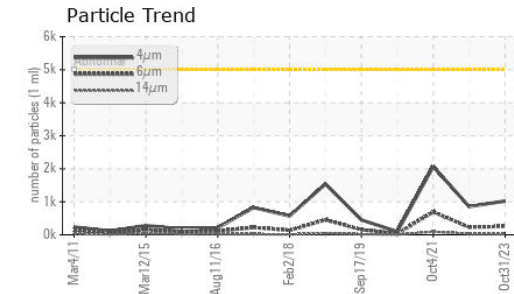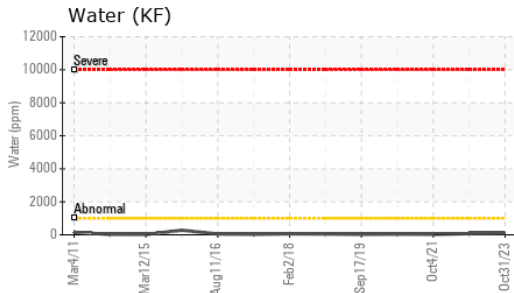


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	30.7	34.0	32.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

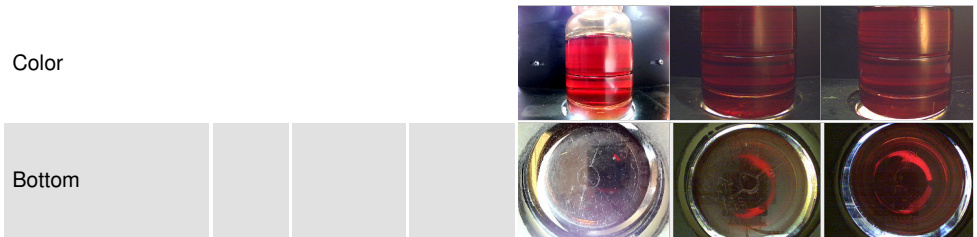

## GRAPHS

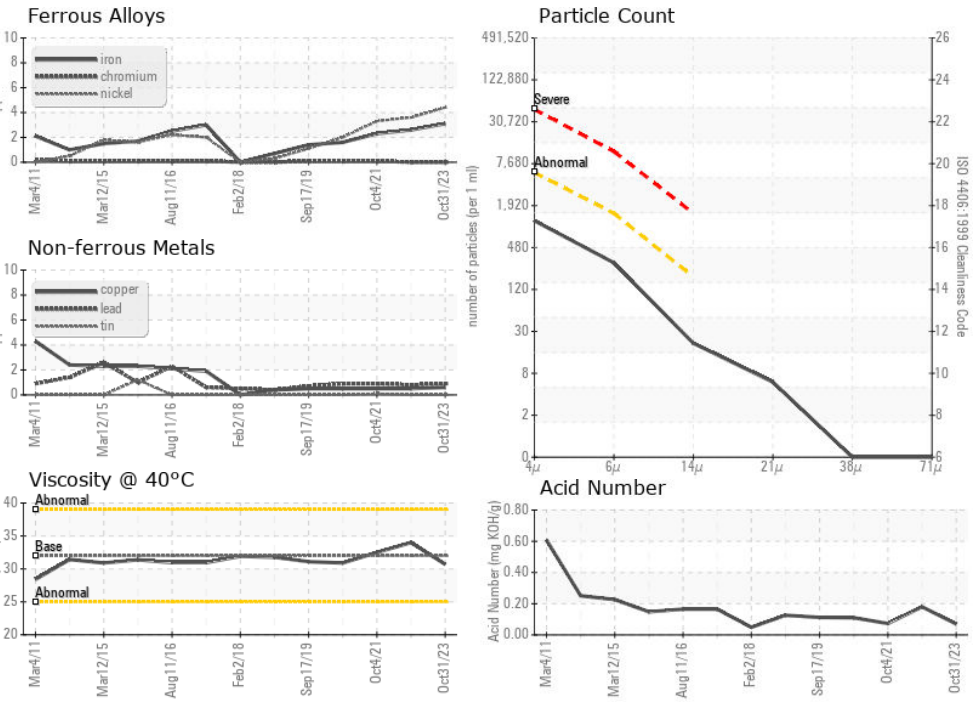

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MHI026279 **Received** : 16 Nov 2023  
**Lab Number** : 06009629 **Diagnosed** : 19 Nov 2023  
**Unique Number** : 10743391 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**DIAMOND WTG - DILLON**  
P.O. BOX 880  
DESERT HOT SPRINGS, CA  
US 92240  
Contact: DANIEL BOYD  
daniel.boyd@diamondwtg.com  
T: (760)329-7171  
F: (760)329-7122

Certificate L2367  
To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)