




# PROBLEM SUMMARY


Sample Rating Trend

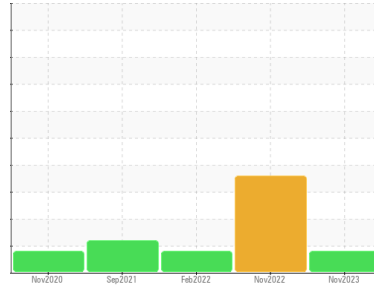

Machine Id  
**KAESER 7033266**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

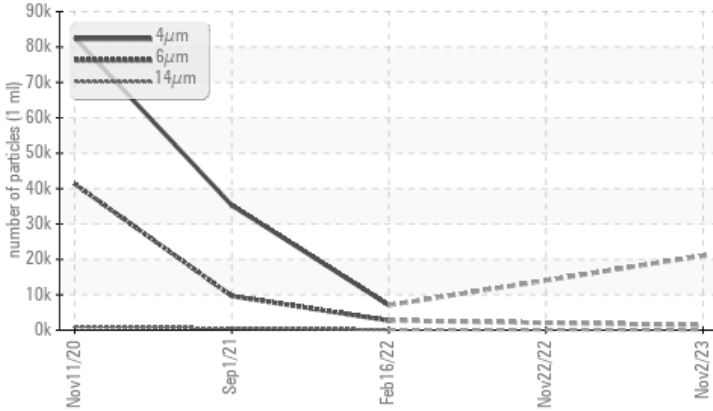

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 1413	---	▲ 2703
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/18/12	---	▲ 19/14

Customer Id: AMACOPTX  
 Sample No.: KCPA006929  
 Lab Number: 06009669  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 22 Nov 2022 Diag: Don Baldrige

WATER



The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.

view report



### 16 Feb 2022 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 01 Sep 2021 Diag: Don Baldrige

ISO




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id  
**KAESER 7033266**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

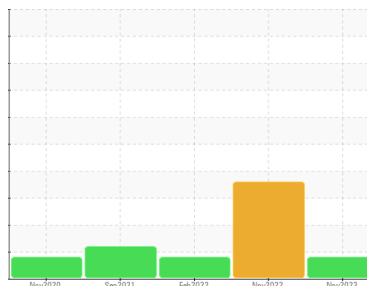

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA006929</b>	KCP47711D	KCP41264
Sample Date	Client Info			<b>02 Nov 2023</b>	22 Nov 2022	16 Feb 2022
Machine Age	hrs	Client Info		<b>18687</b>	14358	10514
Oil Age	hrs	Client Info		<b>0</b>	3842	5427
Oil Changed	Client Info			<b>N/A</b>	Not Changd	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>25</b>	18	15
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>7</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>&lt;1</b>	10	11
Calcium	ppm	ASTM D5185m	2	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>16</b>	24	0
Zinc	ppm	ASTM D5185m		<b>0</b>	9	18
Sulfur	ppm	ASTM D5185m		<b>15332</b>	19952	14827

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>3</b>	3	2
Sodium	ppm	ASTM D5185m		<b>0</b>	5	3
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	2
Water	%	ASTM D6304	>0.05	<b>0.00</b>	▲ 0.229	0.006
ppm Water	ppm	ASTM D6304	>500	<b>0.00</b>	▲ 2290	68.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>21048</b>	---	7054
Particles >6µm		ASTM D7647	>1300	▲ <b>1413</b>	---	▲ 2703
Particles >14µm		ASTM D7647	>80	<b>29</b>	---	▲ 123
Particles >21µm		ASTM D7647	>20	<b>7</b>	---	22
Particles >38µm		ASTM D7647	>4	<b>1</b>	---	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>22/18/12</b>	---	▲ 19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.28</b>	0.31	0.300


# OIL ANALYSIS REPORT

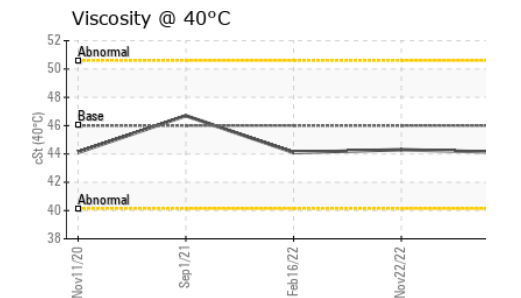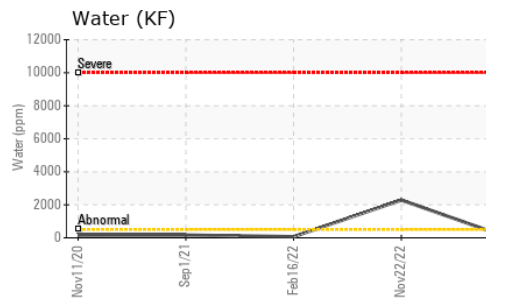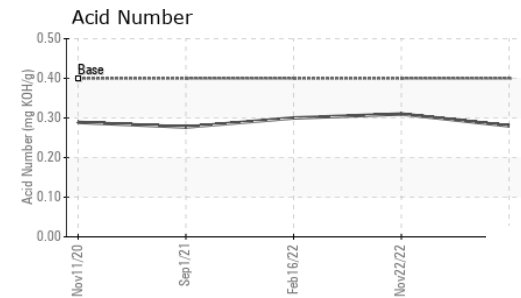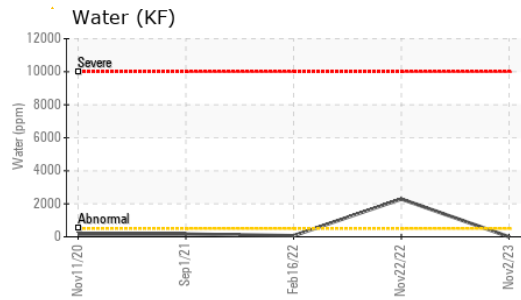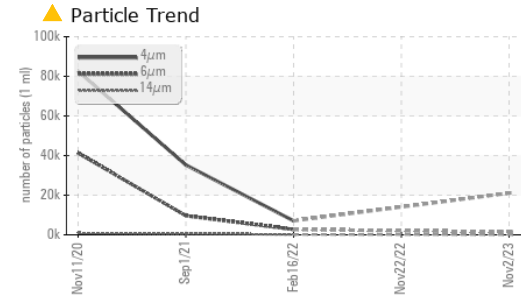





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	44.3	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

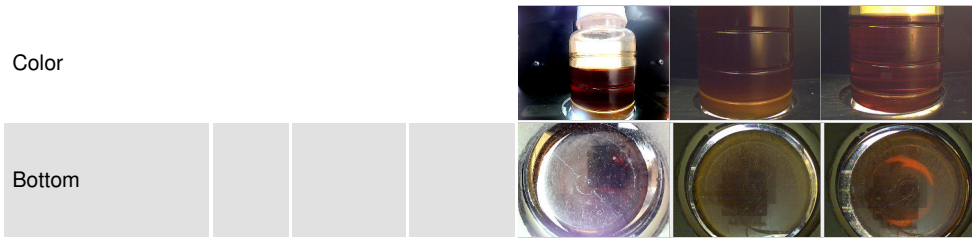

## GRAPHS

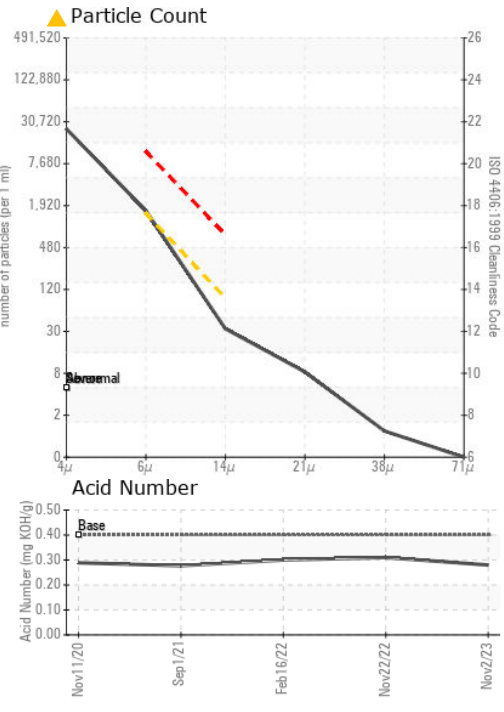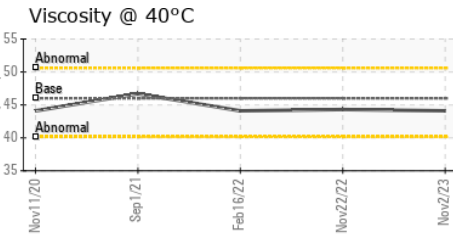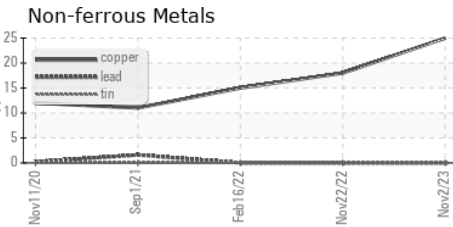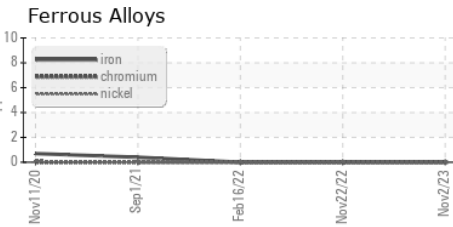

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006929 **Received** : 16 Nov 2023  
**Lab Number** : 06009669 **Diagnosed** : 19 Nov 2023  
**Unique Number** : 10743431 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON FTW 7 AND 9**  
 944 W SANDY LAKE RD  
 COPPELL, TX  
 US 75019  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)