




PROBLEM SUMMARY

Sample Rating Trend

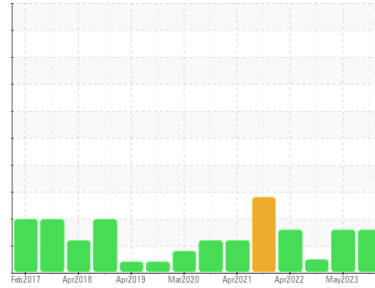


WATER



Machine Id
KAESER SK 20T 5162719 (S/N 1413)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

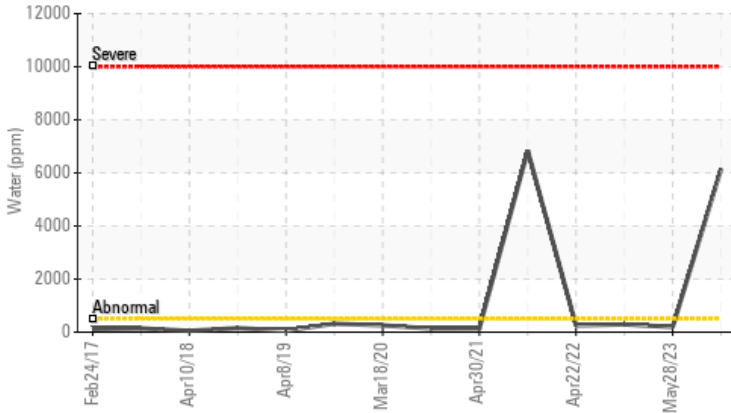

RECOMMENDATION

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	NORMAL
Water	%	ASTM D6304	>0.05	▲ 0.615	0.019	0.029
ppm Water	ppm	ASTM D6304	>500	▲ 6150	196.0	291.1
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG	NEG

Customer Id: ADVDAL
 Sample No.: KCPA009399
 Lab Number: 06009679
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 May 2023 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Nov 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Apr 2022 Diag: Don Baldrige

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER SK 20T 5162719 (S/N 1413)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

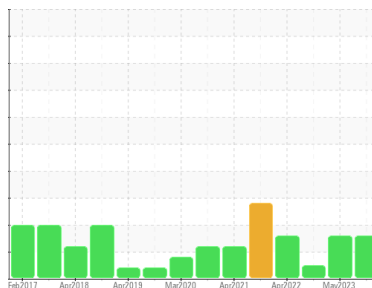

DIAGNOSIS

▲ Recommendation

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA009399	KCPA001828	KCP47932D
Sample Date	Client Info	03 Nov 2023	28 May 2023	07 Nov 2022
Machine Age	hrs	43073	41815	39376
Oil Age	hrs	0	0	2553
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	1	2	1
Chromium	ppm	ASTM D5185m >10	0	<1	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	2	<1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	2	7	6
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	8	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	49	56	47
Calcium	ppm	ASTM D5185m 2	3	0	0
Phosphorus	ppm	ASTM D5185m	19	2	0
Zinc	ppm	ASTM D5185m	3	2	0
Sulfur	ppm	ASTM D5185m	19680	20129	19067

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	3	9	15
Potassium	ppm	ASTM D5185m >20	2	<1	0
Water	%	ASTM D6304 >0.05	▲ 0.615	0.019	0.029
ppm Water	ppm	ASTM D6304 >500	▲ 6150	196.0	291.1




FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	16758	1865
Particles >6µm	ASTM D7647 >1300	---	▲ 3776	494
Particles >14µm	ASTM D7647 >80	---	▲ 121	33
Particles >21µm	ASTM D7647 >20	---	▲ 21	9
Particles >38µm	ASTM D7647 >4	---	0	1
Particles >71µm	ASTM D7647 >3	---	0	0
Oil Cleanliness	ISO 4406 (c) >17/13	---	▲ 19/14	16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.36	0.33


OIL ANALYSIS REPORT

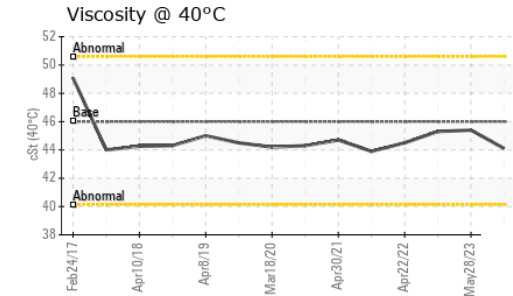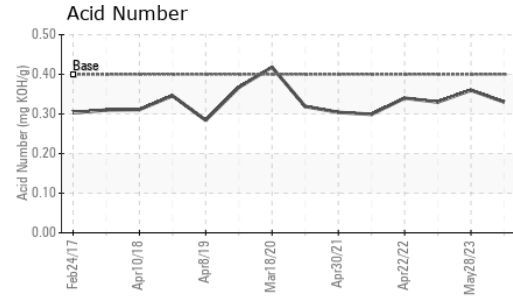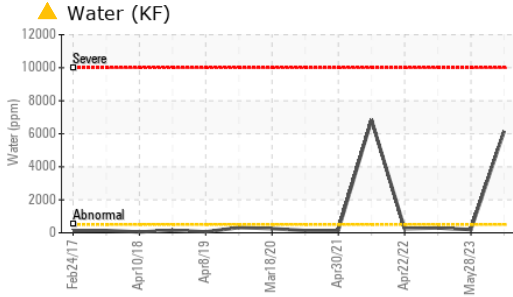





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual	▲ 0.2%	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	45.4	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

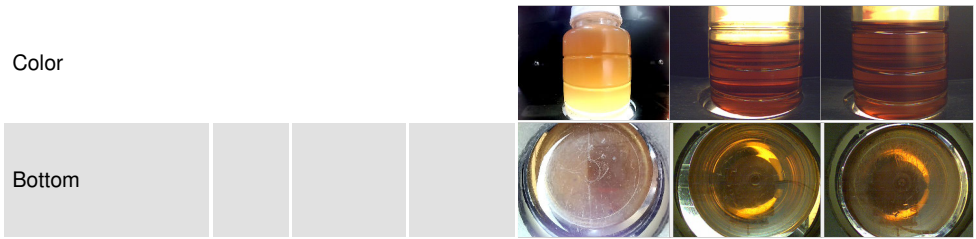

GRAPHS

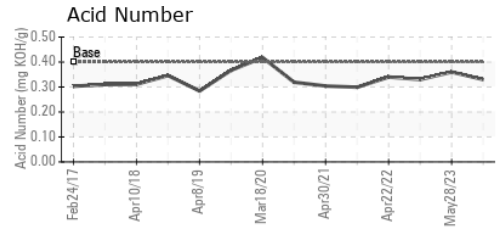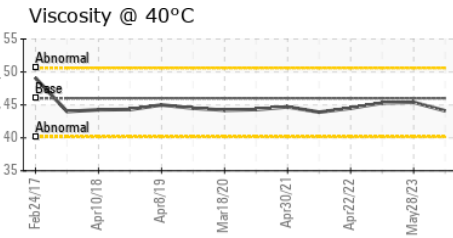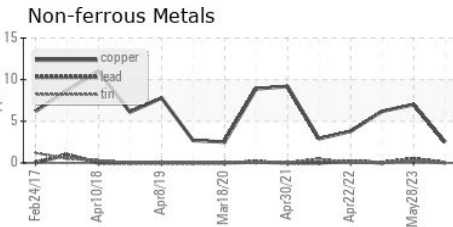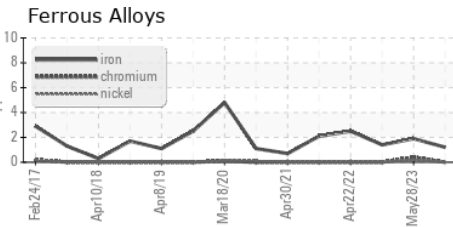

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009399 **Received** : 16 Nov 2023
Lab Number : 06009679 **Diagnosed** : 19 Nov 2023
Unique Number : 10743441 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PftCount)

ADVANTAGE LABEL CO
 8727 EMPRESS ROW
 DALLAS, TX
 US 75247
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: