

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# (FA-J6640) MICHAEL DAVID WINERY [FA-J8728] RC02 - 21341-001-1-01-02 190426-4172

**Reciprocating Compressor** 

**CAMCO 717 HT (33 GAL)** 

### Recommendation

Resample at the next service interval to monitor. Particle count performed inadvertently.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Junzuz	1 N0V2U21		NZ023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0807639	WC0712684	WC0578663
Sample Date		Client Info		09 Nov 2023	26 Oct 2022	23 Nov 2021
Machine Age	hrs	Client Info		0	8060	6314
Oil Age	hrs	Client Info		0	0	6314
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	2	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	3
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		10	4	8
Sulfur	ppm	ASTM D5185m		1	0	8
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	5	2
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.1	0.002	0.004	0.002
ppm Water	ppm	ASTM D6304	>1000	19.2	49.4	19.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>10000	20389		
Particles >6µm		ASTM D7647	>2500	4769		
Particles >14μm		ASTM D7647	>320	143		
Particles >21μm		ASTM D7647	>80	20		
Particles >38μm		ASTM D7647	>20	0		
Particles >71μm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	22/19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

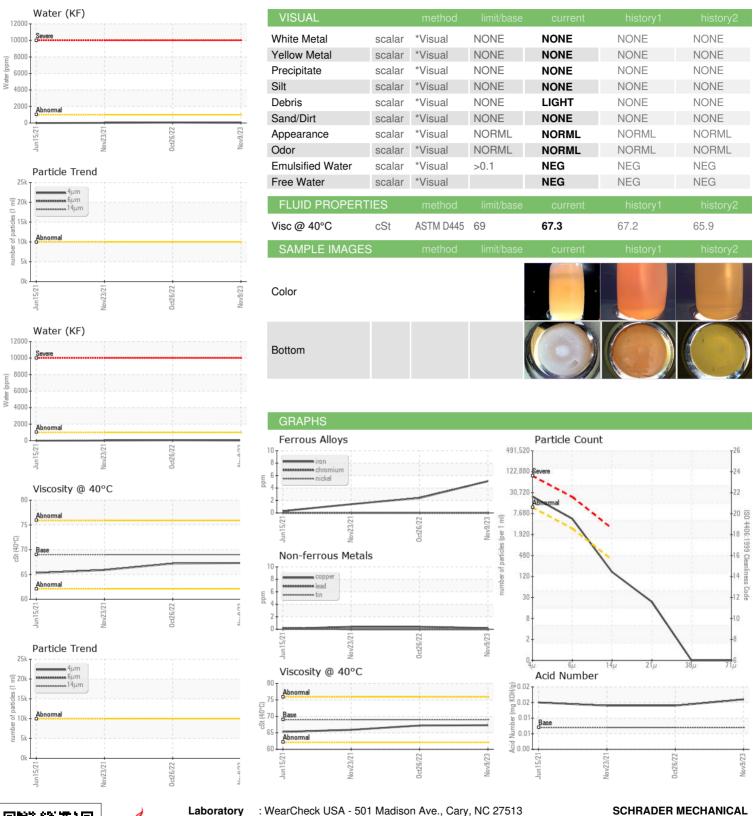





Certificate 12367

Laboratory Sample No. Lab Number

: WC0807639 : 06009705 Unique Number : 10743467 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 16 Nov 2023 **Tested** : 17 Nov 2023

Diagnosed : 17 Nov 2023 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1015 BLACK DIAMOND WAY LODI PROVINCE, CA US 95240

Contact: Schrader Mechanical amanda.h@smiwest.com T: (209)369-6888

F: x: Contact/Location: Schrader Mechanical - SCHLOD