


OIL ANALYSIS REPORT

(FA-J6640) MICHAEL DAVID WINERY [FA-J8728] RC03 - 21341-001-1-01-01 NMR-N22405-28

Reciprocating Compressor

CAMCO 717 HT (--- GAL)





Recommendation

Resample at the next service interval to monitor. Particle count performed inadvertently.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0807640	WC0712683	WC0578678
Sample Date		Client Info		09 Nov 2023	20 Nov 2022	23 Nov 2021
Machine Age	hrs	Client Info		0	2560	2197
Oil Age	hrs	Client Info		0	0	2197
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	4	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>25	0	<1	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	2
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		7	0	1
Sulfur	ppm	ASTM D5185m		10	0	37
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	<1
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.1	0.002	0.003	0.006
ppm Water	ppm	ASTM D6304	>1000	15.1	29.9	60.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>10000	132844		
Particles >6µm		ASTM D7647	>2500	37857		
Particles >14μm		ASTM D7647	>320	583		
Particles >21µm		ASTM D7647	>80	52		
Particles >38μm		ASTM D7647	>20	1		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	24/22/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

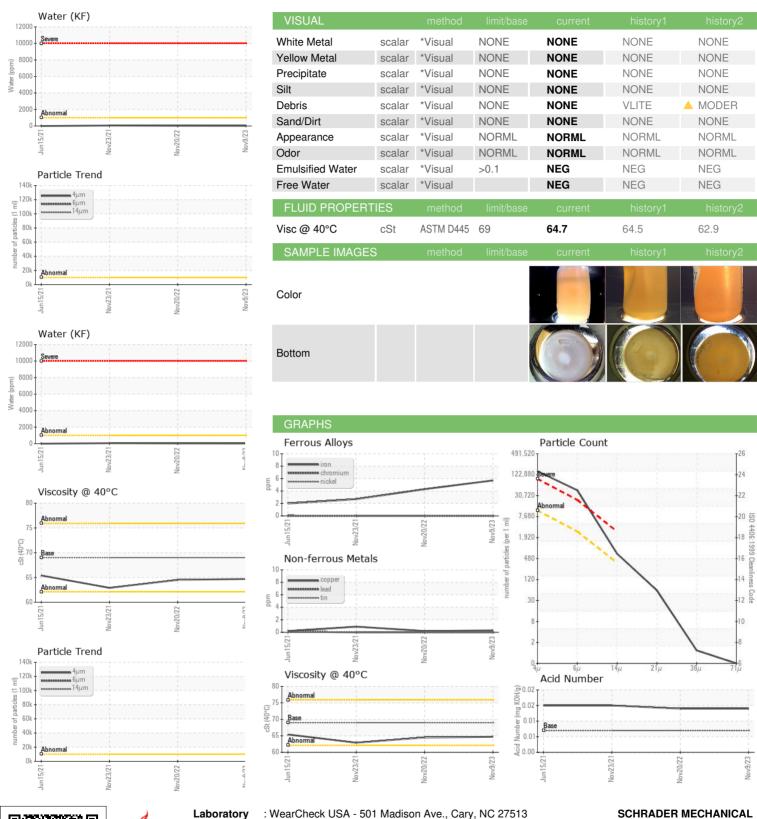





Certificate 12367

Laboratory Sample No. Lab Number

: 06009706 Unique Number : 10743468 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0807640 Received

Tested : 17 Nov 2023 Diagnosed : 17 Nov 2023 - Doug Bogart

: 16 Nov 2023

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1015 BLACK DIAMOND WAY LODI PROVINCE, CA

US 95240

Contact: Schrader Mechanical amanda.h@smiwest.com T: (209)369-6888

Contact/Location: Schrader Mechanical - SCHLOD

F: x: