




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

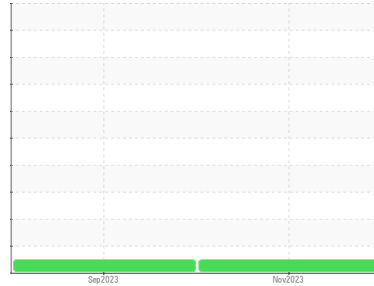

Area  
**WO 68**  
 Machine Id  
**LL 6 - BUFFALO WATER**  
 Component  
**Non-Drive End Pump**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06009707</b>	UCH05959917	---
Sample Date	Client Info			<b>15 Nov 2023</b>	20 Sep 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>20</b>	24	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>7	<b>0</b>	2	---
Lead	ppm	ASTM D5185m	>12	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>30	<b>&lt;1</b>	3	---
Tin	ppm	ASTM D5185m	>9	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	---
Magnesium	ppm	ASTM D5185m	5	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m	12	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	400	<b>550</b>	578	---
Zinc	ppm	ASTM D5185m	12	<b>2</b>	0	---
Sulfur	ppm	ASTM D5185m	650	<b>572</b>	679	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>&lt;1</b>	2	---
Sodium	ppm	ASTM D5185m		<b>2</b>	2	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.50	<b>0.37</b>	0.40	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	MODER	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---





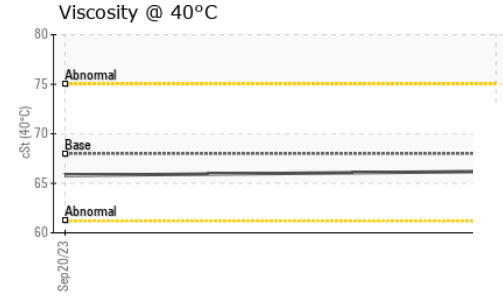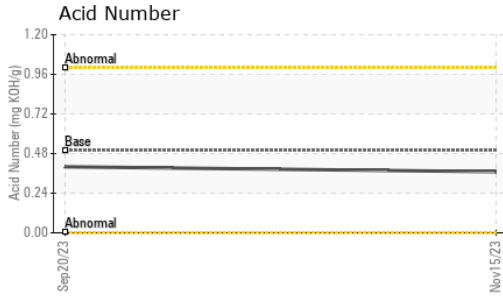

# OIL ANALYSIS REPORT







### FLUID PROPERTIES

method	limit/base	current	history1	history2	
Visc @ 40°C	cSt ASTM D445	68	66.2	65.8	---

### SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image

### GRAPHS

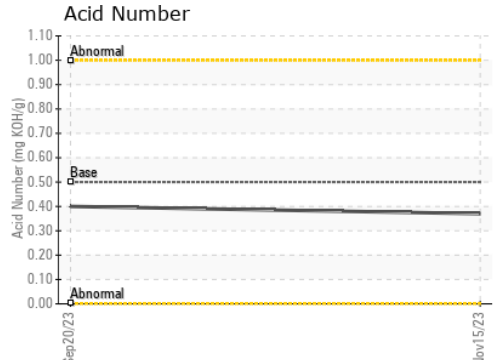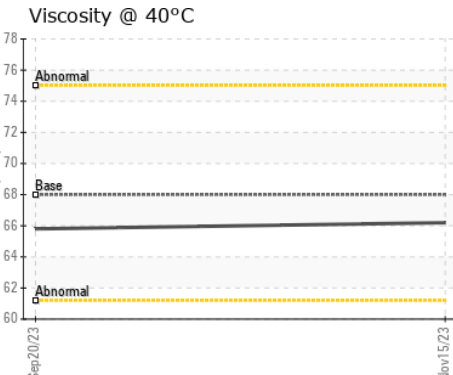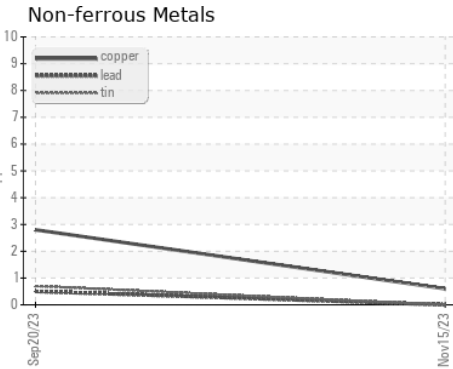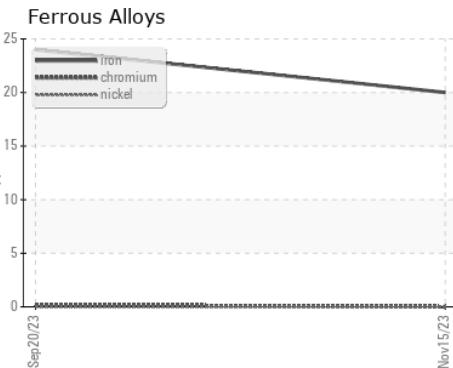

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06009707 **Received** : 16 Nov 2023  
**Lab Number** : **06009707** **Diagnosed** : 17 Nov 2023  
**Unique Number** : 10743469 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CORROSION PRODUCTS & EQUIPMENT INC**  
 110 ELMGROVE PARK  
 ROCHESTER, NY  
 US 14624  
 Contact: Bill Cox  
 cox@corrosion-products.com  
 T: (585)455-7978  
 F: (585)247-7268

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)