

OIL ANALYSIS REPORT

CFG-546 [O-SP2762698] **GARDNER DENVER S586646 - GRIMMWAY PREMIER** Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

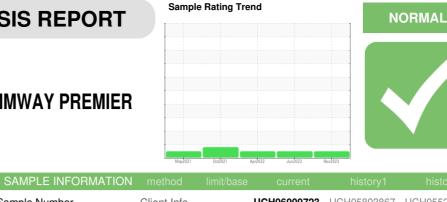

		method	inniv base	Guirent	matory	Thoras a
Sample Number		Client Info		UCH06009723	UCH05893867	UCH05527114
Sample Date		Client Info		07 Nov 2023	23 Jun 2023	11 Apr 2022
Machine Age	hrs	Client Info		20280	17471	13564
Oil Age	hrs	Client Info		2809	2585	6000
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>25	0	<1	3
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	0	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Daman			0	•	0	

Boron	ppm	ASTM D5185m	0	0	0	1
Barium	ppm	ASTM D5185m	0	2	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0	0
Magnesium	ppm	ASTM D5185m	1.2	0	4	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	295	200	48	141
Zinc	ppm	ASTM D5185m	0	0	6	0
Sulfur	ppm	ASTM D5185m	253	1059	1383	981
CONTAMINANTS	;	method	limit/base	current	history1	history2

Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0

0.26


FLUID DEGRADA	TION	method		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.252	0.27


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual	t	NEG	ARRMERKOVIC	H - NEGISSAC

0.39




OIL ANALYSIS REPORT

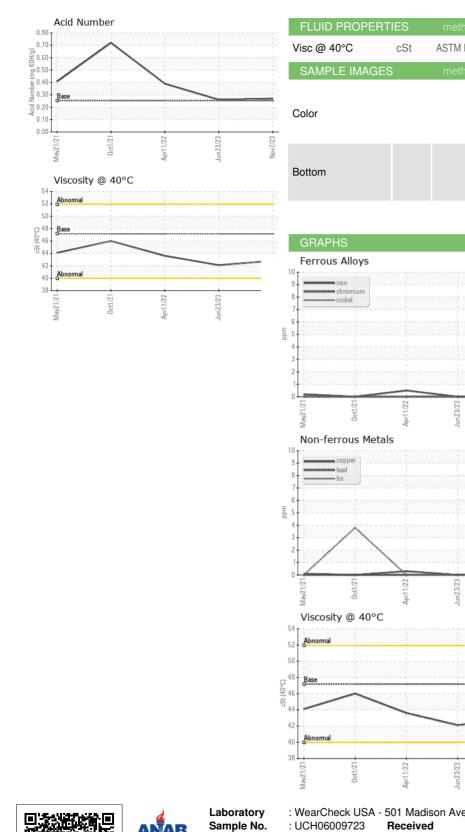

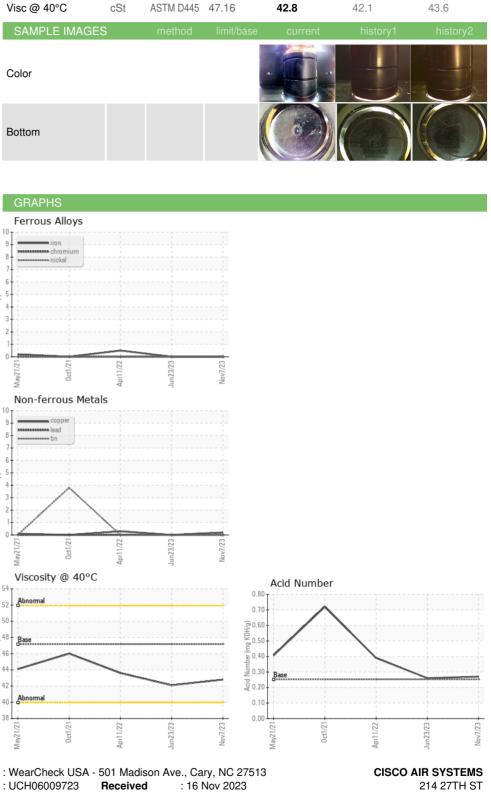

SACRAMENTO, CA : 17 Nov 2023 Diagnostician : Doug Bogart US 95816 Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com T: (916)444-2525 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x:



Lab Number

: 06009723

Diagnosed

Contact/Location: BARRY FRKOVICH - UCCISSAC