




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**FG-460 [WO-7454]**  
 Machine Id  
**KAESER 1038 -ARTHUR SCHUMAN MIDWEST**  
 Component  
**Compressor**

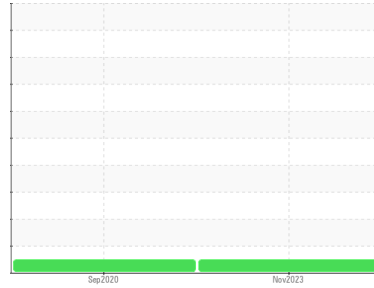

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06009741</b>	UCH05093988	---
Sample Date	Client Info		<b>15 Nov 2023</b>	04 Sep 2020	---
Machine Age	hrs	Client Info	<b>83526</b>	17194	---
Oil Age	hrs	Client Info	<b>5625</b>	334	---
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	1	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Antimony	ppm	ASTM D5185m	<b>---</b>	1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.1	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m 0.8	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m 0.9	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 409	<b>110</b>	272	---
Zinc	ppm	ASTM D5185m 0	<b>6</b>	17	---
Sulfur	ppm	ASTM D5185m 1290	<b>1126</b>	758	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>2</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.537	<b>0.24</b>	0.200	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>NONE</b>	MODER	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	---	---







# OIL ANALYSIS REPORT

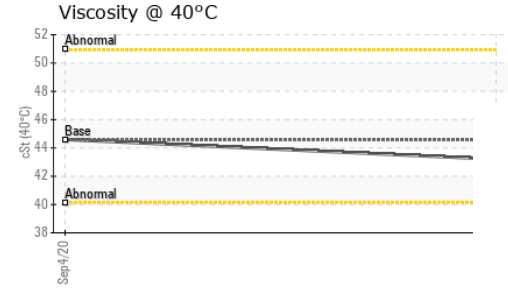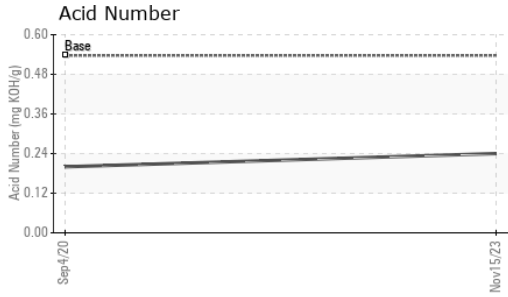

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.56	<b>43.2</b>	44.6	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

## GRAPHS

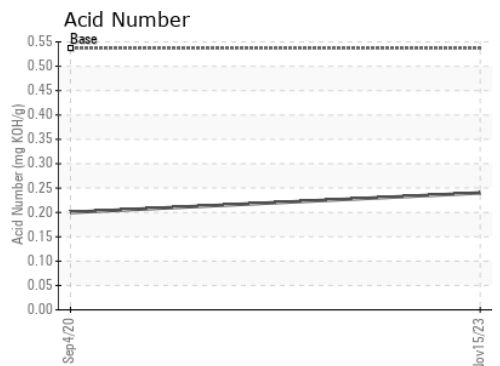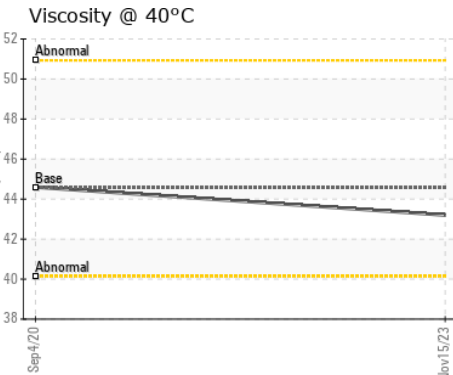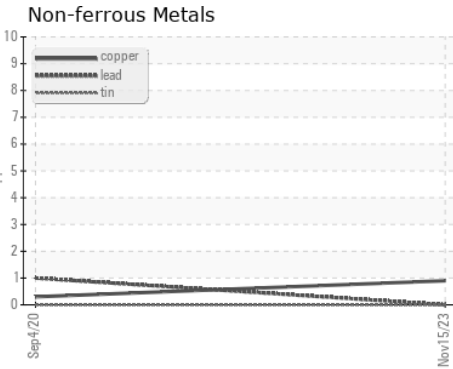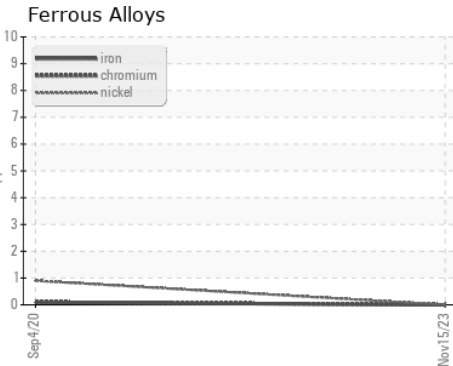

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06009741 **Received** : 16 Nov 2023  
**Lab Number** : 06009741 **Diagnosed** : 17 Nov 2023  
**Unique Number** : 10743503 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**DELTA INDUSTRIES - PEORIA**  
 1115 SW ADAMS ST.  
 PEORIA, IL  
 US 61602  
 Contact: TIM YOUNG  
 tyoung@deltaind.net; jreinert@deltaind.net  
 T: (309)637-5500  
 F: (309)637-5250

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)