




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**RIG 5**  
 Machine Id  
**CATERPILLAR 3512 R5-G-04 NKL**  
 Component  
**Diesel Engine**  
 Fluid  
**NOT GIVEN (--- GAL)**

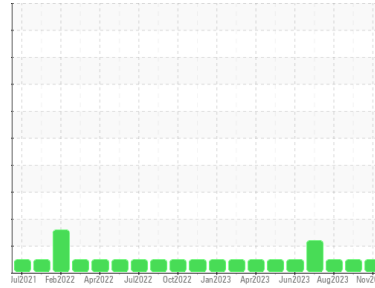

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KL0013089</b>	KL0012989	KL0012482
Sample Date	Client Info		<b>03 Nov 2023</b>	29 Sep 2023	25 Aug 2023
Machine Age	days	Client Info	<b>45233</b>	45196	45161
Oil Age	days	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>0</b>	3	4
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>4</b>	6	<1
Lead	ppm	ASTM D5185m >40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >330	<b>0</b>	<1	1
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>369</b>	321	272
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>122</b>	121	114
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>701</b>	616	677
Calcium	ppm	ASTM D5185m	<b>1509</b>	1387	1547
Phosphorus	ppm	ASTM D5185m	<b>709</b>	649	678
Zinc	ppm	ASTM D5185m	<b>867</b>	780	819
Sulfur	ppm	ASTM D5185m	<b>2566</b>	2490	2856

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>8</b>	6	6
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	1


## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.1</b>	0.1	0.2
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.6</b>	6.1	8.2
Sulfation	Abs./1mm	*ASTM D7415 >30	<b>23.0</b>	22.3	22.9




# OIL ANALYSIS REPORT


### Particle Trend

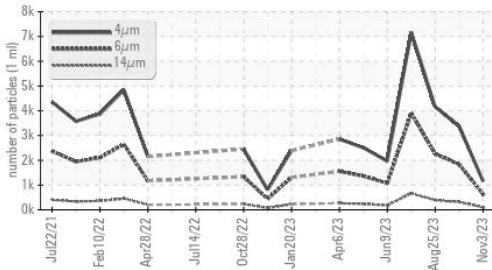


### Base Number

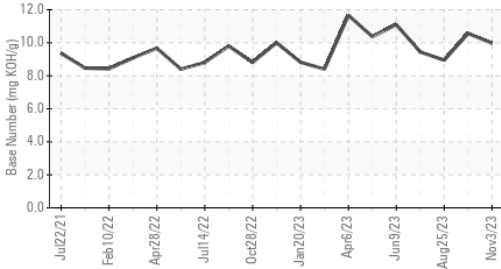

### Viscosity @ 100°C

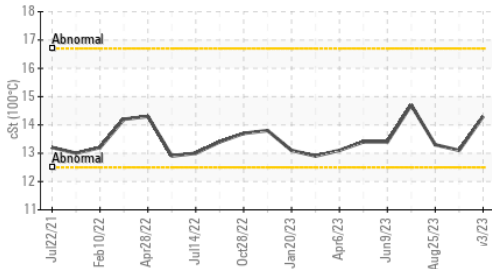

### Particle Trend

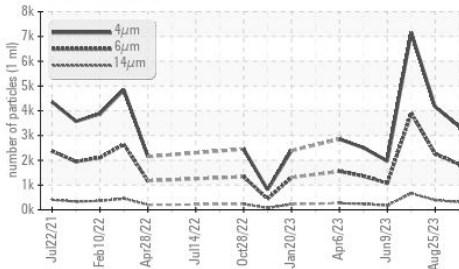

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1157</b>	3375	4158
Particles >6µm	ASTM D7647	>5000	<b>630</b>	1839	2265
Particles >14µm	ASTM D7647	>640	<b>107</b>	313	386
Particles >21µm	ASTM D7647	>160	<b>36</b>	105	130
Particles >38µm	ASTM D7647	>40	<b>6</b>	16	20
Particles >71µm	ASTM D7647	>10	<b>1</b>	2	2
Oil Cleanliness	ISO 4406 (c)	>19/16	<b>16/14</b>	18/15	18/16


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.7</b>	15.8	17.6
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.97</b>	10.56	8.94

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>14.3</b>	13.1	13.3

### GRAPHS


#### Ferrous Alloys

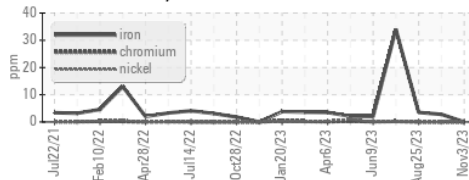


#### Non-ferrous Metals

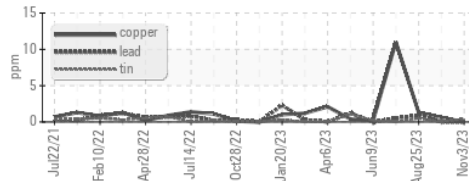


#### Viscosity @ 100°C

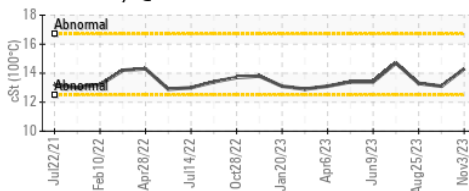

#### Particle Count

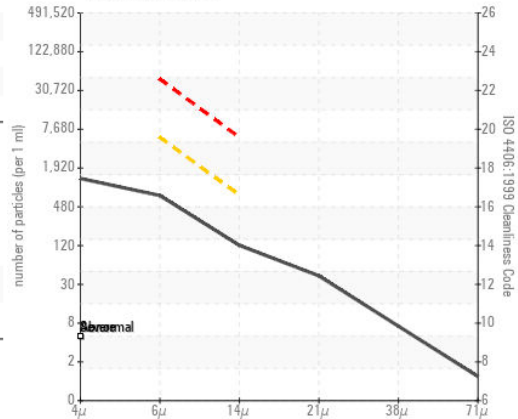

#### Base Number

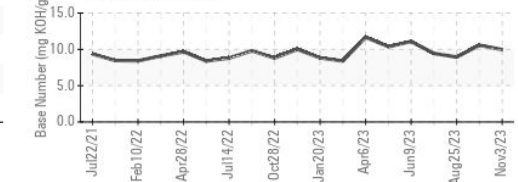

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0013089 **Received** : 16 Nov 2023  
**Lab Number** : 06010275 **Diagnosed** : 22 Nov 2023  
**Unique Number** : 10749419 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**CITADEL DRILLING**  
 7550 W 120  
 ODESSA, TX  
 US 79763

Contact: MIKE COMBDEN  
 mcombden@citadelldrilling.com

T: (780)955-5509

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)