



FUEL REPORT

Sample Rating Trend

NORMAL



Machine Id
CR8803
Component
Diesel Fuel
Fluid
NOT GIVEN (--- GAL)



DIAGNOSIS

Recommendation
No corrective action is recommended at this time.

Corrosion
All metal levels are normal indicating no corrosion in the system.

Contaminants
The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition
The condition of the fuel is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | WC0867475 | --- | --- |
| Sample Date | Client Info | | | 27 Oct 2023 | --- | --- |
| Machine Age | hrs | Client Info | | 2067 | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|-----|-----------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | | 2.74 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|----------|----------|----------|
| Sulfur | ppm | ASTM D5185m | | 0 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.003 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 39.4 | --- | --- |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|----------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |





SAMPLE IMAGES

| method | limit/base | current | history1 | history2 |
|--------|------------|---------|----------|----------|
| Color | | | no image | no image |
| Bottom | | | no image | no image |



FUEL REPORT

GRAPHS

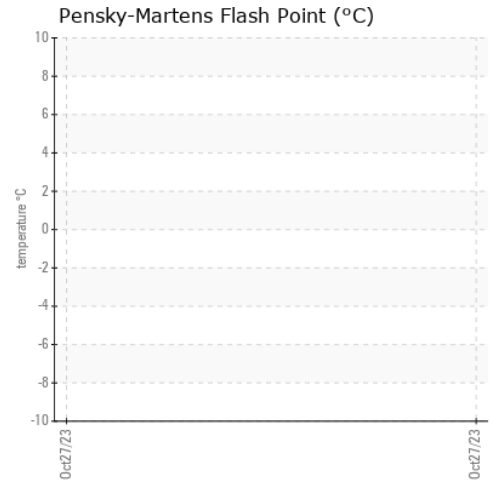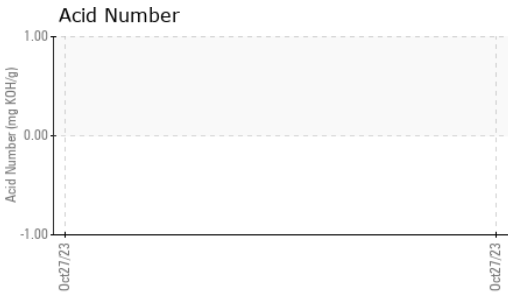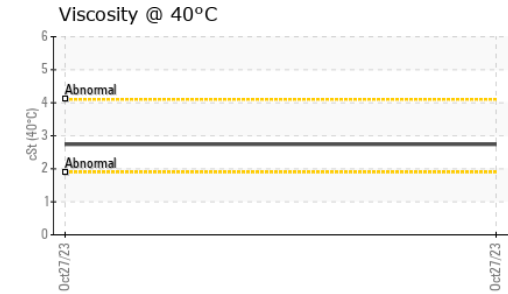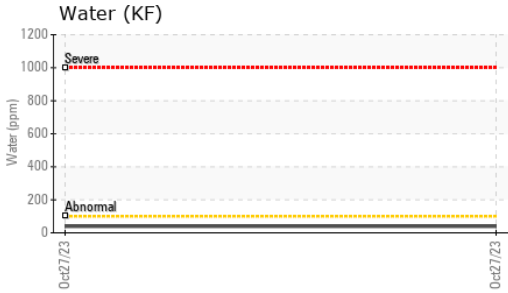

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0867475 **Received** : 16 Nov 2023
Lab Number : **06010436** **Diagnosed** : 17 Dec 2023
Unique Number : 10749580 **Diagnostician** : Doug Bogart
Test Package : CONST (Additional Tests: ICP, KF, KV40, PrtCount, SCREEN)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BUCKNER HEAVY LIFT
 4732 NC 54 EAST
 GRAHAM, NC
 US 27253-9215

Contact: MICHAEL LAWSON
 michael@bucknercompanies.com

T: (336)376-8888

F: (336)376-4090