


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER DSD 150 7007312 (S/N 1082)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIACNOSIS

Recommendation

Resample at the next service interval to monitor.

Moor

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct2019	Jun 2020 Mar 2021	Oct2021 Apr2022 Oct2022	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC110808	KC101671	KC105767
Sample Date		Client Info		17 Nov 2023	15 Feb 2023	17 Oct 2022
Machine Age	hrs	Client Info		34993	29509	26807
Oil Age	hrs	Client Info		4191	4429	1727
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	4	5	5
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	0	0	2
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	21
Zinc	ppm	ASTM D5185m		0	<1	4
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	1
Sodium	ppm	ASTM D5185m		0	<1	2
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.003	0.015	0.008
ppm Water	ppm	ASTM D6304	>500	28.5	155.3	80.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		597		9623
Particles >6µm		ASTM D7647	>1300	205		<u>^</u> 2497
Particles >14μm		ASTM D7647	>80	37		<u>▲</u> 165
Particles >21µm		ASTM D7647	>20	15		4 8
Particles >38μm		ASTM D7647	>4	1		1
Particles >71µm		ASTM D7647	>3	0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/15/12		<u>△</u> 20/18/15
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41	0.42	0.41



OIL ANALYSIS REPORT

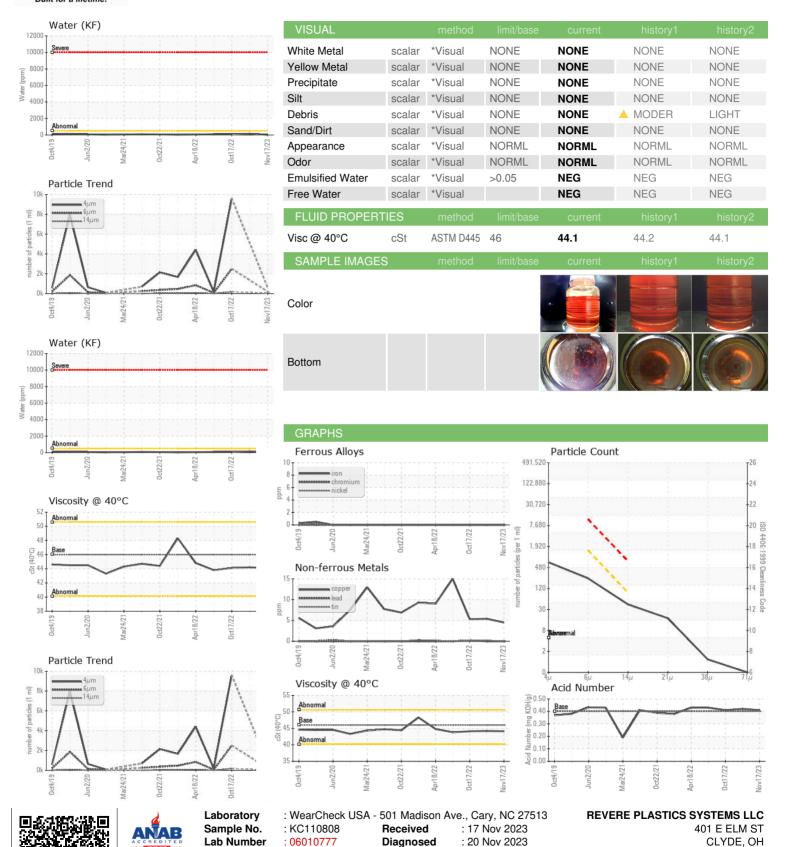

Certificate L2367

Unique Number

Test Package

: 10749921

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: Don Baldridge

US 43410

Contact:

T: F: