

PROBLEM SUMMARY

Sample Rating Trend

WATER


Machine Id

KAESER BSD 50 4886908 (S/N 1086)


Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)



COMPONENT CONDITION SUMMARY

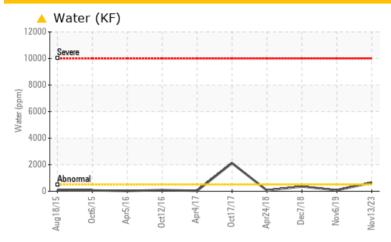

RECOMMENDATION

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL	ATTENTION		
Water	%	ASTM D6304	>0.05	△ 0.065	0.008	0.036		
ppm Water	ppm	ASTM D6304	>500	<u></u> 650	80.6	360		
Debris	scalar	*Visual	NONE	▲ HEAVY	▲ MODER	LIGHT		
Emulsified Water	scalar	*Visual	>0.05	A 0.2%	NEG	0.2%		

Customer Id: STABELKC Sample No.: KCPA005818 Lab Number: 06010788 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert			?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

06 Nov 2019 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



07 Dec 2018 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

24 Apr 2018 Diag: Jonathan Hester

VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. High concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



WATER

Machine Id

KAESER BSD 50 4886908 (S/N 1086)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

High concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

		Aug2015 Oct2	015 Apr2016 Oct2016 Apr20	017 Oct2017 Apr2018 Dec2018 Nov2	019 Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005818	KCP23264	KCP14515
Sample Date		Client Info		13 Nov 2023	06 Nov 2019	07 Dec 2018
Machine Age	hrs	Client Info		62372	37100	31310
Oil Age	hrs	Client Info		0	4800	0
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	11	8
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	0	0	0
Calcium	ppm	ASTM D5185m	2	0	0	8
Phosphorus	ppm	ASTM D5185m		0	0	2
Zinc	ppm	ASTM D5185m		2	0	8
Sulfur	ppm	ASTM D5185m		16732	14480	18061
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.05	<u> </u>	0.008	0.036
ppm Water	ppm	ASTM D6304	>500	650	80.6	360
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647			3269	1012
Particles >6µm		ASTM D7647	>1300		<u>1780</u>	551
Particles >14μm		ASTM D7647	>80		△ 303	△ 94
Particles >21µm		ASTM D7647	>20		<u>102</u>	△ 31
Particles >38μm		ASTM D7647	>4		<u>15</u>	4
Particles >71μm		ASTM D7647	>3		1	0
Oil Cleanliness		ISO 4406 (c)	>17/13		<u> 18/15</u>	△ 16/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.41



OIL ANALYSIS REPORT







Certificate L2367

Laboratory **Unique Number**

Sample No. Lab Number

ś

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA005818 : 06010788

: 10749932

Received : 17 Nov 2023 Diagnosed

: 20 Nov 2023 Diagnostician : Don Baldridge

lov13/23

Nov13/23

(B) 0.50 W 0.40 Ē 0.30 흗 0.20

≥ 0.10 00.00 PG Acid Number

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

Viscosity @ 40°C

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

STATEWIDE BORING

6401 HAGGERTY RD BELLEVILLE, MI US 48111

Contact:

T: F: