

# **PROBLEM SUMMARY**

Sample Rating Trend



Machine Id


# KAESER SFC 160 5704973 (S/N 1003)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **COMPONENT CONDITION SUMMARY**

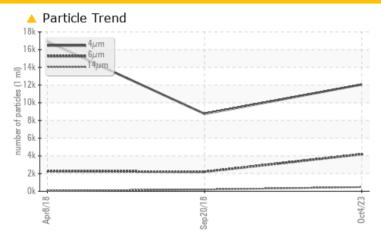

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ATTENTION				
Particles >6µm	ASTM D7647	>1300	<b>4183</b>	<u>^</u> 2199	<u>2268</u>				
Particles >14μm	ASTM D7647	>80	<b>476</b>	<b>1</b> 94	57				
Particles >21µm	ASTM D7647	>20	<b>^</b> 54	<u></u> 55	13				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>21/19/16</b>	<u></u> 18/15	▲ 18/13				

Customer Id: ARCHAMKC Sample No.: KC06010803 Lab Number: 06010803 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

## HISTORICAL DIAGNOSIS

## 20 Sep 2018 Diag: Angela Borella

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 08 Apr 2018 Diag: Angela Borella

150



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



# KAESER SFC 160 5704973 (S/N 1003)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **DIAGNOSIS**

## Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		An	2018	Sep2018 Oct20	73	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info	minu bass	KC06010803	KC79150	KC62897
Sample Date		Client Info		04 Oct 2023	20 Sep 2018	08 Apr 2018
Machine Age	hrs	Client Info		33533	5467	1921
Oil Age	hrs	Client Info		0	5467	1921
Oil Changed	1110	Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	6	<1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m		6	3	1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m	7.0		0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	le le	method	limit/base	-		
			IIIIIIVDase	current	history1	history2
Boron	ppm	ASTM D5185m	00	0	0	<1
Barium	ppm	ASTM D5185m	90	<1	0	25
Molybdenum	ppm	ASTM D5185m		0	0 <1	<1 <1
Manganese	ppm	ASTM D5185m ASTM D5185m	90	0	35	65
Magnesium Calcium	ppm	ASTM D5185m	2	0	0	5
	ppm	ASTM D5185m	2	319	0	43
Phosphorus Zinc	ppm	ASTM D5185m		12	8	7
-	ppm					
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	<1
Sodium	ppm	ASTM D5185m		2	11	16
Potassium	ppm	ASTM D5185m	>20	0	5	35
Water	%	ASTM D6304	>0.05	0.010	0.024	0.012
ppm Water	ppm	ASTM D6304	>500	107.9	240	120
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12064	8748	16918
Particles >6µm		ASTM D7647	>1300	<u>4183</u>	<u>^</u> 2199	<u>▲</u> 2268
Particles >14μm		ASTM D7647	>80	<b>476</b>	<u> </u>	57
Particles >21μm		ASTM D7647	>20	<u>^</u> 54	<u></u> 55	13
Particles >38μm		ASTM D7647	>4	2	3	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/16	<b>▲</b> 18/15	<b>▲</b> 18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)		ACTM DODAE	0.4	0.34	0.397	0.321

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.397

0.34

0.321



## **OIL ANALYSIS REPORT**

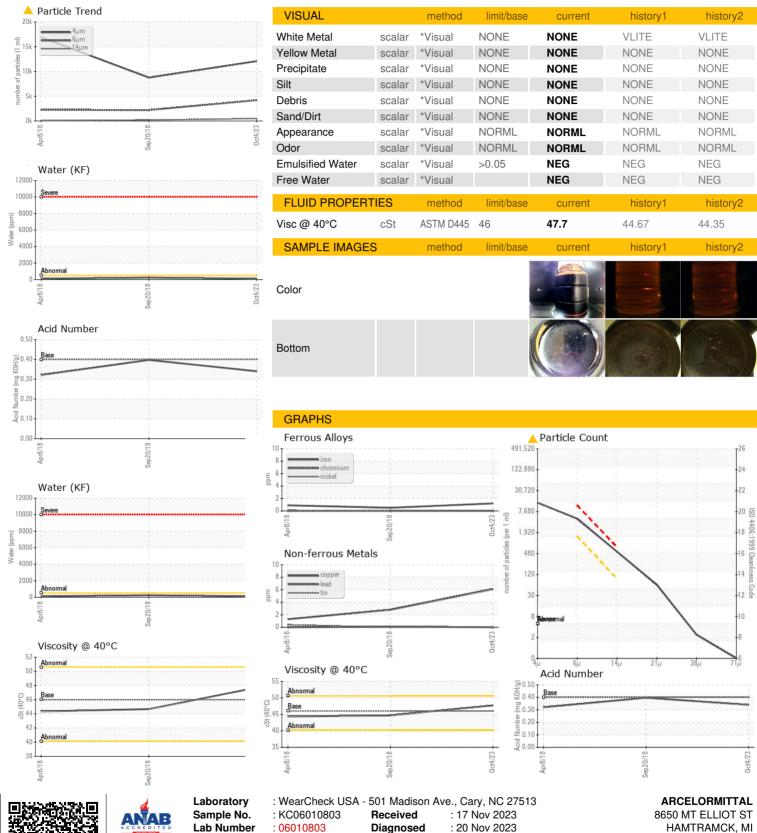





Certificate L2367

Lab Number **Unique Number** 

Test Package

: 06010803

: 10749947

: 20 Nov 2023 Diagnostician : Don Baldridge HAMTRAMCK, MI US 48212

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: