




PROBLEM SUMMARY

Sample Rating Trend

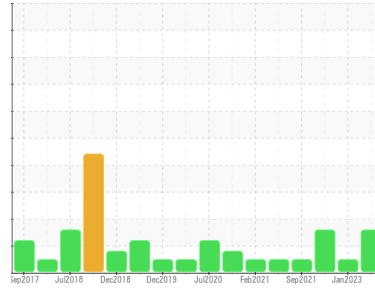


ISO



Machine Id
KAESER SFC 18S 5697580 (S/N 1140)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

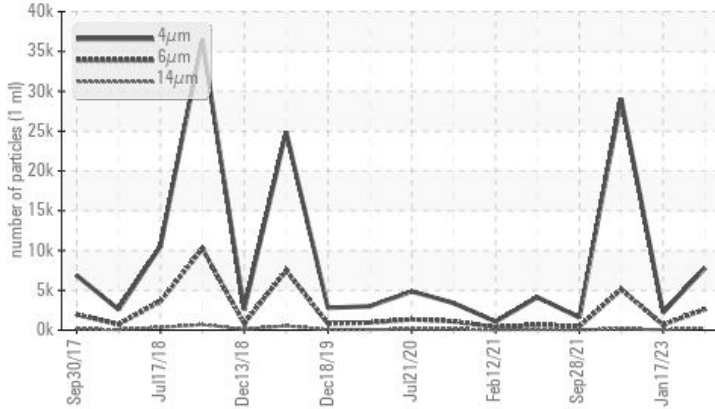

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2622	678	▲ 5110
Particles >14µm	ASTM D7647	>80	▲ 297	42	▲ 168
Particles >21µm	ASTM D7647	>20	▲ 84	6	▲ 31
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	18/17/13	▲ 22/20/15

Customer Id: ANTHOW
 Sample No.: KC125358
 Lab Number: 06010811
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

17 Jan 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Apr 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Sep 2021 Diag: Doug Bogart

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

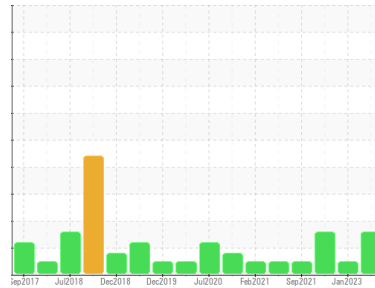

ISO



Machine Id
KAESER SFC 18S 5697580 (S/N 1140)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC125358	KC105772	KC94607
Sample Date	Client Info	12 Sep 2023	17 Jan 2023	13 Apr 2022
Machine Age	hrs	34441	3901	27754
Oil Age	hrs	0	6627	2772
Oil Changed	Client Info	N/A	Not Changd	Not Changd
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	4	9	11
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	30	0	23
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	43	32	52
Calcium	ppm	ASTM D5185m 2	0	1	<1
Phosphorus	ppm	ASTM D5185m	0	6	<1
Zinc	ppm	ASTM D5185m	19	57	36

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	7	23	24
Potassium	ppm	ASTM D5185m >20	<1	5	1
Water	%	ASTM D6304 >0.05	0.023	0.009	0.022
ppm Water	ppm	ASTM D6304 >500	233.8	90.1	226.8

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	7802	2203	29029
Particles >6µm	ASTM D7647 >1300	▲ 2622	678	▲ 5110
Particles >14µm	ASTM D7647 >80	▲ 297	42	▲ 168
Particles >21µm	ASTM D7647 >20	▲ 84	6	▲ 31
Particles >38µm	ASTM D7647 >4	3	1	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/19/15	18/17/13	▲ 22/20/15

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.37	0.41

OIL ANALYSIS REPORT


▲ Particle Trend

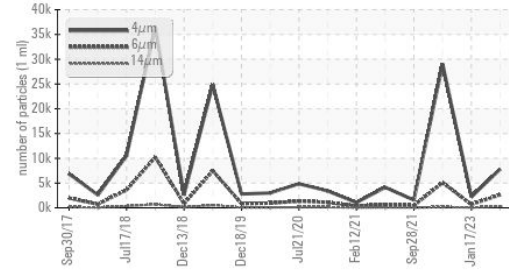


Water (KF)

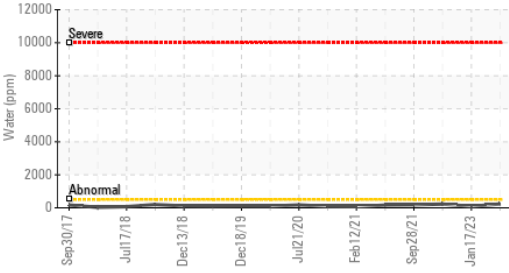


Acid Number

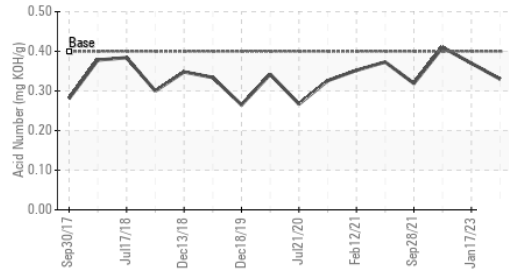

Water (KF)

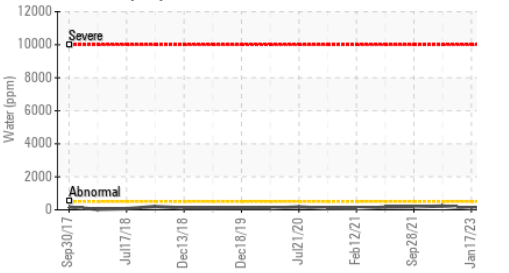

Viscosity @ 40°C

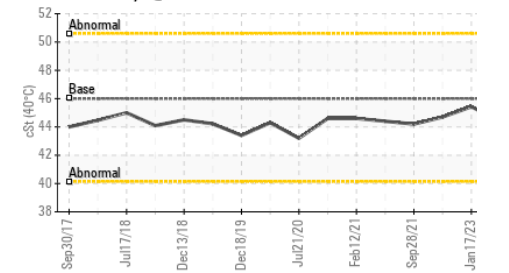


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	45.43	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

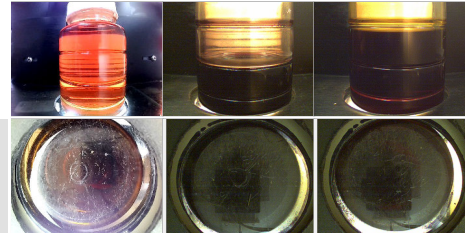


Bottom

GRAPHS


Ferrous Alloys

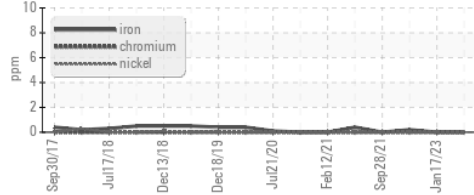


Non-ferrous Metals

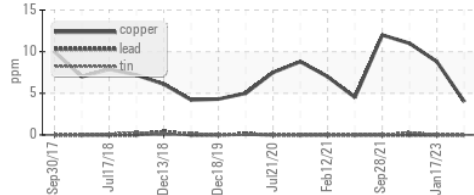


Viscosity @ 40°C

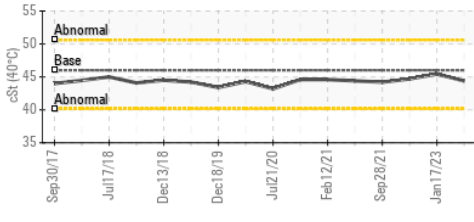

▲ Particle Count

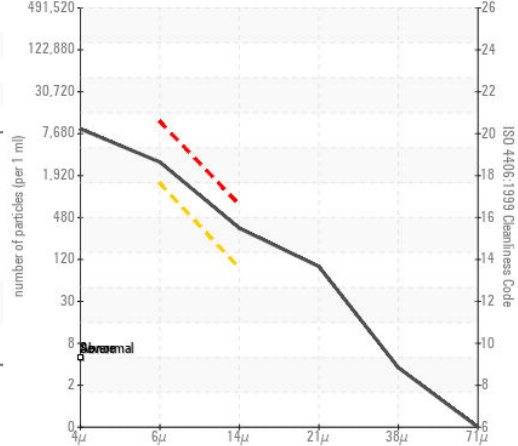

Acid Number

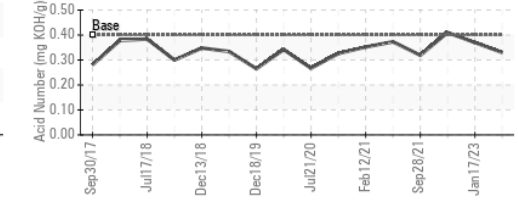

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KC125358
 Lab Number : 06010811
 Unique Number : 10749955
 Test Package : IND 2
 Received : 17 Nov 2023
 Diagnosed : 20 Nov 2023
 Diagnostician : Don Baldrige

ANTOLIN HOWELL
 3705 W GRAND RIVER AVE
 HOWELL, MI
 US 48855
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: