


PROBLEM SUMMARY

KAESER SK20T 3689995 (S/N 1121)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

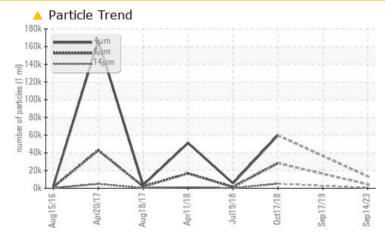

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS Sample Status ABNORMAL ABNORMAL ABNORMAL Particles >6µm ASTM D7647 >1300 4434 ▲ 28332 Particles >14µm ASTM D7647 >80 539 ▲ 5060 ▲ 147 Particles >21µm ASTM D7647 >20 **1658** Particles >38µm ASTM D7647 >4 Δ 5 ▲ 70 **Oil Cleanliness** ISO 4406 (c) >--/17/13 🔺 21/19/16 ▲ 22/20


Customer Id: INTCLIKC Sample No.: KCPA005850 Lab Number: 06010815 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

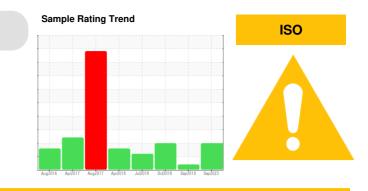

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

17 Sep 2019 Diag: Jonathan Hester

VIS DEBRIS



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



17 Oct 2018 Diag: Jonathan Hester

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





19 Jul 2018 Diag: Doug Bogart

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

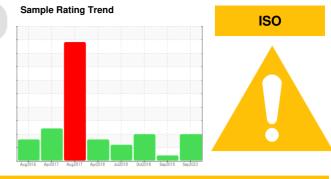


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005850	KC79229	KCP14520
Sample Date		Client Info		14 Sep 2023	17 Sep 2019	17 Oct 2018
Machine Age	hrs	Client Info		74369	56669	53060
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	4	1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
			>10	0	<1	0
Lead	ppm	ASTM D5185m ASTM D5185m		0	5	6
Copper	ppm		>50 >10	-		
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	13	<1	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	15	55	28
Calcium	ppm	ASTM D5185m	2	0	1	0
Phosphorus	ppm	ASTM D5185m		6	9	0
Zinc	ppm	ASTM D5185m		5	<1	10
Sulfur	ppm	ASTM D5185m		4787	16462	22904
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6	1	<1
Sodium	ppm	ASTM D5185m		<1	15	11
Potassium	ppm	ASTM D5185m		0	2	1
Water	%	ASTM D6304		0.008	0.022	0.016
ppm Water	ppm	ASTM D6304	>500	88.4	227.7	160
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		13373		59775
Particles >6µm		ASTM D7647	>1300	<u> </u>		<u> </u>
Particles >14µm		ASTM D7647	>80	<u> </u>		▲ 5060
Particles >21µm		ASTM D7647	>20	🔺 147		1658
Particles >38µm		ASTM D7647	>4	<u> </u>		1 70
Particles >71µm		ASTM D7647	>3	0		<u> </u>
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 21/19/16		▲ 22/20
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.13	0.333	0.327
:16:46) Bev: 1			5		ontact/Location:	


Report Id: INTCLIKC [WUSCAR] 06010815 (Generated: 11/20/2023 18:16:46) Rev: 1


Contact/Location: ? ? - INTCLIKC



OIL ANALYSIS REPORT






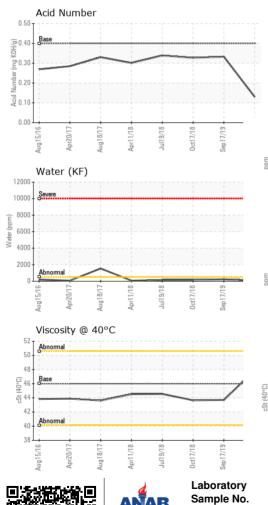

VISUAL		method	limit/base	current	history1	history2
VICONE		method	in the base	Guirent	Thistory	matoryz
White Metal	scalar	*Visual	NONE	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	🔺 MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.9	43.7	43.64
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						



Bottom

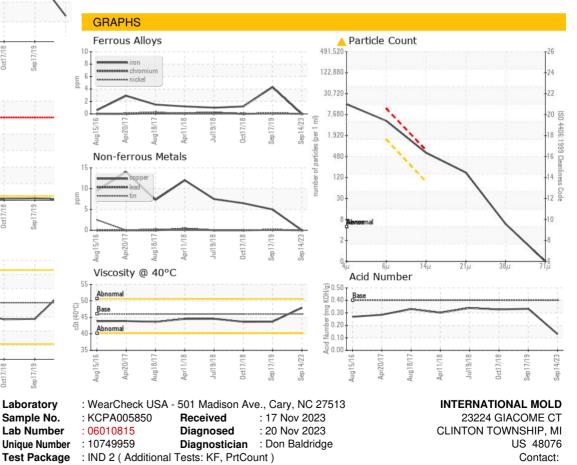

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Certificate L2367

Contact/Location: ? ? - INTCLIKC