




# PROBLEM SUMMARY

Sample Rating Trend

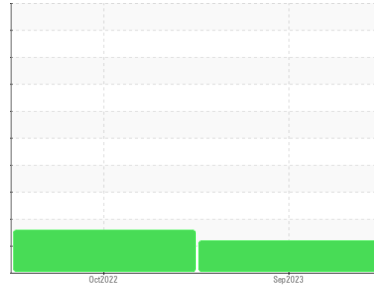


ISO



Machine Id  
**KAESER 8204756 (S/N 1455)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

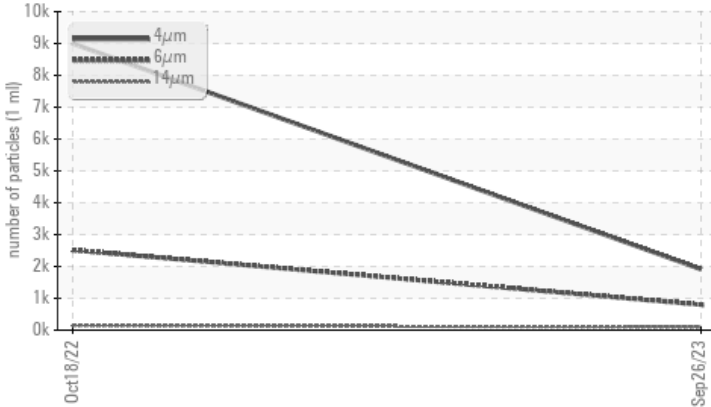

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	---
Particles >14µm	ASTM D7647	>80	▲ <b>93</b>	▲ 147	---
Particles >21µm	ASTM D7647	>20	▲ <b>24</b>	▲ 30	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>18/17/14</b>	▲ 20/19/14	---

Customer Id: MACSYL  
 Sample No.: KC125384  
 Lab Number: 06010816  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**18 Oct 2022 Diag: Jonathan Hester**

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

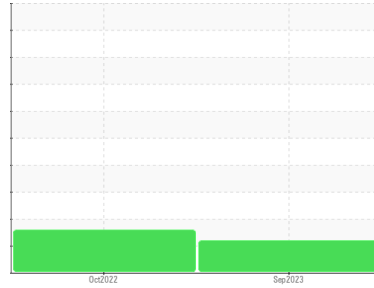

ISO



Machine Id  
**KAESER 8204756 (S/N 1455)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC125384</b>	KC107050	---
Sample Date	Client Info			<b>26 Sep 2023</b>	18 Oct 2022	---
Machine Age	hrs	Client Info		<b>2795</b>	971	---
Oil Age	hrs	Client Info		<b>0</b>	971	---
Oil Changed	Client Info			<b>N/A</b>	Changed	---
Sample Status				<b>ATTENTION</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	2	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>70</b>	71	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	1	---
Phosphorus	ppm	ASTM D5185m		<b>1</b>	28	---
Zinc	ppm	ASTM D5185m		<b>7</b>	7	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	2	---
Sodium	ppm	ASTM D5185m		<b>12</b>	12	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	---
Water	%	ASTM D6304	>0.05	<b>0.026</b>	0.027	---
ppm Water	ppm	ASTM D6304	>500	<b>260.8</b>	272.5	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1912</b>	9000	---
Particles >6µm		ASTM D7647	>1300	<b>799</b>	▲ 2514	---
Particles >14µm		ASTM D7647	>80	▲ <b>93</b>	▲ 147	---
Particles >21µm		ASTM D7647	>20	▲ <b>24</b>	▲ 30	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>18/17/14</b>	▲ 20/19/14	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.35	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

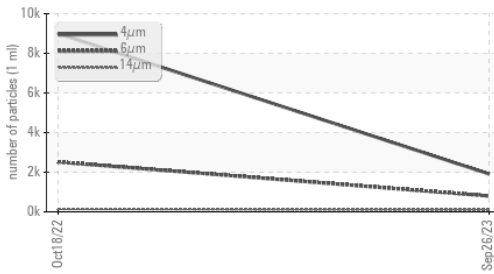


## Water (KF)

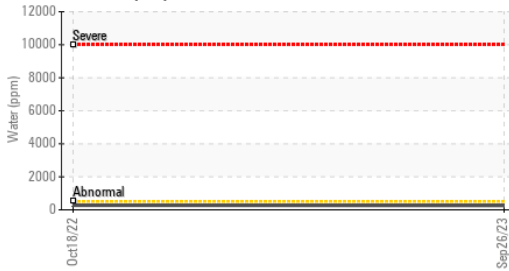


## Acid Number

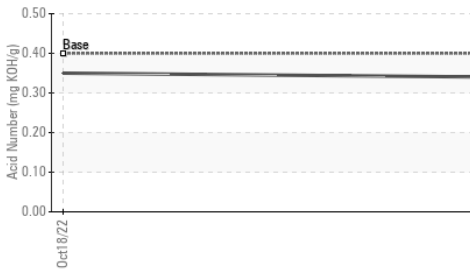

## Water (KF)

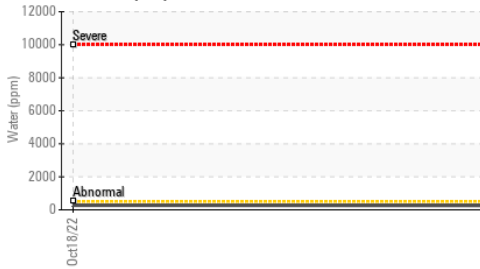


## Viscosity @ 40°C

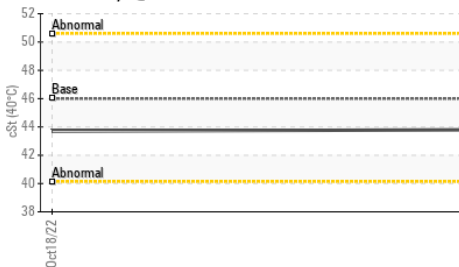

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.8	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

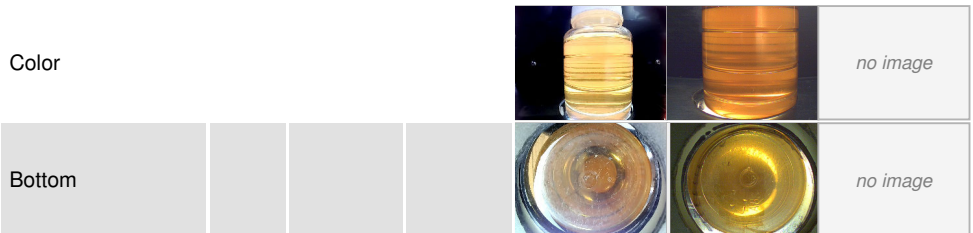


## GRAPHS


### Ferrous Alloys

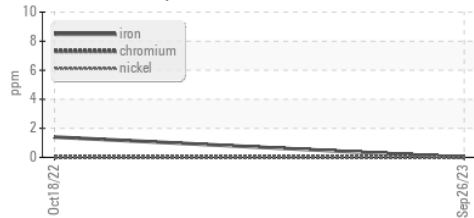


### Non-ferrous Metals

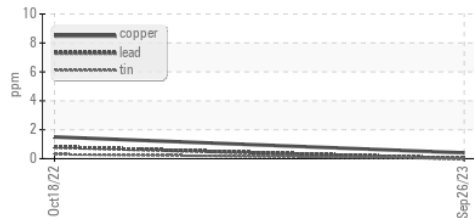

### Viscosity @ 40°C

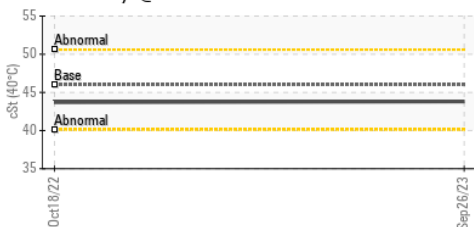

### ▲ Particle Count

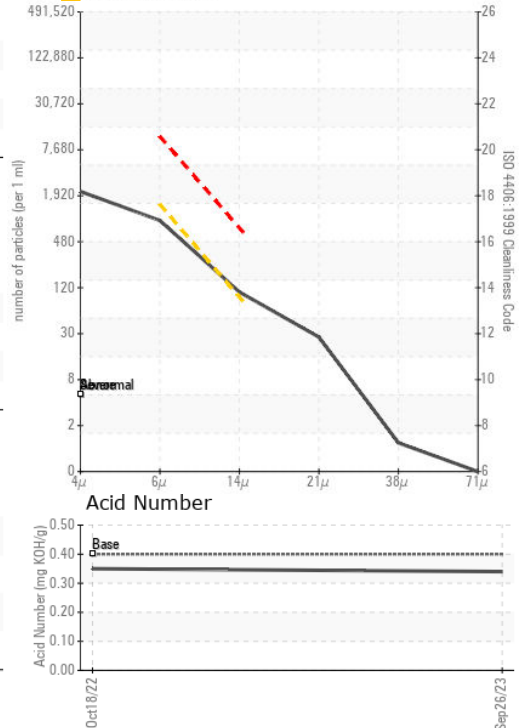

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC125384 **Received** : 17 Nov 2023  
**Lab Number** : 06010816 **Diagnosed** : 20 Nov 2023  
**Unique Number** : 10749960 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**MACK INDUSTRIAL**  
 3485 SILICA RD, UNIT D  
 SYLVANIA, OH  
 US 43560  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: