


## **PROBLEM SUMMARY**

# KAESER AS 30T 6522617 (S/N 1009)

Compressor

#### KAESER SIGMA (OEM) M-460 (--- GAL)

#### COMPONENT CONDITION SUMMARY

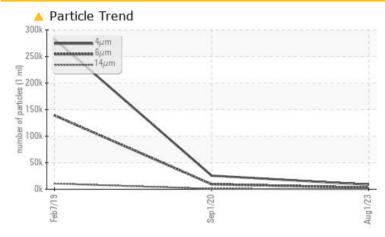

#### RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ABNORMA	SEVERE	SEVERE			
Particles >6µm	ASTM D7647 >13	300 <b>A 2930</b>	<b>4</b> 9485	139233			
Particles >14µm	ASTM D7647 >80	) 🔺 270	871	10653			
Particles >21µm	ASTM D7647 >20	) 🔺 69	262	9 3391			
Oil Cleanliness	ISO 4406 (c) >/	17/13 <b>A 20/19/15</b>	20/17	24/21			


Customer Id: JACWESMI Sample No.: KCPA002375 Lab Number: 06010817 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Don Baldridge +1 <u>don.b505@comcast.net</u>

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

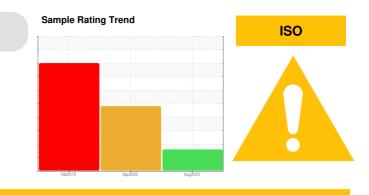

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Filter			?	We recommend you service the filters on this component.		

#### HISTORICAL DIAGNOSIS



01 Sep 2020 Diag: Angela Borella

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 07 Feb 2019 Diag: Angela Borella



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**



Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### A Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

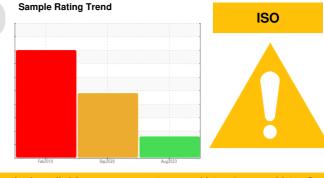

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA002375	KCP30190	KCP11186
Sample Date		Client Info		01 Aug 2023	01 Sep 2020	07 Feb 2019
Machine Age	hrs	Client Info		33131	11061	3108
Oil Age	hrs	Client Info		0	4000	3108
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				ABNORMAL	SEVERE	SEVERE
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m		0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m		9	17	7
Tin	ppm	ASTM D5185m		0	0	<1
Antimony	ppm	ASTM D5185m	210		0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium		ASTM D5185m		0	0	0
	ppm	ASTIVI DOTODIII		U	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	23
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	8	17	57
Calcium	ppm	ASTM D5185m	0	0	<1	3
Phosphorus	ppm	ASTM D5185m	0	0	3	2
Zinc	ppm	ASTM D5185m	0	58	49	14
Sulfur	ppm	ASTM D5185m	23500	18463	15746	20124
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	2
Sodium	ppm	ASTM D5185m		3	6	26
Potassium	ppm	ASTM D5185m	>20	0	<1	4
Water	%	ASTM D6304	>0.05	0.009	0.013	0.010
ppm Water	ppm	ASTM D6304	>500	93.9	132.1	100
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8674	25684	283017
Particles >6µm		ASTM D7647	>1300	<u> </u>	<b>9</b> 485	139233
Particles >14μm		ASTM D7647	>80	<b>A</b> 270	871	10653
Particles >21µm		ASTM D7647	>20	<u> </u>	262	<b>3</b> 391
Particles >38µm		ASTM D7647	>4	1	<b>1</b> 5	145
Particles >71µm		ASTM D7647		0	0	4
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	20/17	<b>2</b> 4/21
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

Acid Number (AN) mg KC

mg KOH/g ASTM D8045 1.0

Contact/Location: Service Manager - JACWESMI


0.373


0.39


0.384

#### KAESER COMPRESSORS Built for a lifetime."

## **OIL ANALYSIS REPORT**






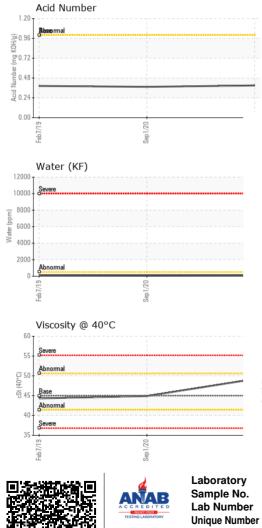

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	HEAVY
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT		method	limit/base	current	history1	history2
		methou	IIIIII/Dase	Current	Thistory I	TIStory2
Visc @ 40°C	cSt	ASTM D445	45	49.2	44.9	44.31
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						

Bottom

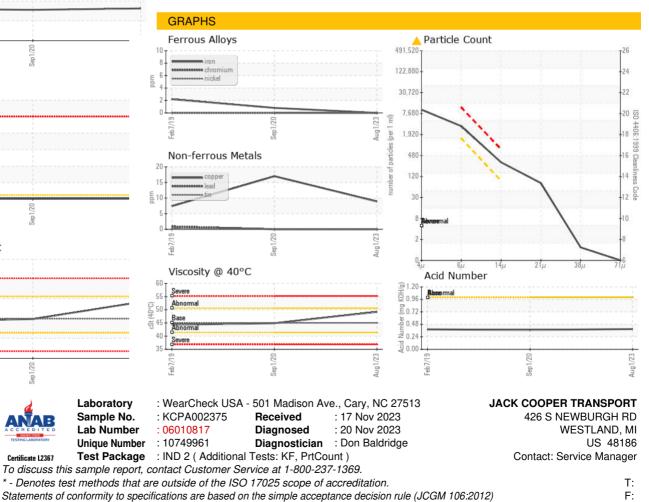

Contact/Location: Service Manager - JACWESMI