

**OIL ANALYSIS REPORT** 

KAESER 1135

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

# Sample Rating Trend



# Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2022	Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126090	KC105750	
Sample Date		Client Info		25 Sep 2023	29 Nov 2022	
Machine Age	hrs	Client Info		8360	4238	
Oil Age	hrs	Client Info		0	4238	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	11	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	0	3	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	5	
Zinc	ppm	ASTM D5185m		6	13	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	
Sodium	ppm	ASTM D5185m		1	0	
Potassium	ppm	ASTM D5185m	>20	0	2	
Water	%	ASTM D6304	>0.05	0.006	0.002	
ppm Water	ppm	ASTM D6304	>500	60.4	22.1	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1731	4070	
Particles >6µm		ASTM D7647	>1300	627	<u>▲</u> 1581	
Particles >14μm		ASTM D7647	>80	74	<b>▲</b> 84	
Particles >21µm		ASTM D7647	>20	21	9	
Particles >38μm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	<b>1</b> 9/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -!-! NI! (ANI)		A OTA A DOO 45	0.4	0.44	0.40	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.43

0.41



# **OIL ANALYSIS REPORT**

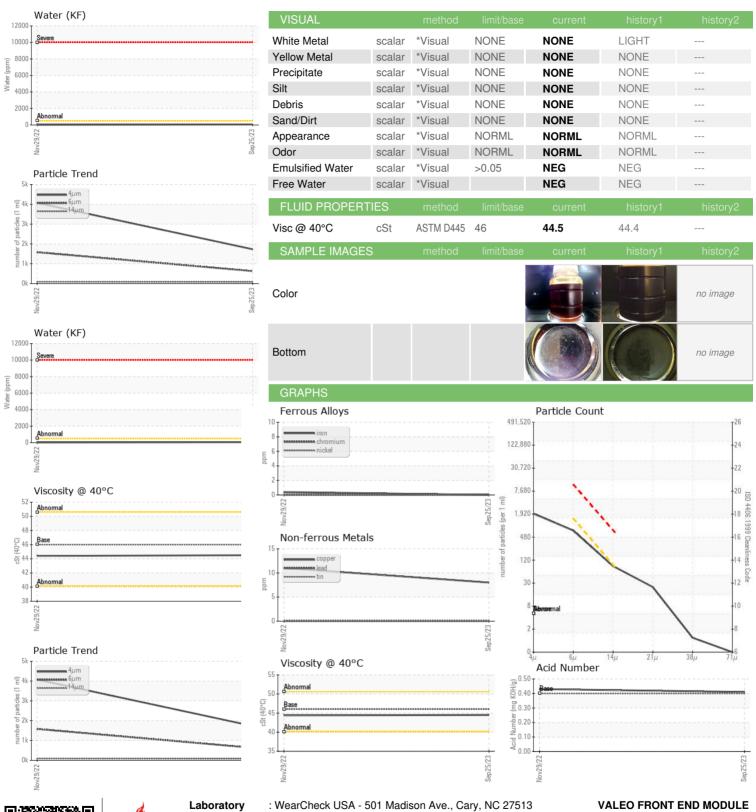



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC126090 : 06010841 : 10749985

: IND 2

: 17 Nov 2023 Received Diagnosed : 20 Nov 2023 Diagnostician

: Don Baldridge

12240 OAKLAND PKWY HIGHLAND PARK, MI US 48203

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: