


PROBLEM SUMMARY

Sample Rating Trend




WATER

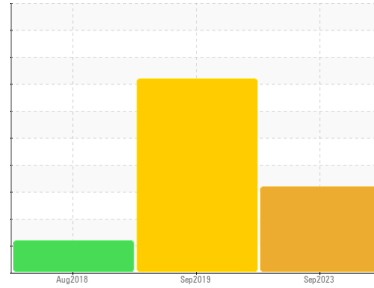

Machine Id
KAESER SM 7.5 5364458 (S/N 1226)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

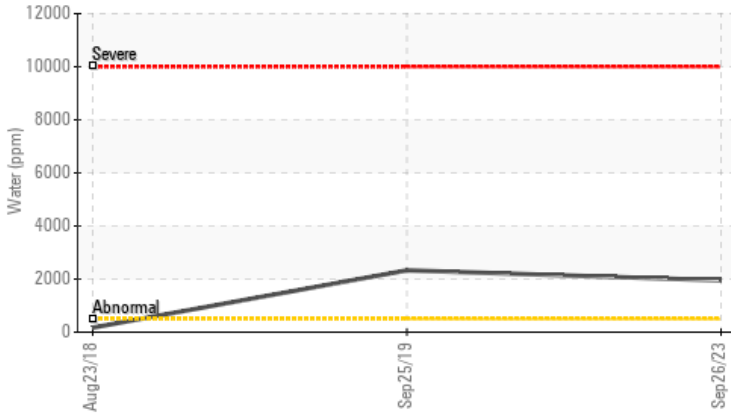

RECOMMENDATION

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	SEVERE	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.195	▲ 0.233	0.017
ppm Water	ppm	ASTM D6304	>500	▲ 1950	▲ 2330	170
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	0.2%	NEG
Free Water	scalar	*Visual		▲ >10%	● 5.0	NEG

Customer Id: SCSANN
Sample No.: KC101216
Lab Number: 06010862
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

25 Sep 2019 Diag: Jonathan Hester

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. There is too much water present in this sample to perform a particle count. All component wear rates are normal. Excessive free water present. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



23 Aug 2018 Diag: Angela Borella

ISO




No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

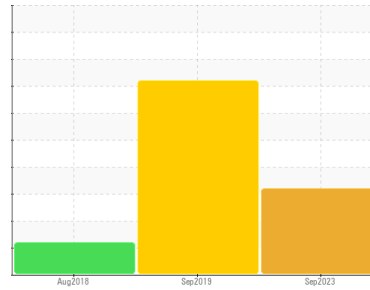

WATER



Machine Id
KAESER SM 7.5 5364458 (S/N 1226)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. Excessive free water present.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC101216	KC77329	KCP47946
Sample Date	Client Info			26 Sep 2023	25 Sep 2019	23 Aug 2018
Machine Age	hrs	Client Info		2713	1825	1477
Oil Age	hrs	Client Info		2713	0	1477
Oil Changed	Client Info			N/A	Changed	N/A
Sample Status				ABNORMAL	SEVERE	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	19	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	1	5	2
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	6	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	<1
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	0	36	47
Calcium	ppm	ASTM D5185m	2	0	<1	<1
Phosphorus	ppm	ASTM D5185m		0	8	1
Zinc	ppm	ASTM D5185m		50	18	26

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	<1
Sodium	ppm	ASTM D5185m		<1	2	17
Potassium	ppm	ASTM D5185m	>20	0	1	2
Water	%	ASTM D6304	>0.05	▲ 0.195	▲ 0.233	0.017
ppm Water	ppm	ASTM D6304	>500	▲ 1950	▲ 2330	170

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	---	25013
Particles >6µm		ASTM D7647	>1300	---	---	▲ 11370
Particles >14µm		ASTM D7647	>80	---	---	▲ 340
Particles >21µm		ASTM D7647	>20	---	---	▲ 67
Particles >38µm		ASTM D7647	>4	---	---	6
Particles >71µm		ASTM D7647	>3	---	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	---	▲ 21/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.16	0.224	0.273


OIL ANALYSIS REPORT

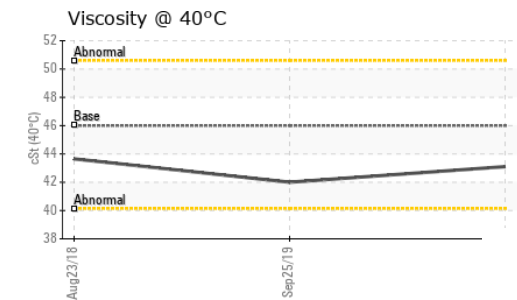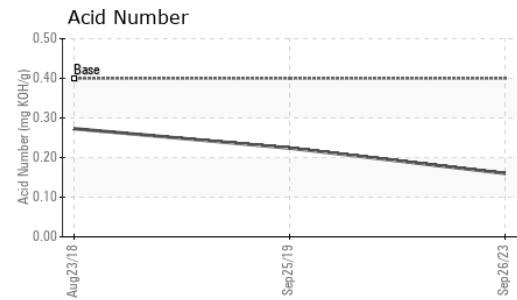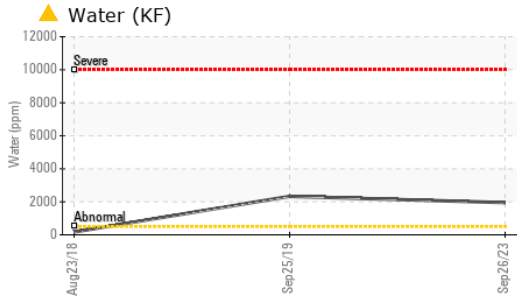





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ LAYRD	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		▲ >10%	● 5.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.1	42.0	43.65

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

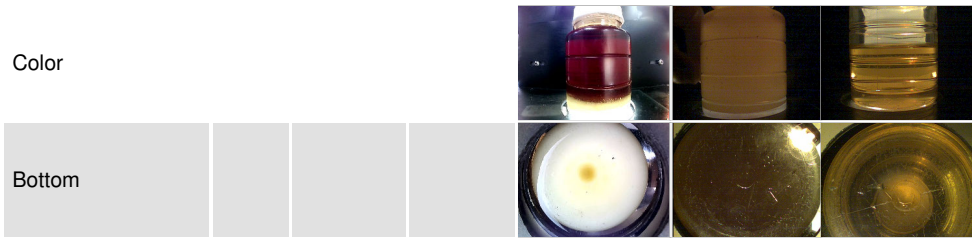

GRAPHS

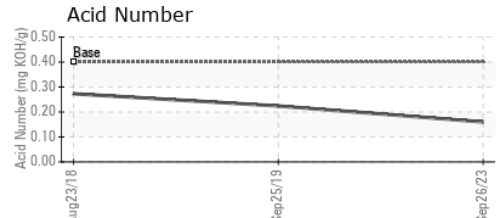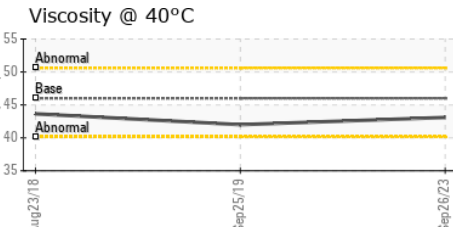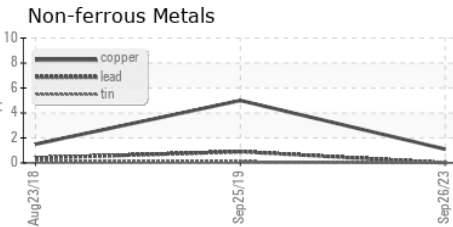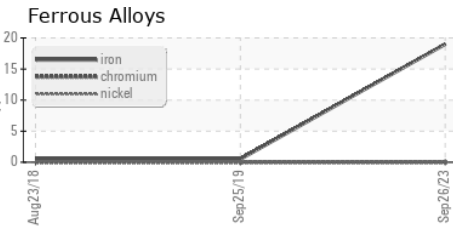

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC101216 **Received** : 17 Nov 2023
Lab Number : 06010862 **Diagnosed** : 20 Nov 2023
Unique Number : 10750006 **Diagnostician** : Don Baldrige
Test Package : IND 2

SCS - STEVE CUSTOM SIGNS
 4676 FREEDOM DR
 ANN ARBOR, MI
 US 48108
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: