



PROBLEM SUMMARY

Sample Rating Trend


WATER



Machine Id
CF201 (S/N 00881-003-1-01-01)


Component
Gearbox

Fluid
MOBIL GLYGOYLE 100 (--- GAL)

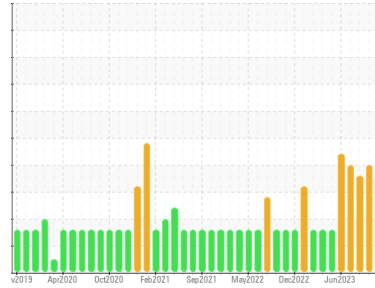


COMPONENT CONDITION SUMMARY

▲ Particle Trend

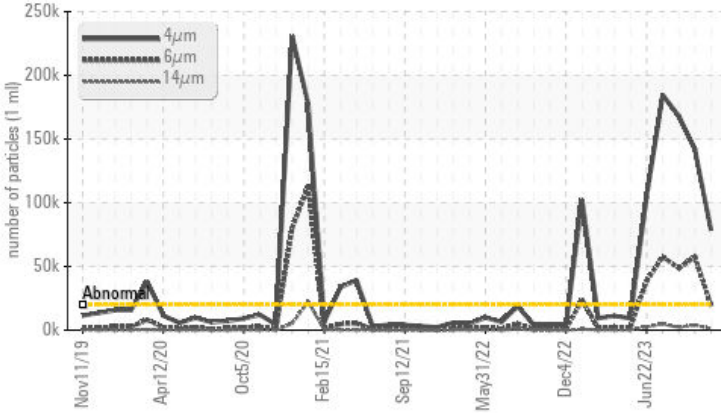

▲ Water (KF)

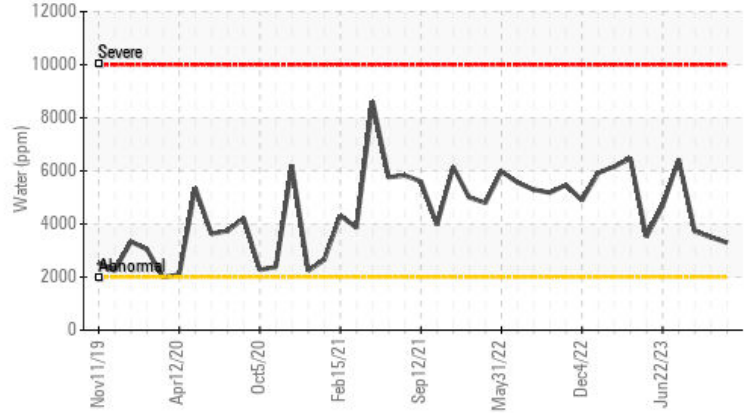

RECOMMENDATION

We advise that you check for the source of water entry. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.2	▲ 0.330	▲ 0.350	▲ 0.373
ppm Water	ppm	ASTM D6304	>2000	▲ 3300	▲ 3500	▲ 3730
Particles >4µm		ASTM D7647	>20000	▲ 78536	▲ 141941	▲ 168211
Particles >6µm		ASTM D7647	>5000	▲ 19847	▲ 57606	▲ 48653
Particles >14µm		ASTM D7647	>640	▲ 1143	▲ 3937	▲ 2153
Particles >21µm		ASTM D7647	>160	▲ 233	▲ 1019	▲ 542
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ 23/21/17	▲ 24/23/19	▲ 25/23/18

Customer Id: FLIFAI
Sample No.: USP246083
Lab Number: 06010874
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Check Water Access	---	---	?	We advise that you check for the source of water entry.

HISTORICAL DIAGNOSIS

01 Oct 2023 Diag: Doug Bogart

WATER



We advise that you check for the source of water entry. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



26 Aug 2023 Diag: Doug Bogart

WATER



We advise that you check for the source of water entry. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



06 Aug 2023 Diag: Jonathan Hester

WATER



We advise that you check for the source of water entry. We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

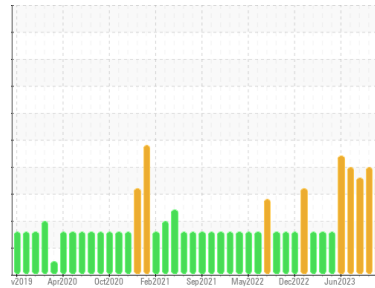

WATER



Machine Id
CF6201 (S/N 00881-003-1-01-01)

Component
Gearbox
Fluid
MOBIL GLYGOYLE 100 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP246083	USP0001761	USP234733
Sample Date	Client Info		17 Nov 2023	01 Oct 2023	26 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	6	66	74
Chromium	ppm	ASTM D5185m	>15	0	<1	1
Nickel	ppm	ASTM D5185m	>15	0	0	<1
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	0
Lead	ppm	ASTM D5185m	>100	0	<1	<1
Copper	ppm	ASTM D5185m	>200	0	0	11
Tin	ppm	ASTM D5185m	>25	0	<1	2
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	1
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		0	0	2
Phosphorus	ppm	ASTM D5185m		470	612	547
Zinc	ppm	ASTM D5185m		0	0	2
Sulfur	ppm	ASTM D5185m		654	839	853

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	2	<1	1
Sodium	ppm	ASTM D5185m		0	0	4
Potassium	ppm	ASTM D5185m	>20	2	4	2
Water	%	ASTM D6304	>0.2	▲ 0.330	▲ 0.350	▲ 0.373
ppm Water	ppm	ASTM D6304	>2000	▲ 3300	▲ 3500	▲ 3730






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 78536	▲ 141941	▲ 168211
Particles >6µm	ASTM D7647	>5000	▲ 19847	▲ 57606	▲ 48653
Particles >14µm	ASTM D7647	>640	▲ 1143	▲ 3937	▲ 2153
Particles >21µm	ASTM D7647	>160	▲ 233	▲ 1019	▲ 542
Particles >38µm	ASTM D7647	>40	8	▲ 51	26
Particles >71µm	ASTM D7647	>10	1	3	2
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/21/17	▲ 24/23/19	▲ 25/23/18

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		0.23	0.064	0.052


OIL ANALYSIS REPORT

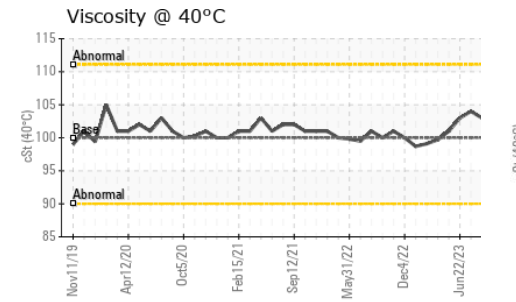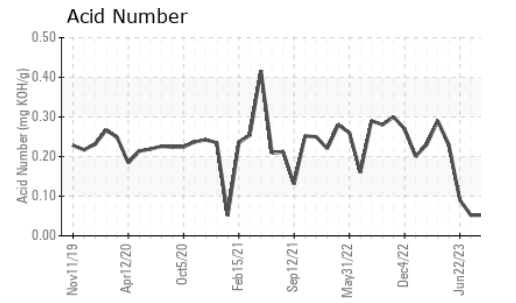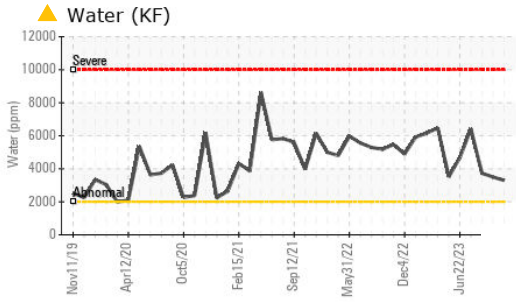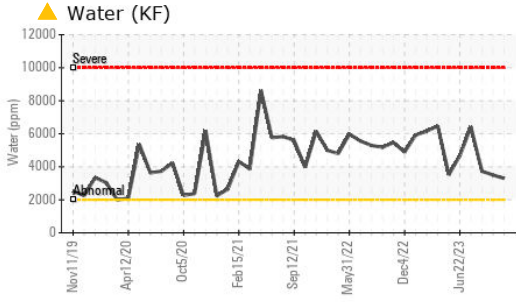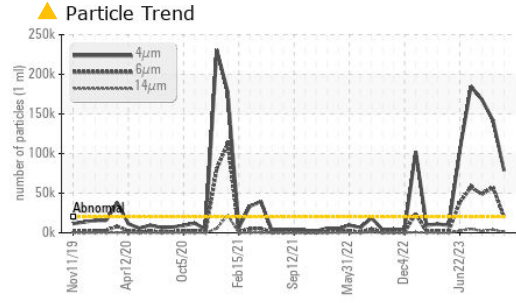






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100.0	104	103

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

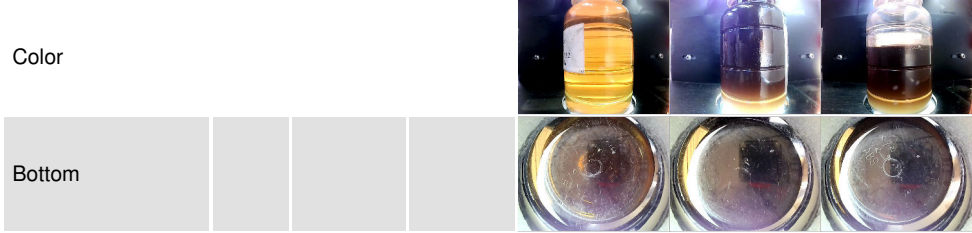

GRAPHS

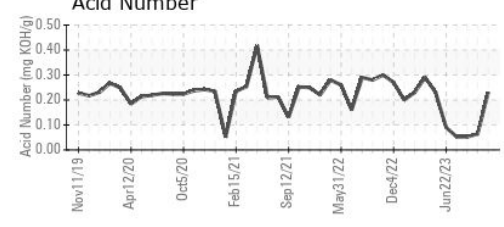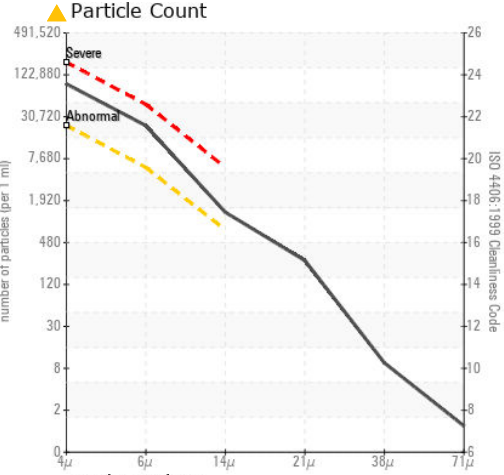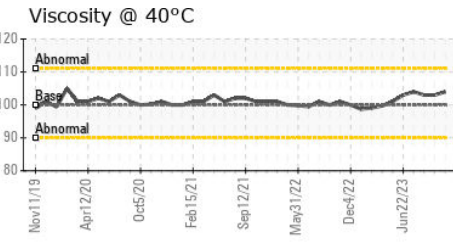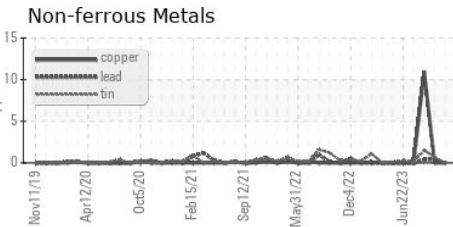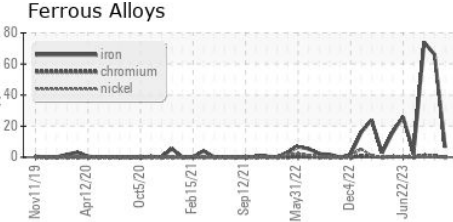

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP246083
Lab Number : 06010874
Unique Number : 10750018
Test Package : IND 2

POET BIO PROCESSING
 1277 102ND ST
 FAIRBANK, IA
 US 50662
 Contact: JASON GOEDKEN
 Jason.Goedken@POET.COM
 T: (319)284-2621
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)