

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id WC-9220-0102-5 Chiller #2

Component Chiller

YORK TYPE K (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0836498	WC0784743	
Sample Date		Client Info		13 Nov 2023	19 Jun 2023	
Machine Age	hrs	Client Info		19151	17907	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	
Chromium	ppm	ASTM D5185m	>2	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>3	0	0	
Lead	ppm	ASTM D5185m	>2	0	0	
Copper	ppm	ASTM D5185m		0	<1	
Tin	ppm	ASTM D5185m	>4	1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	0	0	<1	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	0	<1	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	5	1	0	
Zinc	ppm	ASTM D5185m	0	0	0	
Sulfur	ppm	ASTM D5185m	10	16	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	6	7	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304		0.044	0.064	
ppm Water	ppm	ASTM D6304		441.0	647.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	731	2831	
Particles >6µm		ASTM D7647	>2500	152	1323	
Particles >14µm		ASTM D7647	>320	10	77	
Particles >21µm		ASTM D7647	>80	3	9	
Particles >38µm		ASTM D7647	>20	0	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/14/10	19/18/13	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	0.016	0.046	



OIL ANALYSIS REPORT





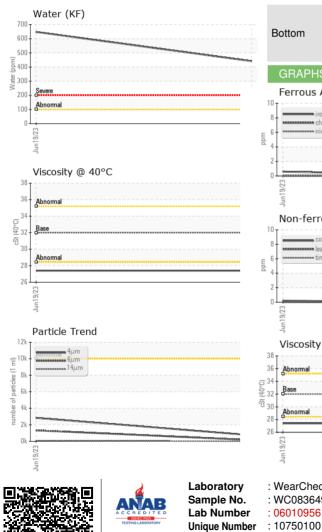

VISUAL		method				history
White Metal	scalar	*Visual	NONE	NONE	NONE	
ellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Ddor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERT	IES	method	limit/base	current	history1	history
/isc @ 40°C	cSt	ASTM D445	32.0	27.4	27.4	
SAMPLE IMAGES	3	method	limit/base	current	history1	history
Color						no image
Bottom						no image
GRAPHS						
Ferrous Alloys				Particle Coun	t	
iron			491,520	1		Ī
annean chromium			122,880	Severe		
			30,720			
				Abnormal		
			7,680	¹		
Jun 19/23			Nov13/23 : (per 1 ml		`	
			33			
Non-ferrous Metals	5		offined j			
copper						-
- tin			2 30			
133			EZ 2	-		
Jun 19/23			Nov13/23			
Viscosity @ 40°C			- 0	4μ Acid Number	14µ 21µ	38µ 71
Terrere						
Abnormal			Hoy 0.04			
Base			Ë 0.03	Base		
Abnormal			0.05 0,04 0,04 0,03 0,02 0,02 0,02 0,02 0,02 0,02 0,02			
0			2 0.01	1-		
Jun 19/23			Nov13/23	Jun 19/23		

: 20 Nov 2023

: Doug Bogart

10840 Guilford Road, Suites 406-407 Annapolis Junction, MD US 20701 Contact: Susan Nord susan.nord@chugachgov.com T: (301)688-6363 106:2012) F: (443)479-5666

Centificate 12367 Test Package : PLANT To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Diagnostician

Contact/Location: Susan Nord - CHUANN