


## **OIL ANALYSIS REPORT**

### Sample Rating Trend







# OIL Machine Id GN-4020A (S/N SOLAR A)

Turbine

**CASTROL PERFECTO XPG 32 (1000 GAL)** 

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the fluid. The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

1/2019 Juni2020 Juli2020 Sept2021 Mark8222 Aug/2012 Juni2023 Juni2023							
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		HLC0002862	HLC0002838	HLC0002758	
Sample Date		Client Info		09 Nov 2023	10 Oct 2023	01 Sep 2023	
Machine Age	hrs	Client Info		3397	0	0	
Oil Age	hrs	Client Info		0	0	0	
Oil Changed		Client Info		N/A	N/A	N/A	
Sample Status				NORMAL	NORMAL	NORMAL	
CONTAMINATION	٧	method	limit/base	current	history1	history2	
Water		WC Method	>0.03	NEG	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	0	0	<1	
Chromium	ppm	ASTM D5185m	>4	0	0	0	
Nickel	ppm	ASTM D5185m	>2	0	0	0	
Titanium	ppm	ASTM D5185m		0	<1	0	
Silver	ppm	ASTM D5185m		0	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	0	
Lead	ppm	ASTM D5185m		1	2	<1	
Copper	ppm	ASTM D5185m	>5	0	<1	0	
Tin	ppm	ASTM D5185m	>5	0	0	0	
Vanadium	ppm	ASTM D5185m		0	0	0	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0	0	
Barium	ppm	ASTM D5185m	0	0	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	0	
Manganese	ppm	ASTM D5185m	0	0	<1	0	
Magnesium	ppm	ASTM D5185m	0	0	0	<1	
Calcium	ppm	ASTM D5185m	0	0	2	3	
Phosphorus	ppm	ASTM D5185m	25	0	7	22	
Zinc	ppm	ASTM D5185m	0	0	2	7	
Sulfur	ppm	ASTM D5185m	1500	206	304	388	
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	2	2	2	
Sodium	ppm	ASTM D5185m		15	17	16	
Potassium	ppm	ASTM D5185m	>20	0	<1	1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2	
Particles >4μm		ASTM D7647		472	604	759	
Particles >6µm		ASTM D7647	>1300	126	139	267	
Particles >14µm		ASTM D7647	>160	16	12	17	
Particles >21µm		ASTM D7647		4	3	5	
Particles >38μm		ASTM D7647	>10	0	0	0	
Particles >71μm		ASTM D7647		0	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/14	16/14/11	16/14/11	17/15/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
A	11011						

Acid Number (AN)

mg KOH/g ASTM D8045 0.05


0.095


0.092


0.18




## **OIL ANALYSIS REPORT**










VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.03	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPERTIES		method				history2
Visc @ 40°C	cSt	ASTM D445	32.0	32.9	32.0	32.5

SAMPLE IMAGES

**Bottom** 

Color



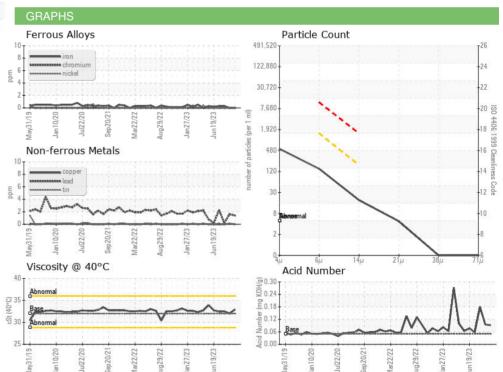





Certificate L2367

Laboratory Sample No. Lab Number

**Unique Number** Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 06011470 : 10750614

: HLC0002862

Received Diagnosed Diagnostician

: 17 Nov 2023 : 21 Nov 2023 : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. HILCORP NORTHSTAR FACILITY

PRUDHOE BAY, AK US 99734 Contact: PERRY NEEL

pneel@hilcorp.com T: (907)670-3514 F: (907)659-5377

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)