


# **PROBLEM SUMMARY**

# KAESER SX 7.5 AC 6142255 (S/N 1200)

Compressor



### COMPONENT CONDITION SUMMARY

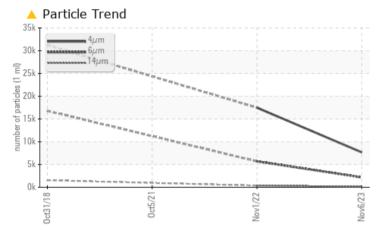

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### **PROBLEMATIC TEST RESULTS** Sample Status ATTENTION ABNORMAL NORMAL Particles >6µm ASTM D7647 >1300 2180 ▲ 5689 Particles >14µm ASTM D7647 >80 ▲ 366 Particles >21µm ASTM D7647 >20 34 **1**78 **Oil Cleanliness** ISO 4406 (c) >--/17/13 **A** 20/18/14 21/20/16


Customer Id: VANWAD Sample No.: KC124813 Lab Number: 06011506 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

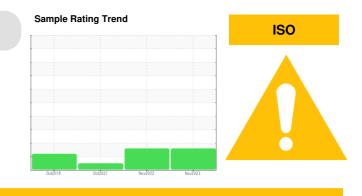

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### **HISTORICAL DIAGNOSIS**

### 01 Nov 2022 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### 05 Oct 2021 Diag: Doug Bogart



Resample at the next service interval to monitor. We were unable to perform a particle count on this sample.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view repor



31 Oct 2018 Diag: Angela Borella

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

### Machine Id KAESER SX 7.5 AC 6142255 (S/N 1200) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

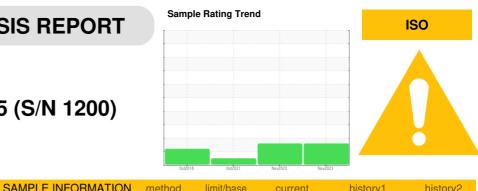

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124813	KC104784	KC99454
Sample Date		Client Info		06 Nov 2023	01 Nov 2022	05 Oct 2021
Machine Age	hrs	Client Info		15745	12935	10165
Oil Age	hrs	Client Info		0	2770	3127
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ATTENTION	ABNORMAL	NORMAL
	_					
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	<1
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	2
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	4
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm		90	0	0	1
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	0	49	47
Calcium	ppm	ASTM D5185m		0	2	2
Phosphorus	ppm	ASTM D5185m	0	0	28	4
Zinc	ppm	ASTM D5185m	0	0	9	2
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	12	5	7
Sodium	ppm	ASTM D5185m		16	15	14
Potassium	ppm	ASTM D5185m	>20	1	<1	2
Water	%	ASTM D6304	>0.05	0.017	0.012	0.023
ppm Water	ppm	ASTM D6304	>500	174.6	127.5	233.7
FLUID CLEANLIN	JESS	method	limit/base	current	history1	history2
		ASTM D7647		7669	17485	
Particles >4µm		ASTM D7647 ASTM D7647	> 1200	A 2180	▲ 5689	
Particles >6µm						
Particles >14µm		ASTM D7647	>80	▲ 132	▲ 366	
Particles >21µm		ASTM D7647		<mark>▲</mark> 34	▲ 78	
Particles >38µm		ASTM D7647	>4	2	3	
Particles >71µm		ASTM D7647		0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 20/18/14	<u> </u>	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.26	0.33	0.330



# **OIL ANALYSIS REPORT**

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

method

\*Visual

\*Visual

\*Visual

\*Visual

\*Visual

\*Visua

\*Visual

\*Visual

method

ASTM D445

method

scalar \*Visual

scalar \*Visual

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

>0.05

45

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML


curren


current

NEG

NEG

50.9

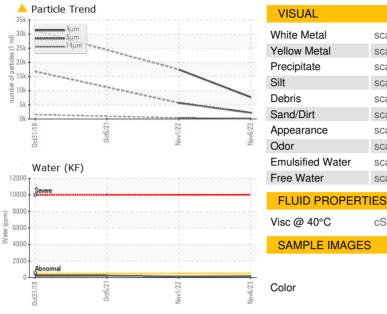

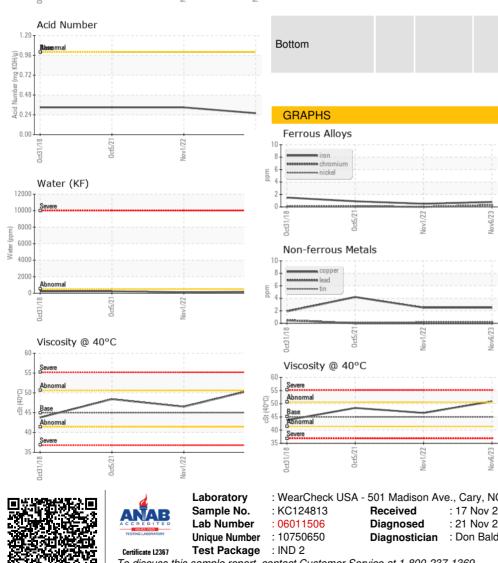

limit/base history2 history1

history1

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

46.5

history

history2

MODER

NONE

NONE

NONE

NONE

NONE

NORML


NORML

history2

NEG

NEG

48.4

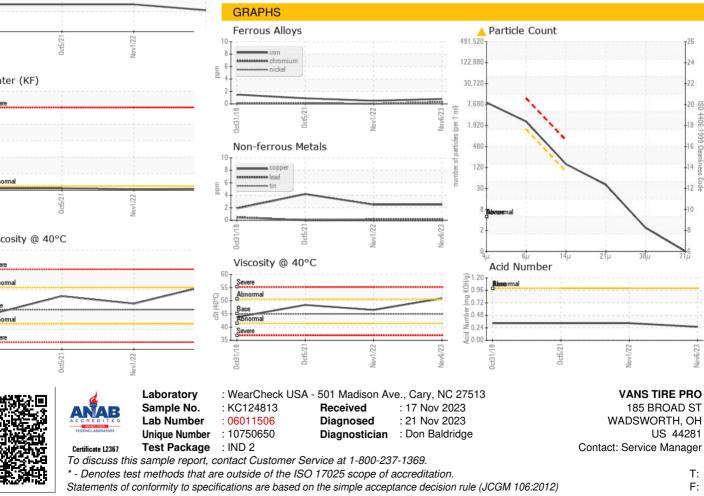

Contact/Location: Service Manager - VANWAD