

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

Machine Id


# KAESER SK15 7355025 (S/N 1552)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# **COMPONENT CONDITION SUMMARY**

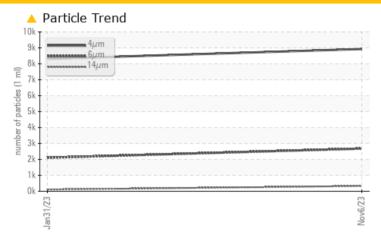

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ATTENTION						
Particles >6µm	ASTM D7647	>1300	<b>2679</b>	<u>^</u> 2107						
Particles >14μm	ASTM D7647	>80	<b>330</b>	<u></u> 108						
Particles >21µm	ASTM D7647	>20	<u> </u>	17						
Particles >38µm	ASTM D7647	>4	<u>^</u> 6	0						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16	<b>2</b> 0/18/14						

Customer Id: PAUBRI Sample No.: KCPA006982 Lab Number: 06011509 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

# **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

# HISTORICAL DIAGNOSIS

# 31 Jan 2023 Diag: Don Baldridge

#### VISCOSITY




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The oil viscosity is lower than normal. The AN level is acceptable for this fluid.





# **OIL ANALYSIS REPORT**



# KAESER SK15 7355025 (S/N 1552)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# **DIAGNOSIS**

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan2023	Nov2023		
SAMPLE INFORM	MATION	method	limit/base	ourront	historya	hiotonyO
	MATION		IIIIII/base	current	history1	history2
Sample Number		Client Info		KCPA006982	KCP55600	
Sample Date		Client Info		06 Nov 2023	31 Jan 2023	
Machine Age	hrs	Client Info		16025	13172	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	10	12	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	5	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	0	38	
Calcium	ppm	ASTM D5185m	0	0	2	
Phosphorus	ppm	ASTM D5185m	0	0	33	
Zinc	ppm	ASTM D5185m	0	0	30	
Sulfur	ppm	ASTM D5185m	23500	19435	21812	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	
Sodium	ppm	ASTM D5185m		21	32	
Potassium	ppm	ASTM D5185m	>20	4	8	
Water	%	ASTM D6304	>0.05	0.016	0.015	
ppm Water	ppm	ASTM D6304	>500	164.3	151.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8927	8311	
Particles >6µm		ASTM D7647	>1300	<b>^</b> 2679	<u>^</u> 2107	
Particles >14µm		ASTM D7647	>80	<b>4</b> 330	<u></u> 108	
Particles >21µm		ASTM D7647	>20	<u></u> 94	17	
Particles >38µm		ASTM D7647	>4	<u>^</u> 6	0	
Particles >71μm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/19/16</b>	<u>^</u> 20/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.29	0.30	



# **OIL ANALYSIS REPORT**

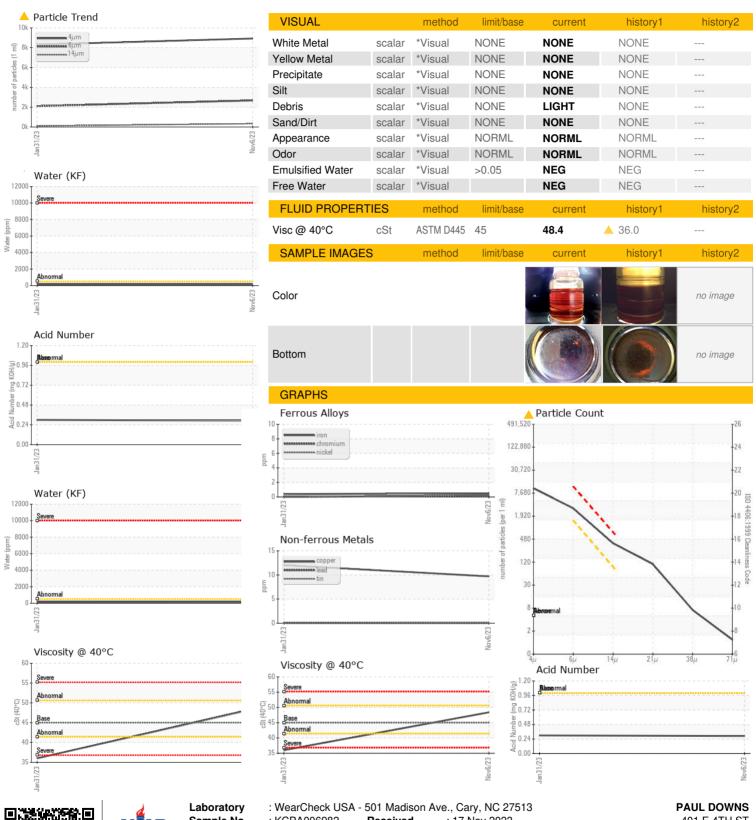





Certificate L2367

Sample No. Lab Number **Unique Number** 

: KCPA006982 : 06011509

Received Diagnosed : 10750653

: 17 Nov 2023

: 21 Nov 2023 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

401 E 4TH ST BRIDGEPORT, PA US 19405

Contact: Service Manager

T:

F: