

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

Machine Id


# KAESER BSD 60T 6475974 (S/N 1250)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**

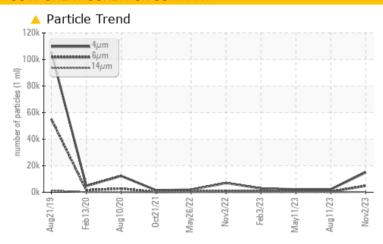

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	NORMAL	NORMAL				
Particles >6µm	ASTM D7647	>1300	<b>4845</b>	489	715				
Particles >14µm	ASTM D7647	>80	<b>269</b>	48	24				
Particles >21µm	ASTM D7647	>20	<u></u> ▲ 51	13	3				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>2</b> 1/19/15	18/16/13	18/17/12				

Customer Id: AMANORCT Sample No.: KCPA004557 Lab Number: 06011525 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 11 Aug 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 11 May 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 03 Feb 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO

Machine Id

# KAESER BSD 60T 6475974 (S/N 1250)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Aug2019 Feb2020 Aug2020 Oct0021 May2022 Nov2022 Feb2023 May2023 Nov2023 Nov2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KCPA004557	KCPA005992	KCPA001798		
Sample Date		Client Info		02 Nov 2023	11 Aug 2023	11 May 2023		
Machine Age	hrs	Client Info		19048	17654	16046		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				ABNORMAL	NORMAL	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	<1	0	0		
Chromium	ppm	ASTM D5185m	>10	<1	0	0		
Nickel	ppm	ASTM D5185m	>3	<1	0	0		
Titanium	ppm	ASTM D5185m	>3	<1	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0		
Lead	ppm	ASTM D5185m	>10	0	0	0		
Copper	ppm	ASTM D5185m	>50	1	<1	<1		
Tin	ppm	ASTM D5185m	>10	<1	<1	<1		
Vanadium	ppm	ASTM D5185m		<1	<1	0		
Cadmium	ppm	ASTM D5185m		<1	<1	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	0	0		
Barium	ppm	ASTM D5185m	90	0	48	66		
Molybdenum	ppm	ASTM D5185m	0	0	0	0		
Manganese	ppm	ASTM D5185m		<1	<1	0		
Magnesium	ppm	ASTM D5185m	100	0	80	85		
Calcium	ppm	ASTM D5185m	0	0	<1	2		
Phosphorus	ppm	ASTM D5185m	0	0	2	0		
Zinc	ppm	ASTM D5185m	0	0	2	<1		
Sulfur	ppm	ASTM D5185m	23500	20079	23492	22387		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	2	1	<1		
Sodium	ppm	ASTM D5185m		22	26	23		
Potassium	ppm	ASTM D5185m	>20	5	6	6		
Water	%	ASTM D6304	>0.05	0.026	0.038	0.026		
ppm Water	ppm	ASTM D6304	>500	268.3	380.2	268.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		14953	2211	2190		
Particles >6µm		ASTM D7647	>1300	<b>4845</b>	489	715		
Particles >14µm		ASTM D7647	>80	<b>^</b> 269	48	24		
Particles >21µm		ASTM D7647	>20	<u></u> 51	13	3		
Particles >38μm		ASTM D7647	>4	1	0	0		
Particles >71μm		ASTM D7647	>3	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/19/15</u>	18/16/13	18/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.30	0.38	0.38		



## OIL ANALYSIS REPORT

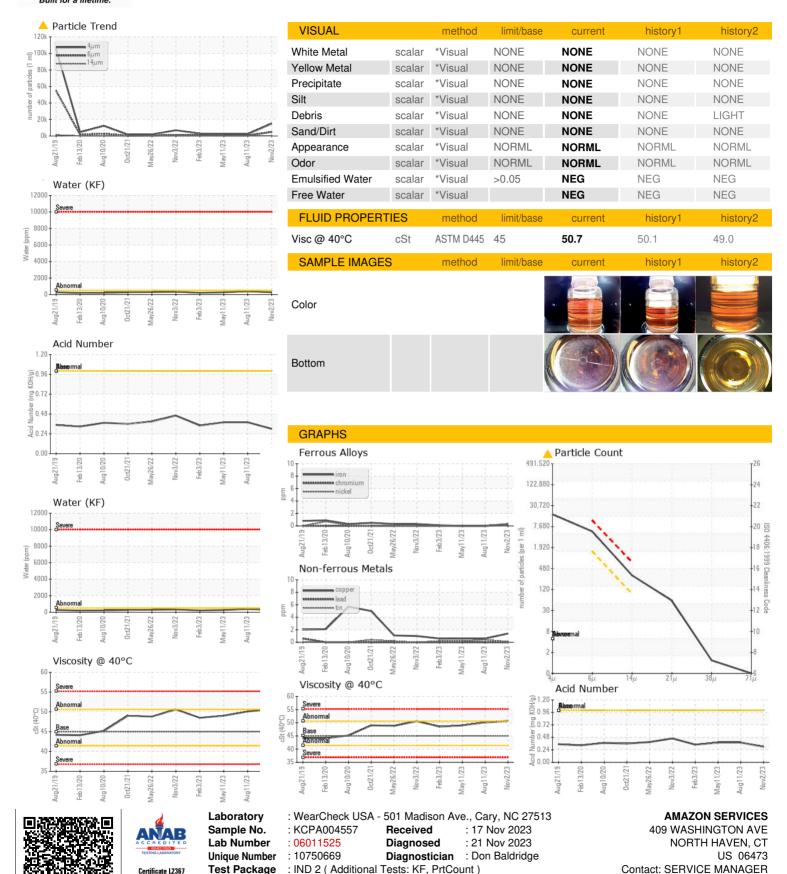

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Certificate L2367

T: F:

lucastra@amazon.com