

## **PROBLEM SUMMARY**

Sample Rating Trend

ISO

Machine Id


# KAESER BSD 60T 6489587 (S/N 1252)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

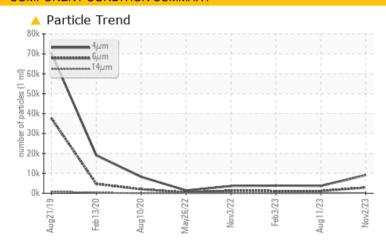

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST	RESULTS			
Sample Status		ABNORMAL	ATTENTION	NORMAL
Particles >6µm	ASTM D7647 >1300	<b>2872</b>	1117	1127
Particles >14μm	ASTM D7647 >80	<u> </u>	<b>88</b>	37
Particles >21µm	ASTM D7647 >20	<b>4</b> 0	17	5
Oil Cleanliness	ISO 4406 (c) >/17/1	3 4 20/19/15	19/17/14	19/17/12

Customer Id: AMANORCT Sample No.: KCPA004558 Lab Number: 06011529 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 11 Aug 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 03 Feb 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 03 Nov 2022 Diag: Don Baldridge

150




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





## **OIL ANALYSIS REPORT**

Sample Rating Trend

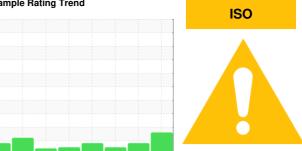

## KAESER BSD 60T 6489587 (S/N 1252)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2019 F	eb2020 Aug2020 May20	22 Nov2022 Feb2023 Aug2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004558	KCPA005993	KCP55576
Sample Date		Client Info		02 Nov 2023	11 Aug 2023	03 Feb 2023
Machine Age	hrs	Client Info		15358	16958	14338
Oil Age	hrs	Client Info		0	0	2305
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	1	<1
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	50	74
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	0	76	87
Calcium	ppm	ASTM D5185m	2	0	1	2
Phosphorus	ppm	ASTM D5185m		0	4	11
Zinc	ppm	ASTM D5185m		0	2	0
Sulfur	ppm	ASTM D5185m		19866	23206	23691
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	2
Sodium	ppm	ASTM D5185m		26	25	24
Potassium	ppm	ASTM D5185m	>20	5	6	3
Water	%	ASTM D6304	>0.05	0.027	0.039	0.015
ppm Water	ppm	ASTM D6304	>500	271.6	390.1	154.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9139	3684	3838
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2872	1117	1127
Particles >14μm		ASTM D7647	>80	<u> </u>	<u></u> 88	37
Particles >21µm		ASTM D7647	>20	<b>40</b>	17	5
Particles >38μm		ASTM D7647	>4	1	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/15	<u>19/17/14</u>	19/17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.37	0.34



### **OIL ANALYSIS REPORT**

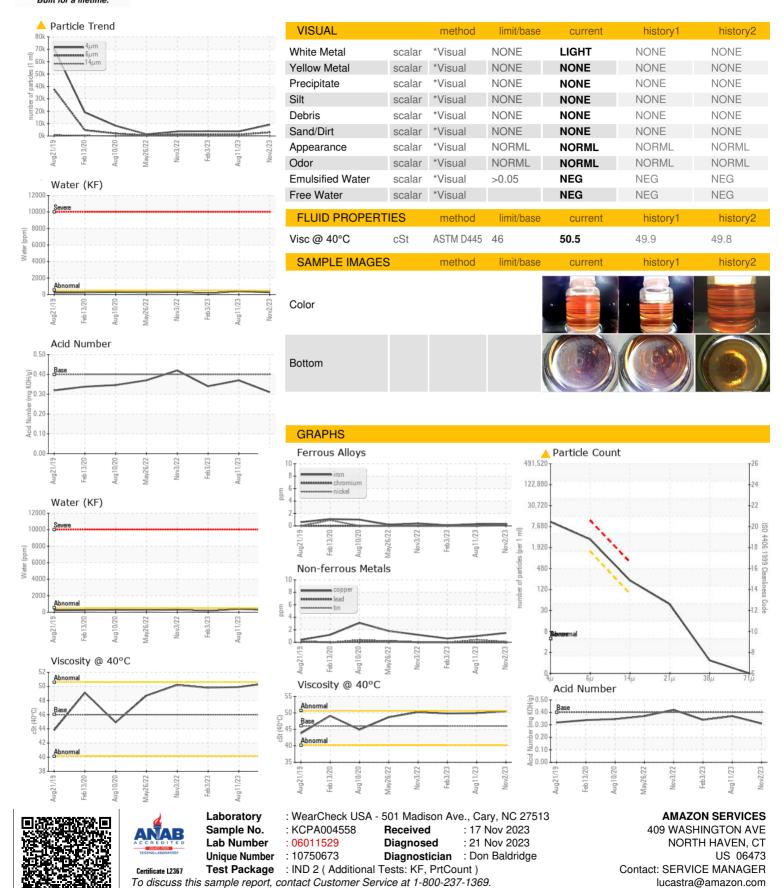

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: