




PROBLEM SUMMARY

Sample Rating Trend

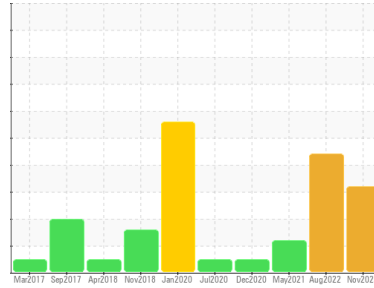

WATER




Machine Id
KAESER ASD 30 3576879 (S/N 1491)

Component
Compressor


Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

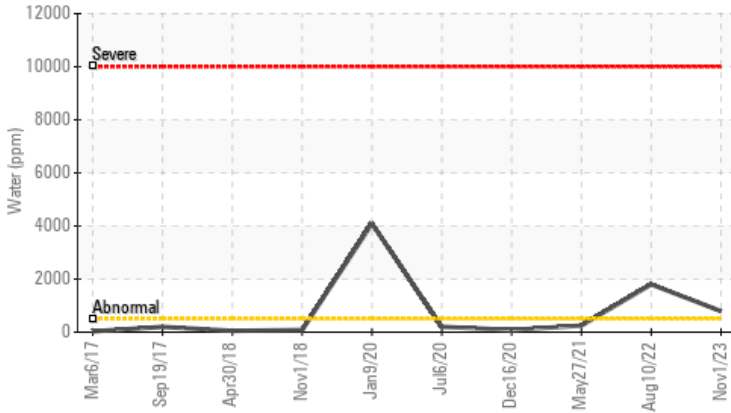

▲ Particle Trend

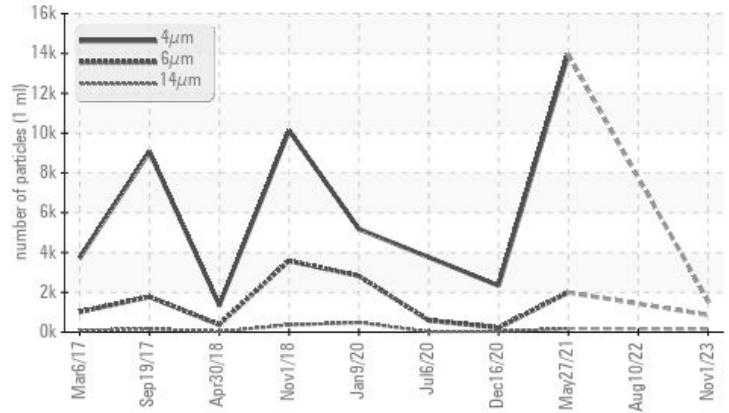

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.079	▲ 0.180	0.024
ppm Water	ppm	ASTM D6304	>500	▲ 790	▲ 1800	247.8
Particles >14µm		ASTM D7647	>80	▲ 147	---	▲ 176
Particles >21µm		ASTM D7647	>20	▲ 49	---	▲ 55
Particles >38µm		ASTM D7647	>4	▲ 8	---	3
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 18/17/14	---	▲ 18/15

Customer Id: SXISTO
 Sample No.: KCPA009494
 Lab Number: 06011531
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

10 Aug 2022 Diag: Jonathan Hester

WATER



Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Appearance is hazy. Free water present. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



27 May 2021 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



16 Dec 2020 Diag: Jonathan Hester

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER ASD 30 3576879 (S/N 1491)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

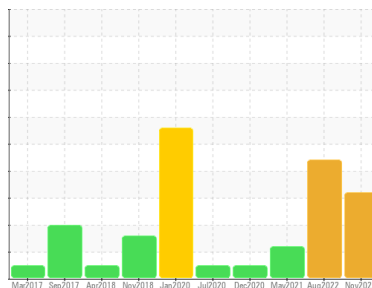

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA009494	KCP51613	KCP35734
Sample Date	Client Info	01 Nov 2023	10 Aug 2022	27 May 2021
Machine Age	hrs	36305	32884	30121
Oil Age	hrs	0	1353	960
Oil Changed	Client Info	N/A	Changed	Not Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	<1	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	<1	<1
Aluminum	ppm	ASTM D5185m >10	<1	2	<1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	7	7	2
Tin	ppm	ASTM D5185m >10	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	<1	22
Barium	ppm	ASTM D5185m 90	0	0	49
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 100	0	25	64
Calcium	ppm	ASTM D5185m 0	0	<1	<1
Phosphorus	ppm	ASTM D5185m 0	0	2	0
Zinc	ppm	ASTM D5185m 0	0	14	8
Sulfur	ppm	ASTM D5185m 23500	18993	18817	14793

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	2	2	19
Potassium	ppm	ASTM D5185m >20	0	1	3
Water	%	ASTM D6304 >0.05	▲ 0.079	▲ 0.180	0.024
ppm Water	ppm	ASTM D6304 >500	▲ 790	▲ 1800	247.8






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1583	---	13937
Particles >6µm	ASTM D7647 >1300	863	---	▲ 1994
Particles >14µm	ASTM D7647 >80	▲ 147	---	▲ 176
Particles >21µm	ASTM D7647 >20	▲ 49	---	▲ 55
Particles >38µm	ASTM D7647 >4	▲ 8	---	3
Particles >71µm	ASTM D7647 >3	1	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 18/17/14	---	▲ 18/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.39	0.399


OIL ANALYSIS REPORT

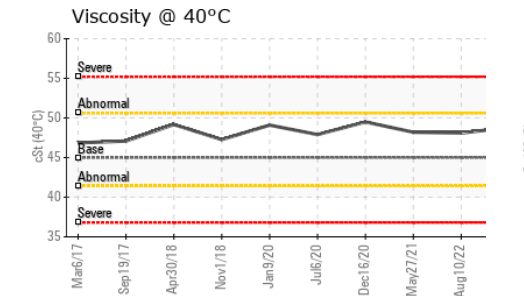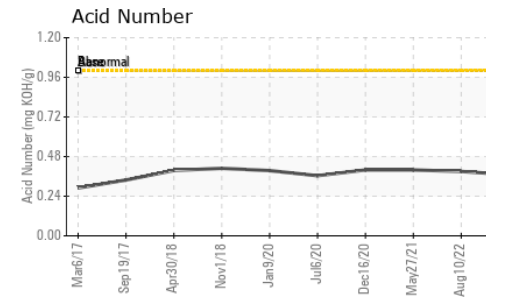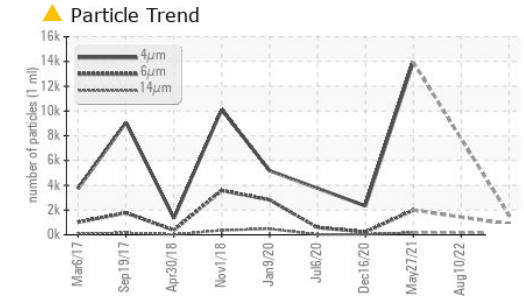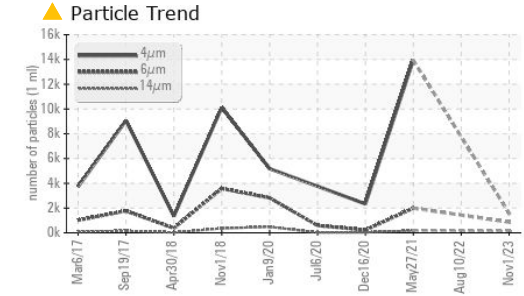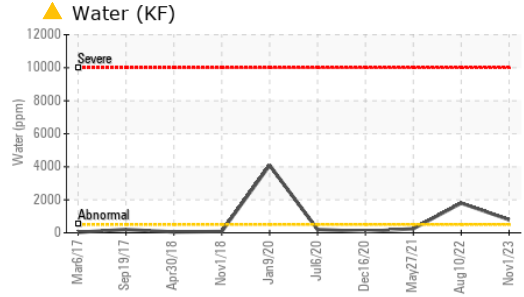





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		▲ 1.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.8	48.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

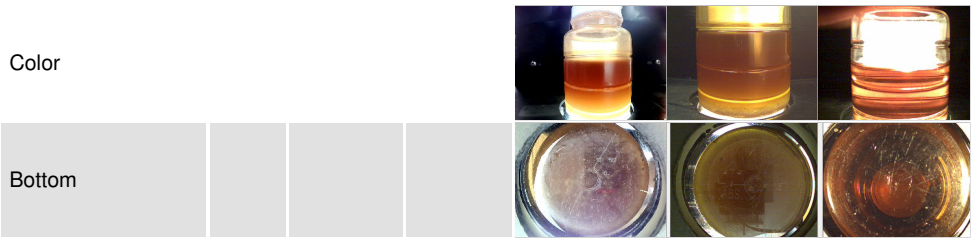

GRAPHS

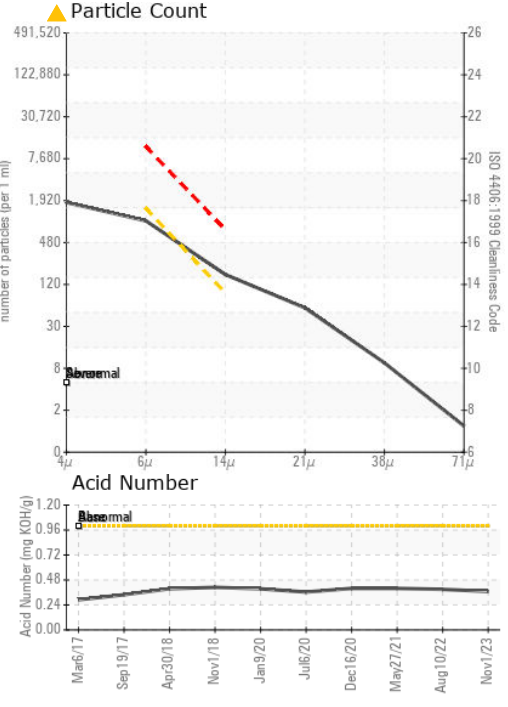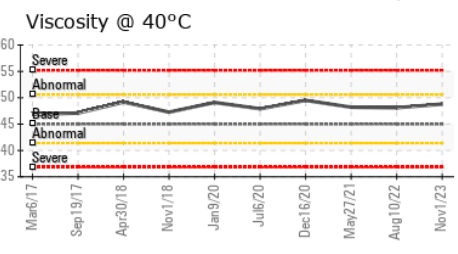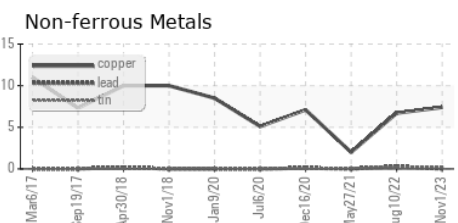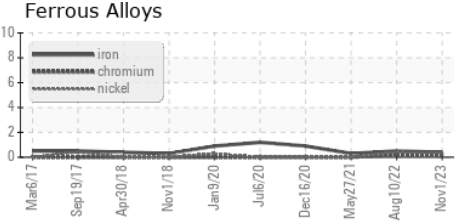

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009494 **Received** : 17 Nov 2023
Lab Number : 06011531 **Diagnosed** : 29 Nov 2023
Unique Number : 10750675 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SX INVESTMENT GROUP
 1551 CENTRAL ST
 STOUGHTON, MA
 US 02072
 Contact: TIM
 TIM@SXINDUSTRIES.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)