




PROBLEM SUMMARY

Sample Rating Trend

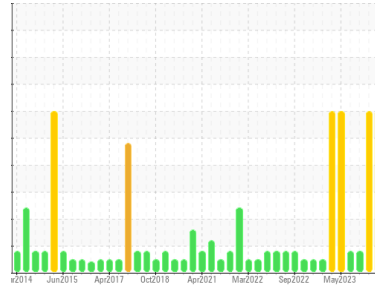


WEAR



Area
BLEACH O2
Machine Id
BX025 PRE02 PRESS NE (S/N 0661-03-02-040-040-090)
Component
Bearing
Fluid
NOT GIVEN (4 GAL)

COMPONENT CONDITION SUMMARY

Ferrous Alloys

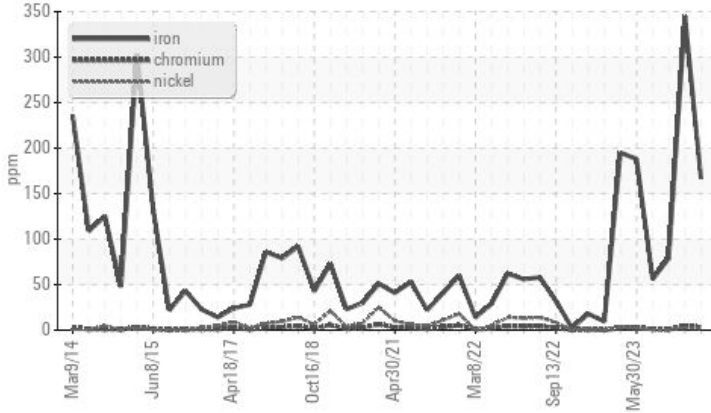

RECOMMENDATION

We advise that you inspect for the source(s) of wear.
We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	SEVERE	ABNORMAL
Iron	ppm	ASTM D5185m	>20	167	345	79

Customer Id: INTRIERP
Sample No.: WC0851757
Lab Number: 06011544
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Inspect Wear Source	---	---	?	We advise that you inspect for the source(s) of wear.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

09 Oct 2023 Diag: Doug Bogart

WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

view report



17 Aug 2023 Diag: Don Baldrige

WEAR



We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

view report



24 Jul 2023 Diag: Doug Bogart

WEAR



We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

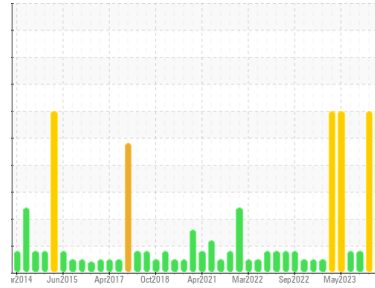

WEAR



Area
BLEACH O2
 Machine Id
BX025 PRE02 PRESS NE (S/N 0661-03-02-040-040-090)
 Component
Bearing
 Fluid
NOT GIVEN (4 GAL)

DIAGNOSIS

Recommendation

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

Wear

The iron level has decreased, but is still abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0851757	WC0760576	WC0760566
Sample Date	Client Info		15 Nov 2023	09 Oct 2023	17 Aug 2023
Machine Age	mls	Client Info	0	0	0
Oil Age	mls	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	167	345	79
Chromium	ppm	ASTM D5185m >20	3	5	<1
Nickel	ppm	ASTM D5185m >20	1	2	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	1	0	<1
Lead	ppm	ASTM D5185m >20	0	<1	0
Copper	ppm	ASTM D5185m >20	2	3	<1
Tin	ppm	ASTM D5185m >20	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	<1	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	<1	0
Manganese	ppm	ASTM D5185m	1	3	1
Magnesium	ppm	ASTM D5185m	0	<1	1
Calcium	ppm	ASTM D5185m	0	<1	<1
Phosphorus	ppm	ASTM D5185m	388	495	533
Zinc	ppm	ASTM D5185m	0	6	<1
Sulfur	ppm	ASTM D5185m	15904	17060	18767





CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	6	10	9
Sodium	ppm	ASTM D5185m	7	3	3
Potassium	ppm	ASTM D5185m >20	1	1	2
Water	%	ASTM D6304 >2	0.183	0.085	0.089
ppm Water	ppm	ASTM D6304	1830	850	890

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.65	0.72	1.02


OIL ANALYSIS REPORT

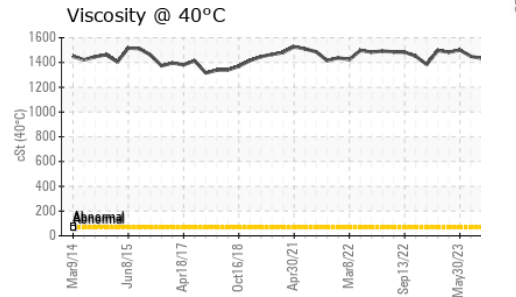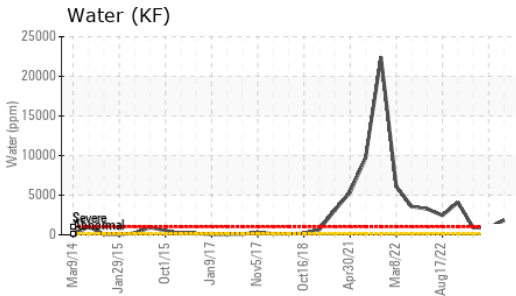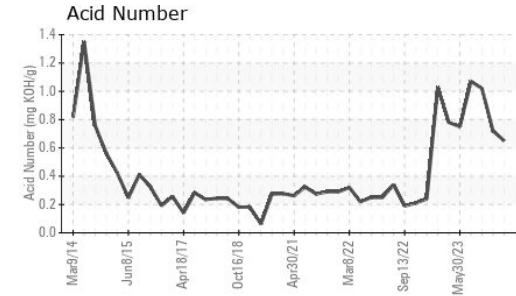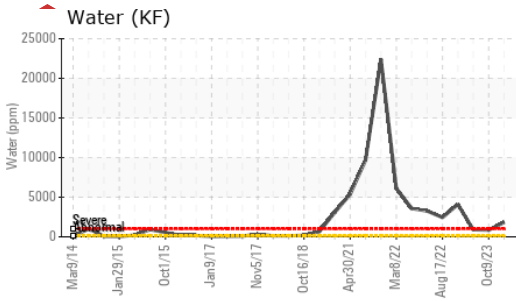





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	0.2%	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1395	1442	1433

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

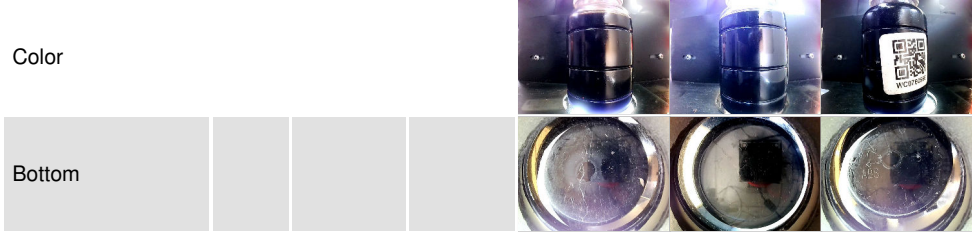

GRAPHS

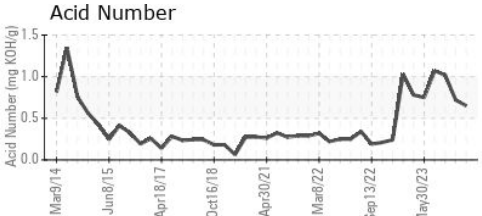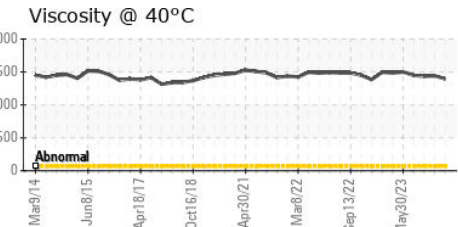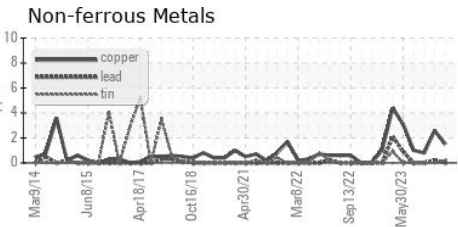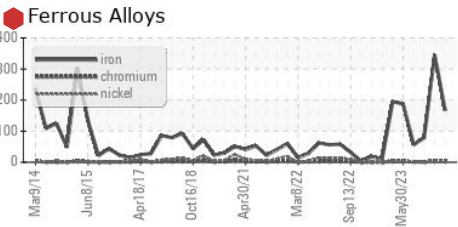

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0851757 **Received** : 17 Nov 2023
Lab Number : 06011544 **Diagnosed** : 21 Nov 2023
Unique Number : 10750688 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

INTERNATIONAL PAPER
 865 JOHN L REGEL RD
 RIEGELWOOD, NC
 US 28456
 Contact: Zach Lizana
 zachary.lizana@ipaper.com
 T: (910)362-4775
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)