




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

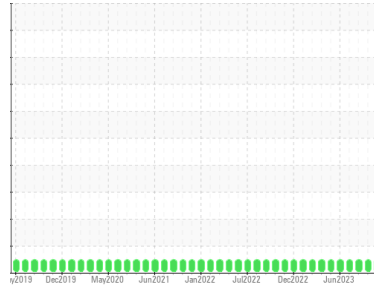

Area  
**UTILITIES**  
 Machine Id  
**GN-8001A (S/N EMERGENCY GENERATOR)**  
 Component  
**Diesel Engine**  
 Fluid  
**CHEVRON DELO 400 LE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>HLC0002859</b>  | HLC0002349  | HLC0002464  |
| Sample Date        | Client Info |             |            | <b>09 Nov 2023</b> | 15 Oct 2023 | 03 Sep 2023 |
| Machine Age        | hrs         | Client Info |            | <b>1347</b>        | 0           | 0           |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | N/A         |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| CONTAMINATION |           | method | limit/base | current        | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel          | WC Method | >3.0   |            | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Water         | WC Method | >0.2   |            | <b>NEG</b>     | NEG      | NEG      |
| Glycol        | WC Method |        |            | <b>NEG</b>     | NEG      | NEG      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >65        | <b>&lt;1</b> | 1        | 2        |
| Chromium    | ppm | ASTM D5185m | >3         | <b>0</b>     | 0        | 0        |
| Nickel      | ppm | ASTM D5185m | >2         | <b>0</b>     | <1       | 0        |
| Titanium    | ppm | ASTM D5185m | >2         | <b>&lt;1</b> | <1       | <1       |
| Silver      | ppm | ASTM D5185m | >2         | <b>0</b>     | 0        | 0        |
| Aluminum    | ppm | ASTM D5185m | >6         | <b>1</b>     | <1       | <1       |
| Lead        | ppm | ASTM D5185m | >13        | <b>0</b>     | <1       | <1       |
| Copper      | ppm | ASTM D5185m | >65        | <b>&lt;1</b> | <1       | <1       |
| Tin         | ppm | ASTM D5185m | >2         | <b>0</b>     | <1       | <1       |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>     | 0        | <1       |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>     | <1       | <1       |



| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>125</b>   | 133      | 127      |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>14</b>    | 15       | 14       |
| Manganese  | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | <1       |
| Magnesium  | ppm | ASTM D5185m |            | <b>642</b>   | 596      | 668      |
| Calcium    | ppm | ASTM D5185m |            | <b>1495</b>  | 1468     | 1529     |
| Phosphorus | ppm | ASTM D5185m | 1200       | <b>768</b>   | 701      | 717      |
| Zinc       | ppm | ASTM D5185m | 1300       | <b>882</b>   | 838      | 855      |
| Sulfur     | ppm | ASTM D5185m | 3200       | <b>3172</b>  | 3056     | 3707     |

| CONTAMINANTS |     | method      | limit/base | current  | history1 | history2 |
|--------------|-----|-------------|------------|----------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >25        | <b>4</b> | 4        | 4        |
| Sodium       | ppm | ASTM D5185m |            | <b>1</b> | 3        | 1        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>2</b> | 5        | 3        |

| INFRA-RED |          | method      | limit/base | current     | history1 | history2 |
|-----------|----------|-------------|------------|-------------|----------|----------|
| Soot %    | %        | *ASTM D7844 | >6         | <b>0.1</b>  | 0.1      | 0.1      |
| Nitration | Abs/cm   | *ASTM D7624 | >20        | <b>6.7</b>  | 6.6      | 6.5      |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30        | <b>18.9</b> | 18.8     | 18.7     |

| FLUID DEGRADATION |          | method      | limit/base | current     | history1 | history2 |
|-------------------|----------|-------------|------------|-------------|----------|----------|
| Oxidation         | Abs/.1mm | *ASTM D7414 | >25        | <b>13.4</b> | 13.3     | 13.0     |
| Base Number (BN)  | mg KOH/g | ASTM D2896  | 9.6        | <b>9.72</b> | 10.00    | 9.70     |





# OIL ANALYSIS REPORT

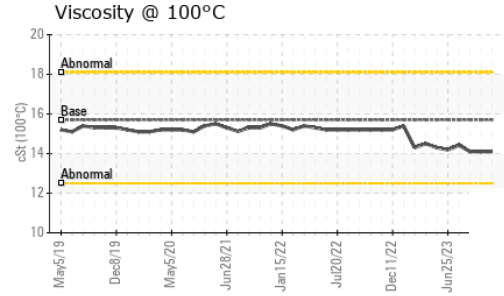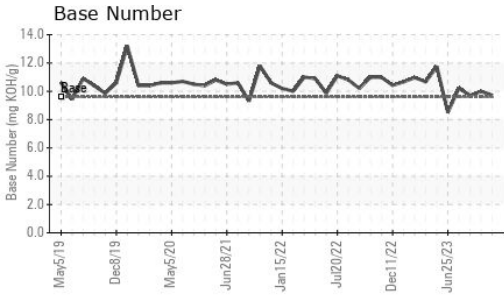

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.2    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |      |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 100°C     | cSt    | ASTM D445  | 15.7    | <b>14.1</b> | 14.1     | 14.1 |

## GRAPHS

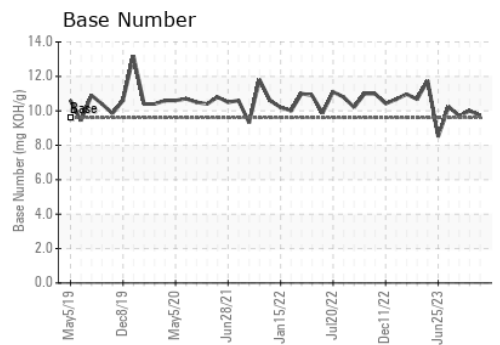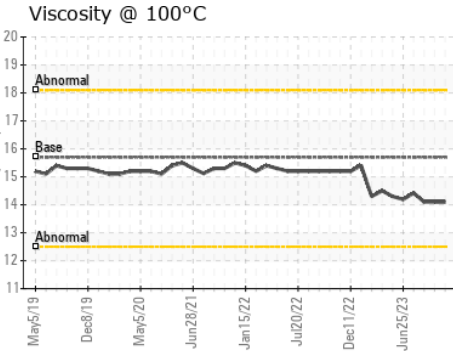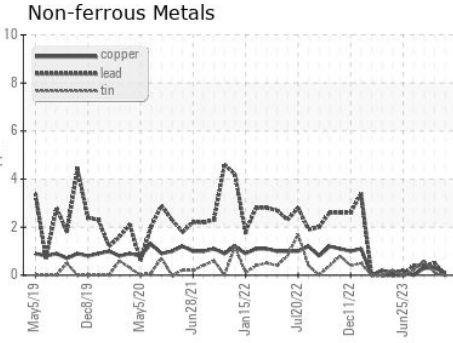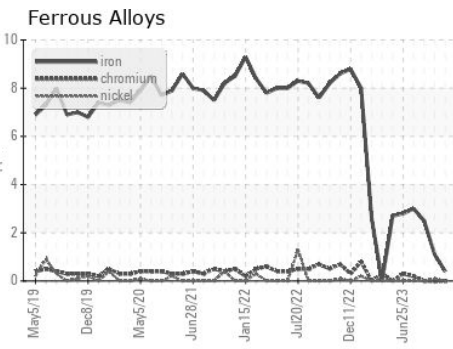

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002859 **Received** : 17 Nov 2023  
**Lab Number** : **06011655** **Diagnosed** : 20 Nov 2023  
**Unique Number** : 10750799 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**HILCORP NORTHSTAR FACILITY**  
 PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)