


## **OIL ANALYSIS REPORT**





NORMAL

KAESER DSD 150 6307771 (S/N 1023)

# KAESER SIGMA (OEM) S-460 (--- GAL)

Component Compressor

### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125735	KC121436	KC101432
Sample Date		Client Info		03 Nov 2023	07 Jul 2023	25 Mar 2023
Machine Age	hrs	Client Info		29578	29313	27463
Oil Age	hrs	Client Info		0	0	1839
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	2
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m		7	6	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	4	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	0	3	21
Calcium	ppm	ASTM D5185m	2	0	5	0
Phosphorus	ppm	ASTM D5185m		0	11	6
Zinc	ppm	ASTM D5185m		0	4	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	<1
Sodium	ppm	ASTM D5185m		2	0	5
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.05	0.004	0.007	0.008
ppm Water	ppm	ASTM D6304	>500	44.3	72.9	85.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1359	358	876
Particles >6µm		ASTM D7647	>1300	332	146	220
Particles >14µm		ASTM D7647	>80	26	34	22
Particles >21µm		ASTM D7647	>20	6	13	4
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	16/14/12	17/15/12
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.46	0.52	0.55




**OIL ANALYSIS REPORT** 






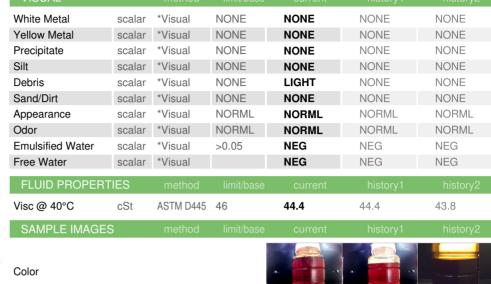

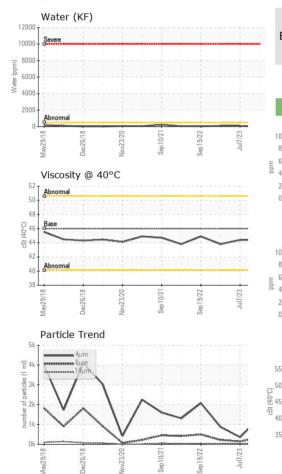

1/6Cmel

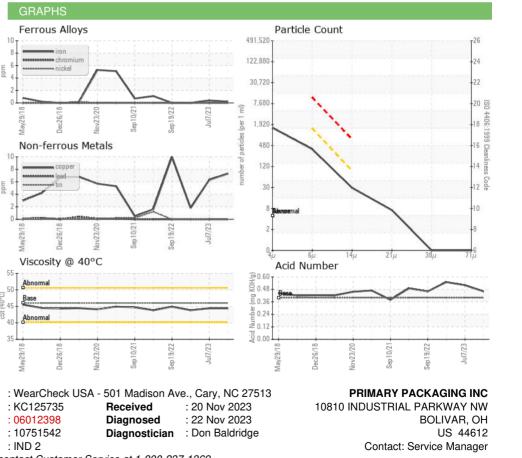

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Bottom

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Laboratory

Sample No.

Lab Number

Unique Number

Test Package

Contact/Location: Service Manager - PRIBOLKC