




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
KAESER CSD-100 4069582 (S/N 1301)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

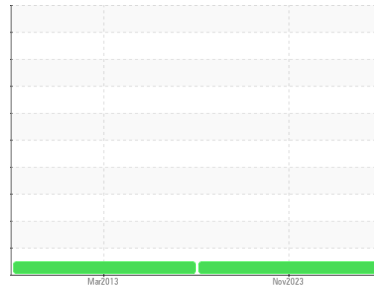

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC111399	KC32588	---
Sample Date	Client Info		14 Nov 2023	12 Mar 2013	---
Machine Age	hrs	Client Info	25691	5698	---
Oil Age	hrs	Client Info	4000	3939	---
Oil Changed	Client Info		Not Chngd	N/A	---
Sample Status			NORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >5	0	0	---
Nickel	ppm	ASTM D5185m	0	<1	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >15	0	<1	---
Lead	ppm	ASTM D5185m >65	0	0	---
Copper	ppm	ASTM D5185m >65	10	9	---
Tin	ppm	ASTM D5185m >10	0	0	---
Antimony	ppm	ASTM D5185m	---	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	<1	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	0	<1	---
Molybdenum	ppm	ASTM D5185m	2	4	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m 90	0	0	---
Calcium	ppm	ASTM D5185m 2	0	0	---
Phosphorus	ppm	ASTM D5185m	0	2	---
Zinc	ppm	ASTM D5185m	31	11	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<1	<1	---
Sodium	ppm	ASTM D5185m	1	<1	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >0.1	0.004	0.008	---
ppm Water	ppm	ASTM D6304 >1000	47.4	80	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		6456	410	---
Particles >6µm	ASTM D7647 >1300		534	223	---
Particles >14µm	ASTM D7647 >80		67	38	---
Particles >21µm	ASTM D7647 >20		32	12	---
Particles >38µm	ASTM D7647 >4		4	1	---
Particles >71µm	ASTM D7647 >3		1	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	20/16/13	15/12	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.440	---

OIL ANALYSIS REPORT

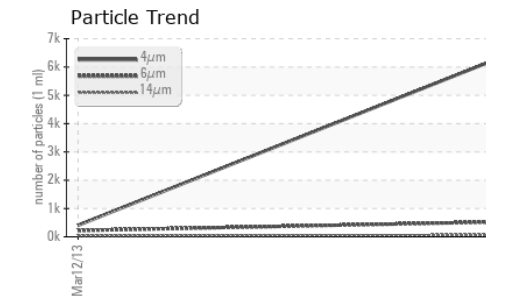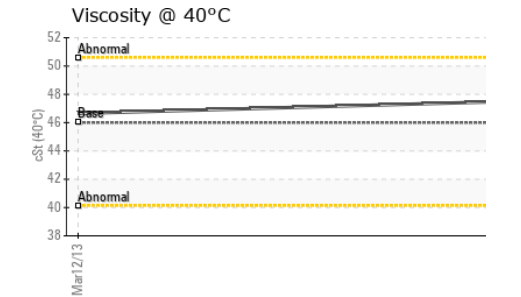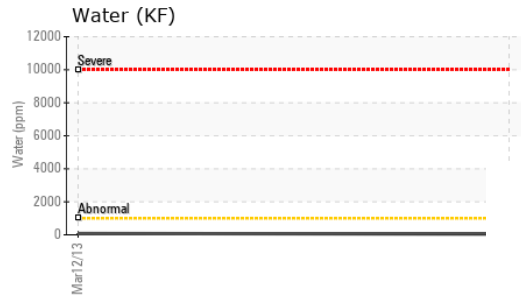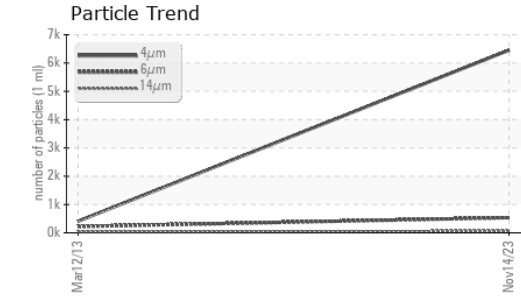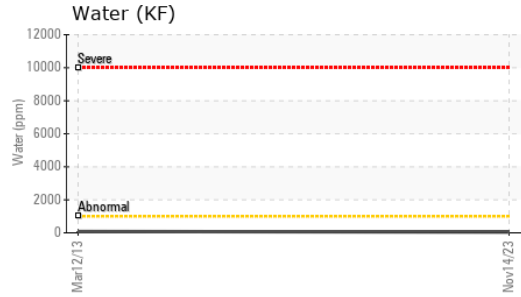






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	47.5	46.65	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

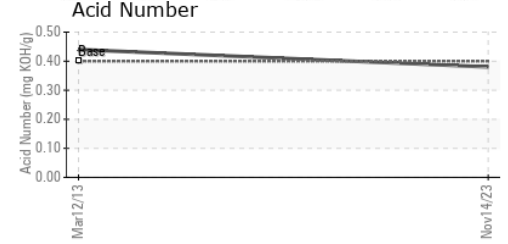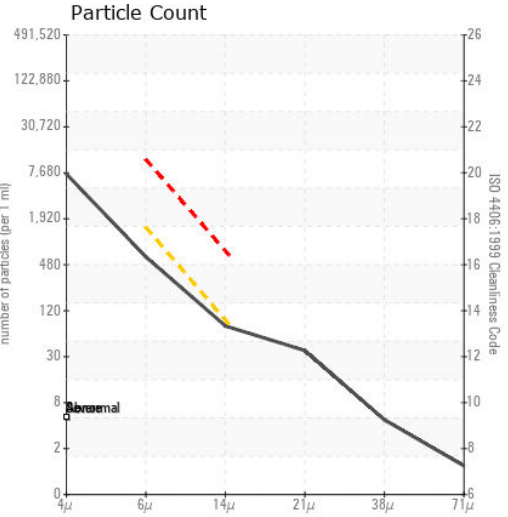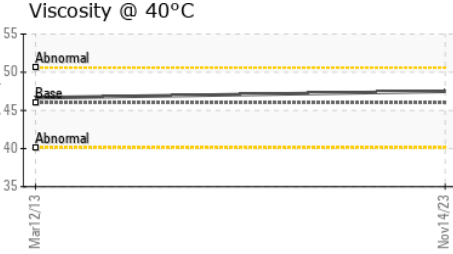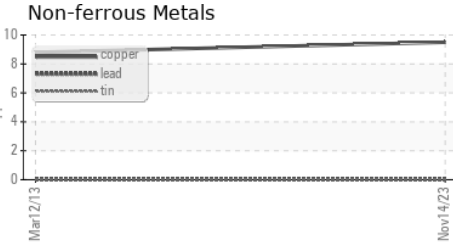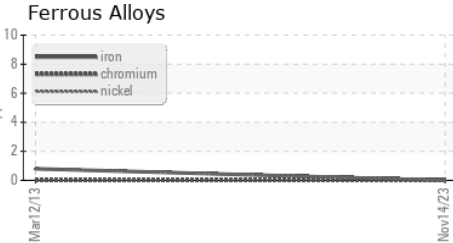

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC111399 **Received** : 20 Nov 2023
Lab Number : 06012401 **Diagnosed** : 29 Nov 2023
Unique Number : 10751545 **Diagnostician** : Jonathan Hester
Test Package : IND 2

SOLMET
 2716 SHEPLER CHURCH AVE
 CANTON, OH
 US 44706
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: