

OIL ANALYSIS REPORT

Sample Rating Trend



KAESER 4418306

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Oct202	1 Feb2022	Oct2022 No	v2023	
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009250	KCP47351D	KCP38505
Sample Date		Client Info		03 Nov 2023	12 Oct 2022	28 Feb 2022
Machine Age	hrs	Client Info		34365	31674	29972
Oil Age	hrs	Client Info		0	1702	1330
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	9	5
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	20	25	19
Volybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	-	0	0	<1
Magnesium	ppm	ASTM D5185m	100	64	73	77
Calcium	ppm	ASTM D5185m	0	0	<1	<1
Phosphorus	ppm		0	0	4	3
Zinc	ppm	ASTM D5185m	0	0	24	22
Sulfur	ppm	ASTM D5185m	23500	18280	23143	16755
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		21	10	20
Potassium	ppm	ASTM D5185m	>20	1	0	5
Water	%	ASTM D6304	>0.05	0.018	0.024	0.021
ppm Water	ppm	ASTM D6304	>500	189.4	247.9	213.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1872	2576	
Particles >6µm		ASTM D7647	>1300	416	545	
Particles >14µm		ASTM D7647	>80	35	62	
Particles >21µm		ASTM D7647	>20	11	20	
Particles >38µm		ASTM D7647	>4	1	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	19/16/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.48	0.45
:44:06) Boy: 1	0 - 0					ager - AMALE


Report Id: AMALEB [WUSCAR] 06012436 (Generated: 11/21/2023 19:44:06) Rev: 1


Contact/Location: Service Manager - AMALEB




OIL ANALYSIS REPORT





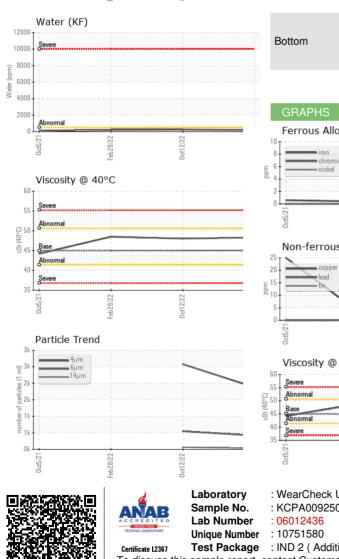

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.3	48.0	48.5
SAMPLE IMAGES	\$	method	limit/base	current	history1	history2
Color				a.		

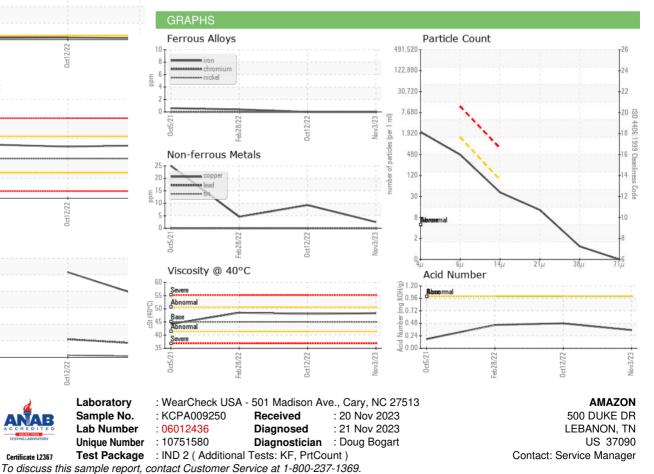

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)