

PROBLEM SUMMARY

Sample Rating Trend




Machine Id KAESER 7474242

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

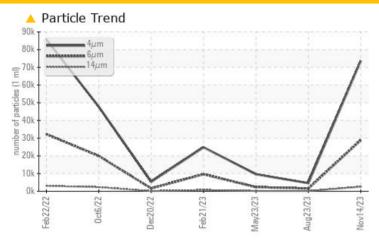

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	28881	<u>▲</u> 1565	<u>^</u> 2334				
Particles >14µm	ASTM D7647	>80	2577	▲ 153	<u></u> 170				
Particles >21µm	ASTM D7647	>20	△ 651	4 0	4 0				
Particles >38µm	ASTM D7647	>4	25	2	1				
Oil Cleanliness	ISO 4406 (c)	>/17/13	23/22/19	<u>19/18/14</u>	<u>^</u> 20/18/15				

Customer Id: CHEJES Sample No.: KC06012443 Lab Number: 06012443 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

23 Aug 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



23 May 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



21 Feb 2023 Diag: Doug Bogart

ISO




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER 7474242

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 2022	Oct2022 Dec2022	Feb2023 May2023 Aug2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06012443	KC125440	KC104981
Sample Date		Client Info		14 Nov 2023	23 Aug 2023	23 May 2023
Machine Age	hrs	Client Info		13797	13796	13795
Oil Age	hrs	Client Info		0	0	384
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	<1	<1	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	63	82	38
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	67	82	71
Calcium	ppm	ASTM D5185m	2	0	2	2
Phosphorus	ppm	ASTM D5185m		0	1	1
Zinc	ppm	ASTM D5185m		0	1	0
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	5
Sodium	ppm	ASTM D5185m		8	3	23
Potassium	ppm	ASTM D5185m	>20	<1	3	7
Water	%	ASTM D6304	>0.05	0.016	0.035	0.012
ppm Water	ppm	ASTM D6304	>500	160.0	357.0	122.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		73611	4583	9609
Particles >6µm		ASTM D7647	>1300	<u>^</u> 28881	<u>▲</u> 1565	<u>^</u> 2334
Particles >14µm		ASTM D7647	>80	<u>2577</u>	<u> </u>	▲ 170
Particles >21µm		ASTM D7647	>20	<u></u> 651	4 0	4 0
Particles >38μm		ASTM D7647	>4	25	2	1
Particles >71μm		ASTM D7647	>3	2	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/22/19	△ 19/18/14	<u>△</u> 20/18/15
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.26	0.34	0.28



OIL ANALYSIS REPORT



To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

T: F: