


### **PROBLEM SUMMARY**

# ER1 H/LSSC-14 (S/N S0320HFMPLHAA3)

Refrigeration Compressor Fluid USPI ALT-68 SC (--- GAL)

### COMPONENT CONDITION SUMMARY

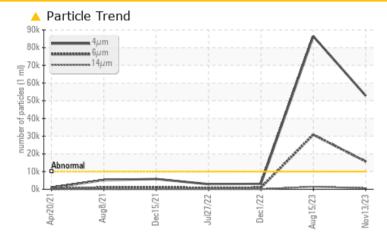

### RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS						
Sample Status		ABNORMAL	NORMAL	NORMAL		
Particles >4µm	ASTM D7647 >	10000 🔺 <b>52836</b>	86397	3050		
Particles >6µm	ASTM D7647 >2	2500 🔺 <b>15679</b>	30820	882		
Particles >14µm	ASTM D7647 >3	320 🔺 614	1448	56		
Oil Cleanliness	ISO 4406 (c) >2	20/18/15 🔺 23/21/16	24/22/18	19/17/13		


Customer Id: AMEOMA Sample No.: USP0003634 Lab Number: 06012468 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

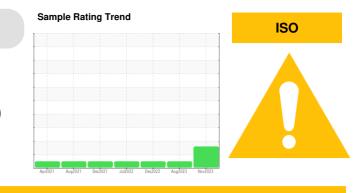

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Filter			?	We recommend you service the filters on this component.		

### HISTORICAL DIAGNOSIS

#### NORMAL



We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

### 01 Dec 2022 Diag: Doug Bogart

15 Aug 2023 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 27 Jul 2022 Diag: Doug Bogart

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







### **OIL ANALYSIS REPORT**

## ER1 H/LSSC-14 (S/N S0320HFMPLHAA3)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

### DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

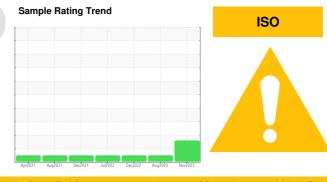



SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0003634	USP0000614	USP247966
Sample Date		Client Info		13 Nov 2023	15 Aug 2023	01 Dec 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		1	0	0
Calcium	ppm	ASTM D5185m		1	0	0
Phosphorus	ppm	ASTM D5185m		1	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	25	3	19
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	0
Sodium	ppm	ASTM D5185m		1	0	<1
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Water	%	ASTM D6304	>0.01	0.002	0.003	0.002
ppm Water	ppm	ASTM D6304		17.7	31.5	23.1
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 52836	86397	3050
Particles >6µm		ASTM D7647	>2500	🔺 15679	30820	882
Particles >14µm		ASTM D7647	>320	<u> </u>	1448	56
Particles >21µm		ASTM D7647	>80	79	151	9
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>A</b> 23/21/16	24/22/18	19/17/13
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.01	0.013	0.016



### **OIL ANALYSIS REPORT**






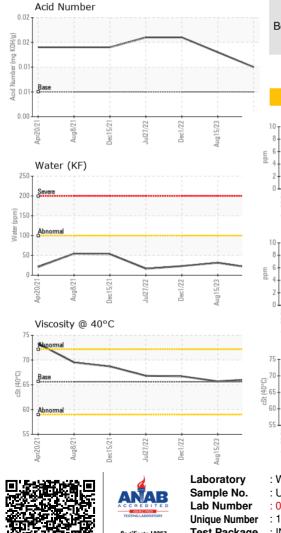

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	66.1	65.7	66.7
SAMPLE IMAGES	6	method	limit/base	current	history1	history2
Color				H CARL	Pictore Official West Official West Anthenia Anthenia Contracting	N3 155C-14 1359996 HEDMA



Bottom

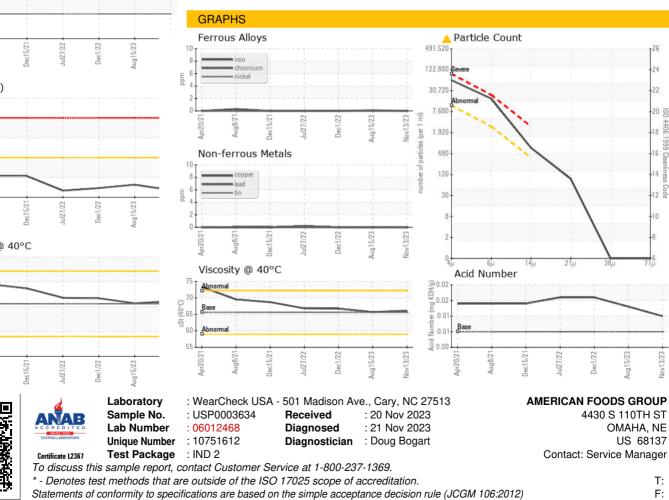

Contact/Location: Service Manager - AMEOMA