



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
AG-1900-2520-54FJ-16 1768412

Component
Compressor

Fluid
REFRIG COMP OIL ISO 46 (--- GAL)

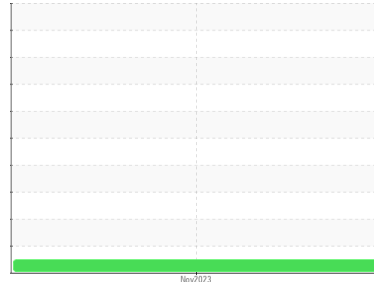

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0854622	---	---
Sample Date	Client Info	13 Nov 2023	---	---
Machine Age	hrs Client Info	18232	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		NORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	0	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m		2	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		0	---	---
Aluminum ppm ASTM D5185m	>25	<1	---	---
Lead ppm ASTM D5185m	>25	0	---	---
Copper ppm ASTM D5185m	>50	0	---	---
Tin ppm ASTM D5185m	>15	0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	5	0	---	---
Barium ppm ASTM D5185m	5	0	---	---
Molybdenum ppm ASTM D5185m	5	0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m	5	1	---	---
Calcium ppm ASTM D5185m	12	1	---	---
Phosphorus ppm ASTM D5185m	12	7	---	---
Zinc ppm ASTM D5185m	12	0	---	---
Sulfur ppm ASTM D5185m	1000	136	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	0	---	---
Sodium ppm ASTM D5185m		1	---	---
Potassium ppm ASTM D5185m	>20	2	---	---
Water % ASTM D6304	>0.1	NEG	---	---

FLUID DEGRADATION



method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.10	0.17	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	NONE	---	---
Yellow Metal scalar *Visual	NONE	NONE	---	---
Precipitate scalar *Visual	NONE	NONE	---	---
Silt scalar *Visual	NONE	NONE	---	---
Debris scalar *Visual	NONE	NONE	---	---
Sand/Dirt scalar *Visual	NONE	NONE	---	---
Appearance scalar *Visual	NORML	NORML	---	---
Odor scalar *Visual	NORML	NORML	---	---
Emulsified Water scalar *Visual	>0.1	NEG	---	---
Free Water scalar *Visual		NEG	---	---



OIL ANALYSIS REPORT



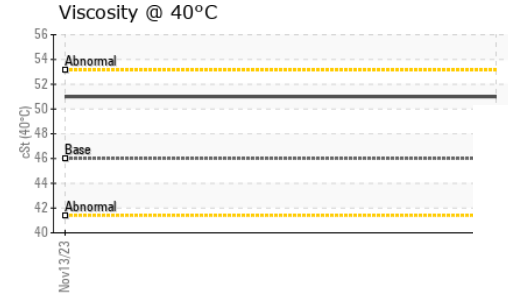
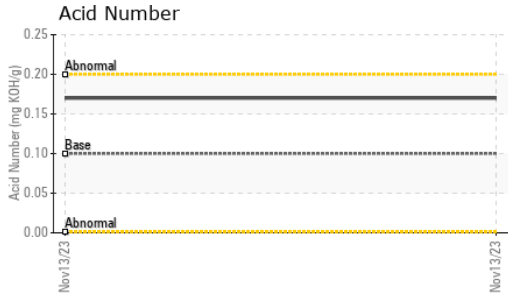


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	51.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

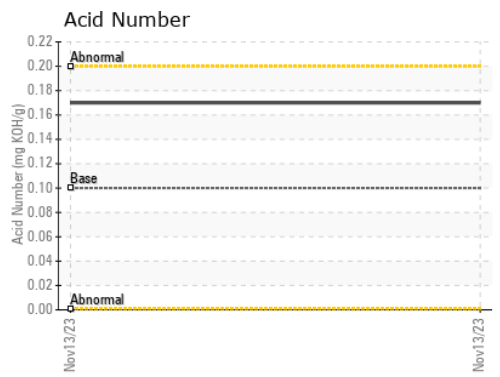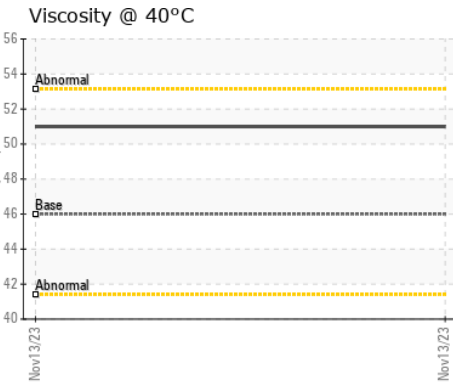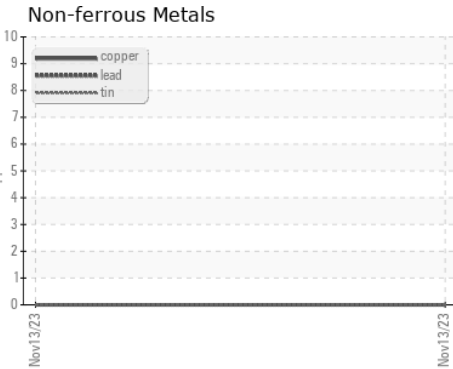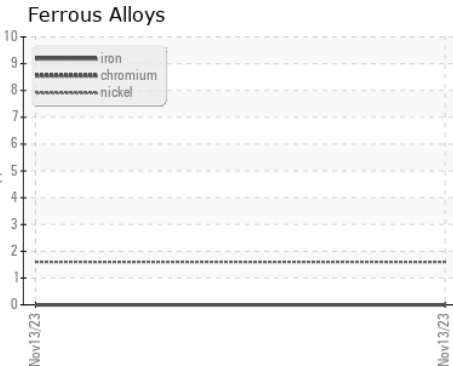

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0854622 **Received** : 20 Nov 2023
Lab Number : 06012516 **Diagnosed** : 22 Nov 2023
Unique Number : 10751660 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

ELEVATED INDUSTRIAL SOLUTIONS
 120 LAWTON AVE.
 MONROE, OH
 US 45050
 Contact: ROBIN PRICHARD
 r.prichard@compressedairtechnologies.com
 T: (513)539-5155
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)