



# PROBLEM SUMMARY

Area  
**NOT GIVEN**  
Machine Id  
**MOX1005569**  
Component  
**Compressor**

Sample Rating Trend




## COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C



▲ Silicon (ppm)

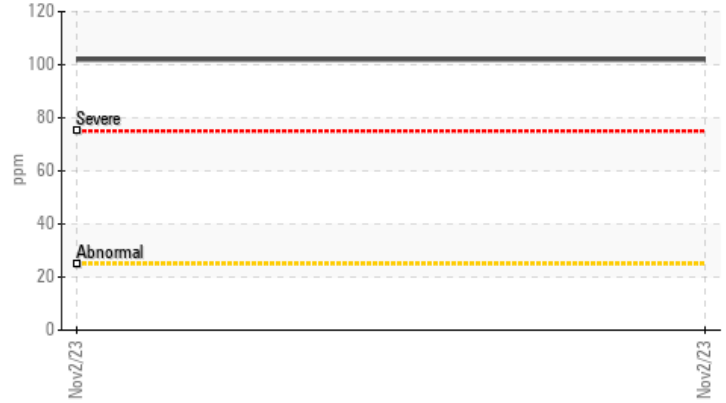

## RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	---	---
Silicon	ppm	ASTM D5185m	>25	▲ 102	---	---
Visc @ 40°C	cSt	ASTM D445	46	▲ 55.28	---	---

Customer Id: UCJOHSAI  
Sample No.: UCH06012525  
Lab Number: 06012525  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

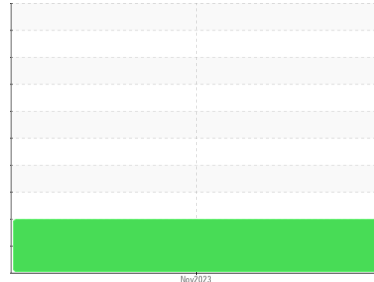

DIRT



Area  
**NOT GIVEN**  
 Machine Id  
**MOX1005569**  
 Component  
**Compressor**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal.

### ▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06012525</b>	---	---
Sample Date	Client Info		<b>02 Nov 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.8	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>2</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>9</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 525	<b>385</b>	---	---
Molybdenum	ppm	ASTM D5185m 10	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 5	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m 10	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m 250	<b>5</b>	---	---
Zinc	ppm	ASTM D5185m 100	<b>28</b>	---	---
Sulfur	ppm	ASTM D5185m 400	<b>398</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>▲ 102</b>	---	---
Sodium	ppm	ASTM D5185m	<b>68</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>13</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.94</b>	---	---



# OIL ANALYSIS REPORT

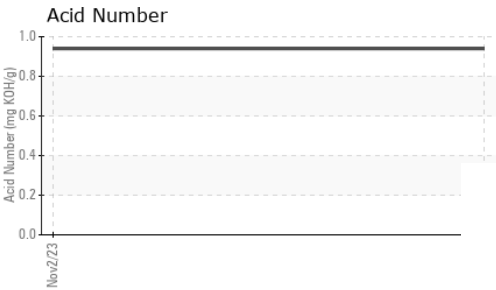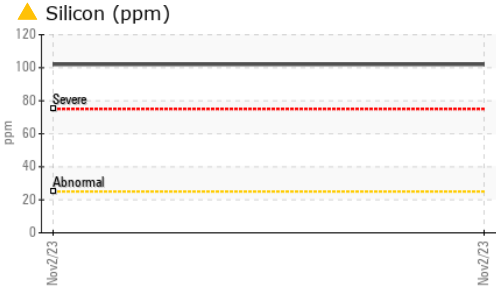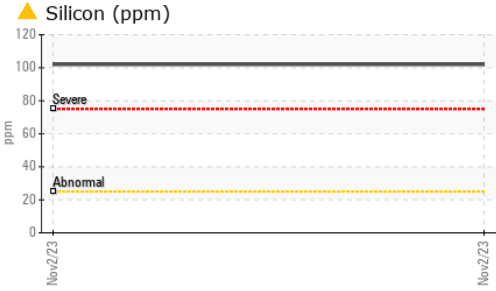





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.8	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46 ▲ <b>55.28</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

### GRAPHS

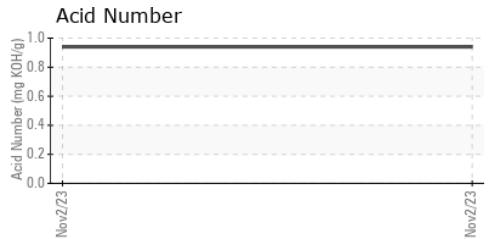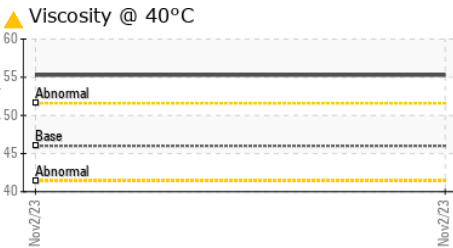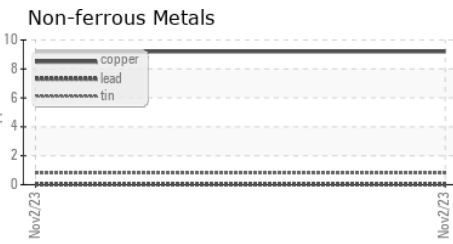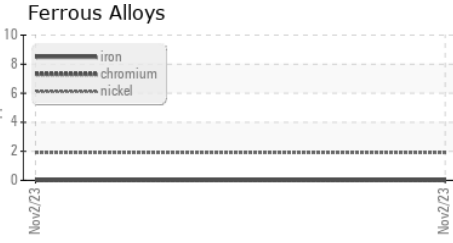

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06012525 **Received** : 20 Nov 2023  
**Lab Number** : **06012525** **Diagnosed** : 29 Nov 2023  
**Unique Number** : 10751669 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhfc.com  
 T: (314)593-1267  
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)