


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

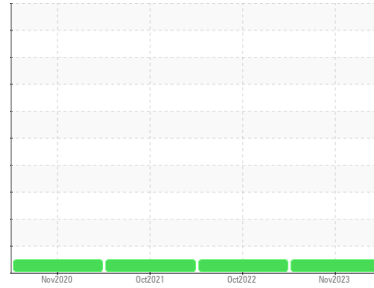

Area  
**PALEXTRA 44 [JAX-PM2772433-1]**  
Machine Id  
**PALATEK 03L014 - EP**  
Component  
**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS06012537</b>	UCS05671743	UCS05392015
Sample Date	Client Info			<b>06 Nov 2023</b>	11 Oct 2022	29 Oct 2021
Machine Age	hrs	Client Info		<b>0</b>	40126	39646
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	2	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>2</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.3	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0.4	<b>2</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m	689	<b>467</b>	140	185
Zinc	ppm	ASTM D5185m	0	<b>0</b>	16	0
Sulfur	ppm	ASTM D5185m	1237	<b>272</b>	123	121

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>2</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	<1	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	<b>0.33</b>	0.26	0.243


# OIL ANALYSIS REPORT

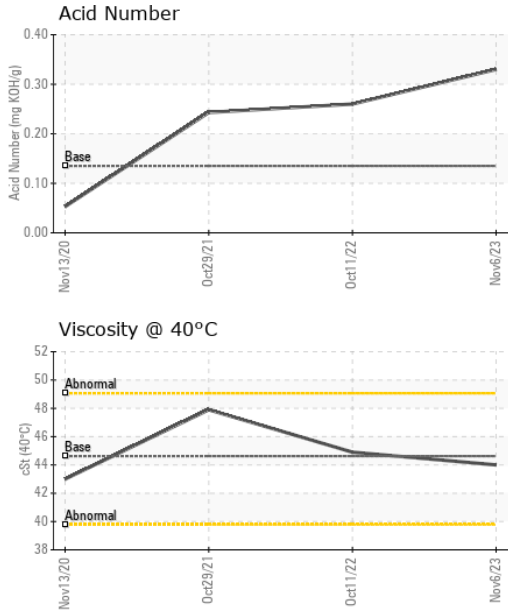





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	MODER	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.62	<b>44.0</b>	44.9	47.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

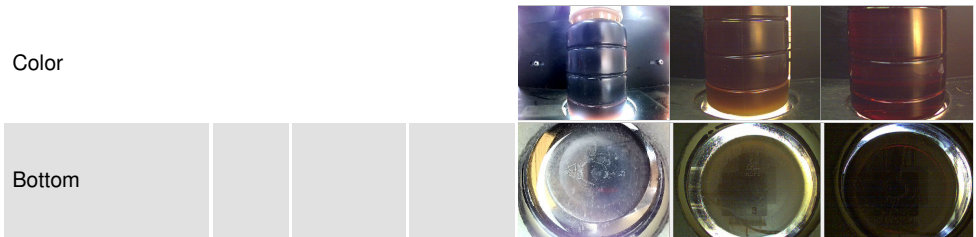

## GRAPHS

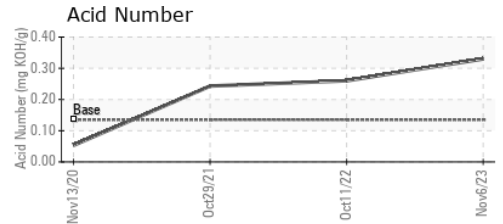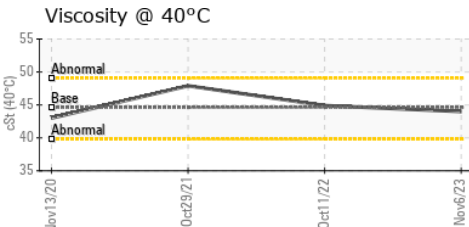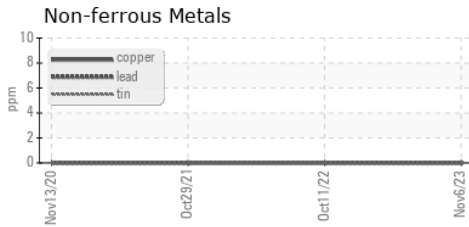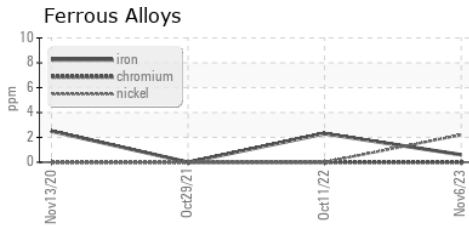

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06012537 **Received** : 20 Nov 2023  
**Lab Number** : 06012537 **Diagnosed** : 22 Nov 2023  
**Unique Number** : 10751681 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**QUALITY COMPRESSED AIR SERVICES INC**

BATON ROUGE, LA  
 US 70814  
 Contact: GEORGIA HOLLEY  
 georgia@qc-as-inc.com  
 T: (225)932-0029  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)