




OIL ANALYSIS REPORT

Sample Rating Trend

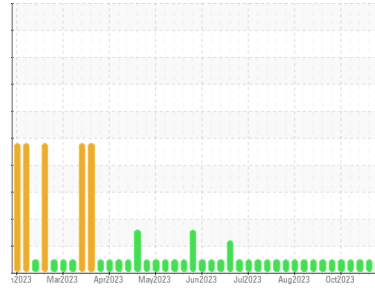

NORMAL



Machine Id
HANM04BE (S/N 4EK00413)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX LFG SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0851280	WC0851228	WC0851197
Sample Date	Client Info		17 Nov 2023	09 Nov 2023	31 Oct 2023
Machine Age	hrs	Client Info	70823	70634	70415
Oil Age	hrs	Client Info	551	362	143
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	1	3	2
Chromium	ppm	ASTM D5185m	>4	0	<1	0
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>5	0	<1	0
Aluminum	ppm	ASTM D5185m	>6	2	2	<1
Lead	ppm	ASTM D5185m	>9	0	1	0
Copper	ppm	ASTM D5185m	>14	2	2	1
Tin	ppm	ASTM D5185m	>4	5	3	2
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	6	0
Molybdenum	ppm	ASTM D5185m		<1	2	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		14	10	6
Calcium	ppm	ASTM D5185m		1971	1855	1748
Phosphorus	ppm	ASTM D5185m	270	300	310	248
Zinc	ppm	ASTM D5185m	310	387	338	334
Sulfur	ppm	ASTM D5185m		2411	2423	1924

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	126	107	66
Sodium	ppm	ASTM D5185m		<1	0	<1
Potassium	ppm	ASTM D5185m	>20	2	2	0

INFRA-RED




	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	7.0	6.8	7.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.6	19.4	16.7

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.2	14.5	10.9
Acid Number (AN)	mg KOH/g	ASTM D8045	1.8	1.16	1.10	0.51
Base Number (BN)	mg KOH/g	ASTM D2896	6.0	3.89	4.14	4.82











OIL ANALYSIS REPORT

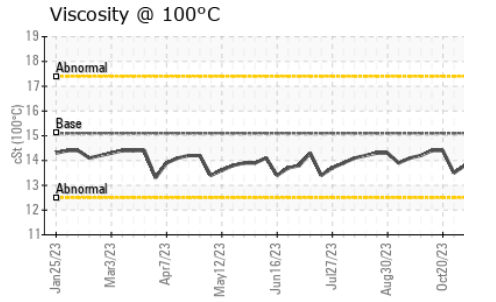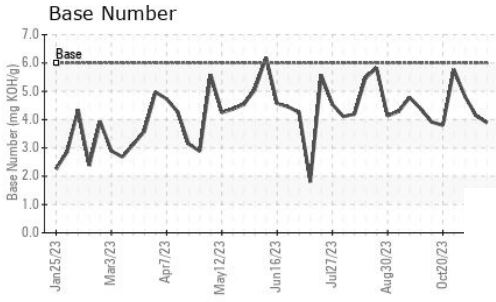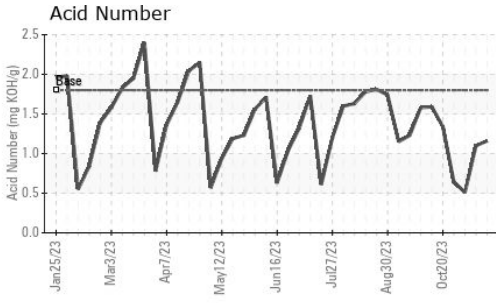

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.1	14.2	13.9	13.8

GRAPHS

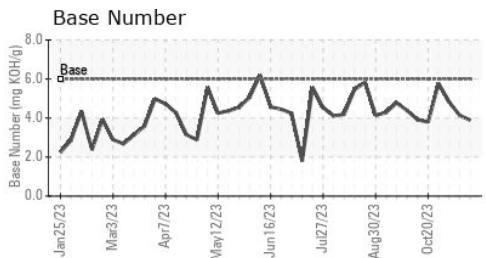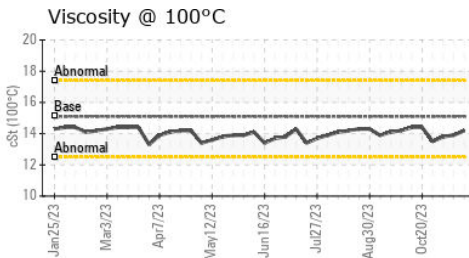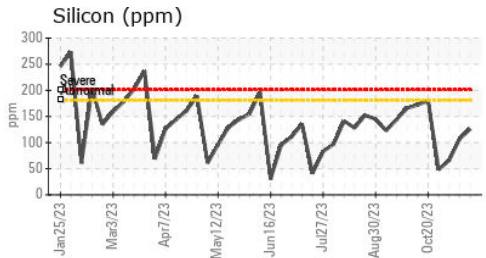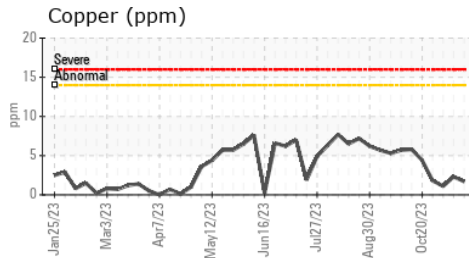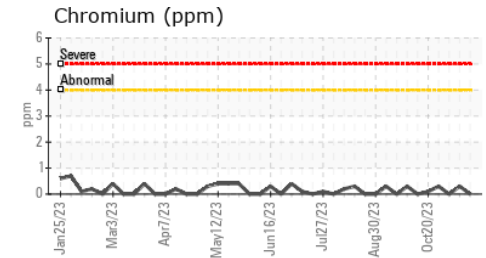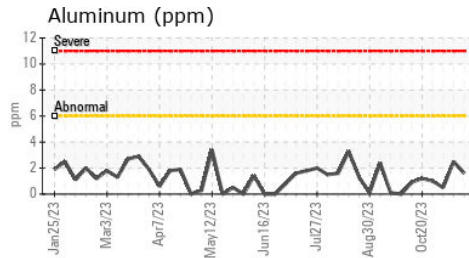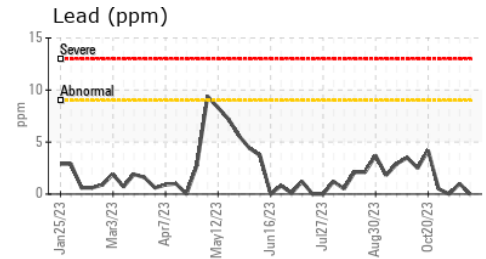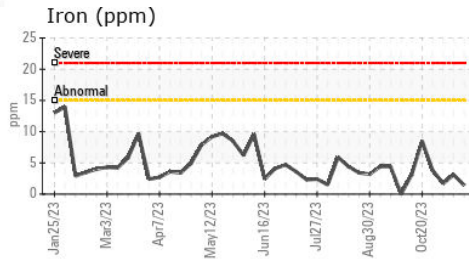

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0851280 **Received** : 20 Nov 2023
Lab Number : 06012614 **Diagnosed** : 21 Nov 2023
Unique Number : 10751758 **Diagnostician** : Sean Felton
Test Package : MOB 2

EDL NA Recips-Hancock County
 HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142
 FINDLAY, OH
 US 45840
 Contact: TIM CUSICK
 tim.cusick@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: