




OIL ANALYSIS REPORT



Machine Id
Hancock CAT 1 (S/N 4EK00133)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX LFG SAE 40 (--- GAL)

Sample Rating Trend

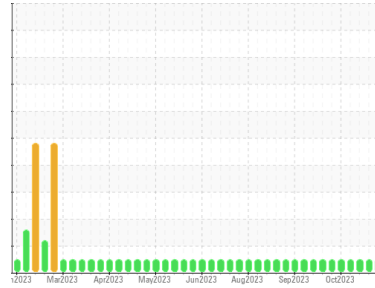

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0851277	WC0851225	WC0851198
Sample Date	Client Info		17 Nov 2023	09 Nov 2023	31 Oct 2023
Machine Age	hrs	Client Info	66787	66599	66379
Oil Age	hrs	Client Info	70	999	779
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	0	2	1
Chromium	ppm	ASTM D5185m >4	0	<1	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m >5	0	<1	0
Aluminum	ppm	ASTM D5185m >6	1	2	1
Lead	ppm	ASTM D5185m >9	0	2	<1
Copper	ppm	ASTM D5185m >14	0	1	<1
Tin	ppm	ASTM D5185m >4	2	5	5
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	6	0
Molybdenum	ppm	ASTM D5185m	<1	2	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	14	11	8
Calcium	ppm	ASTM D5185m	1480	1998	1900
Phosphorus	ppm	ASTM D5185m 270	289	321	272
Zinc	ppm	ASTM D5185m 310	366	368	380
Sulfur	ppm	ASTM D5185m	2434	2708	2152

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	47	153	146
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	2	2	<1

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	4.4	7.2	6.8
Sulfation	Abs/.1mm	*ASTM D7415 >30	15.7	20.7	20.3

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	9.0	15.9	15.0
Acid Number (AN)	mg KOH/g	ASTM D8045 1.8	0.39	1.26	1.27
Base Number (BN)	mg KOH/g	ASTM D2896 6.0	4.02	4.10	4.23











OIL ANALYSIS REPORT

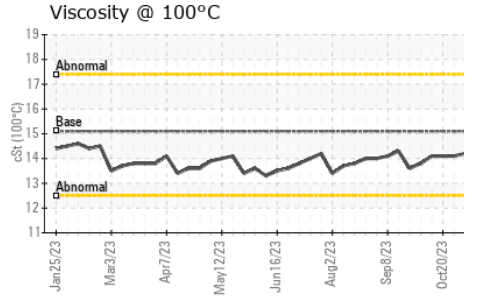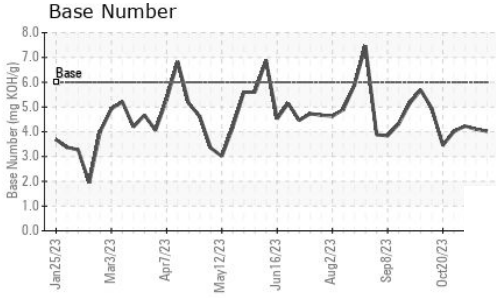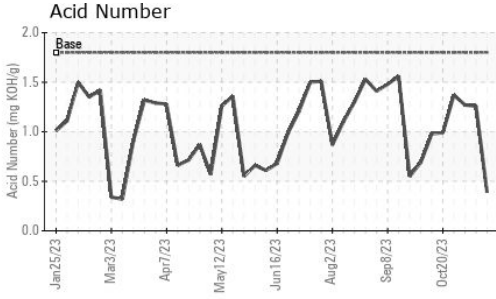

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	13.5	14.2

GRAPHS

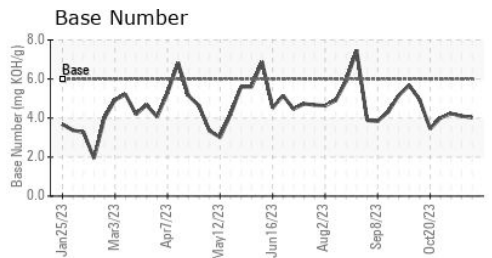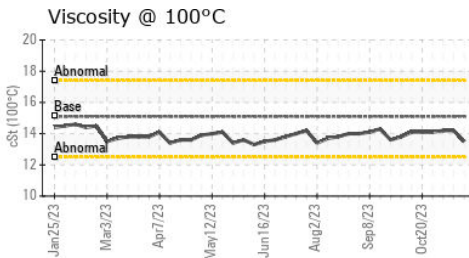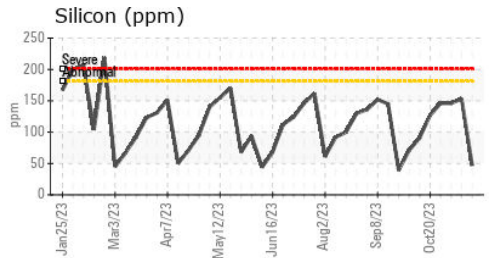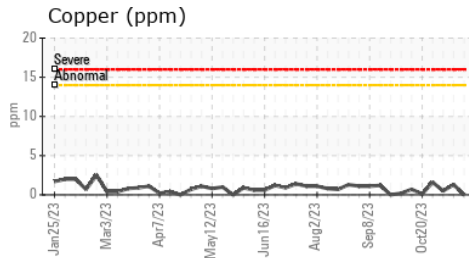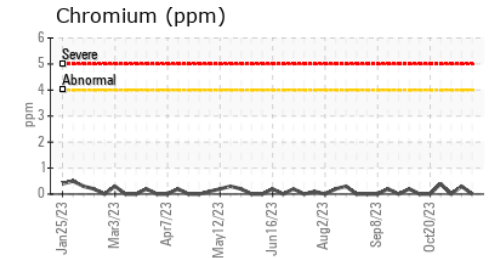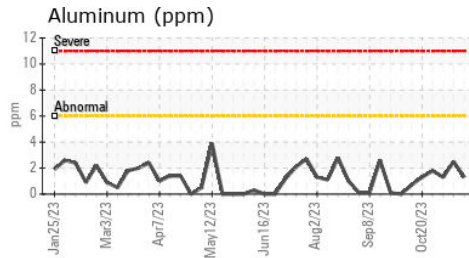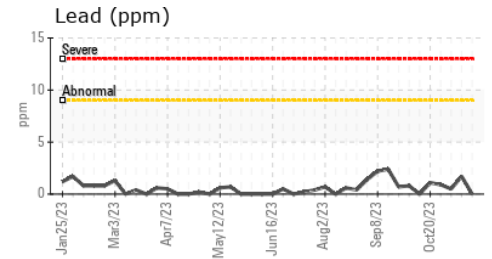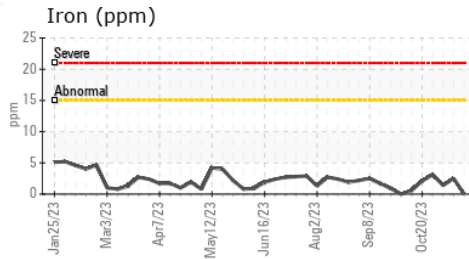

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0851277 Received : 20 Nov 2023
 Lab Number : 06012616 Diagnosed : 21 Nov 2023
 Unique Number : 10751760 Diagnostician : Sean Felton
 Test Package : MOB 2

EDL NA Recips-Hancock County
 HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142
 FINDLAY, OH
 US 45840
 Contact: TIM CUSICK
 tim.cusick@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: