



# FUEL REPORT

Sample Rating Trend

**NORMAL**



Area  
**[W126079]**  
 Machine Id  
**3002006488**  
 Component  
**Diesel Fuel**  
 Fluid  
**DIESEL FUEL No. 2 (--- GAL)**



## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

### Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0637186</b>	---	---
Sample Date	Client Info			<b>25 Oct 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	4.1	<b>2.46</b>	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>1</b>	---	---
Water	%	ASTM D6304	<0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304	<500	<b>31.3</b>	---	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	---	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	---	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>2</b>	---	---
Nickel	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<0.1	<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---





## SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image



# FUEL REPORT

## GRAPHS

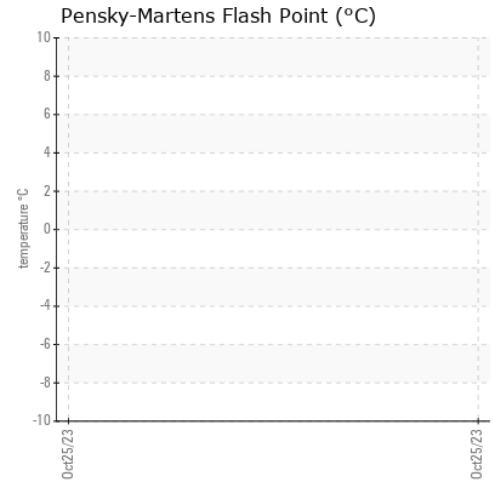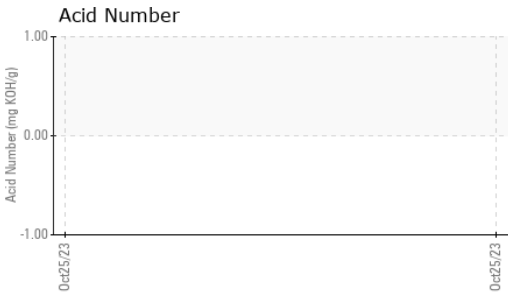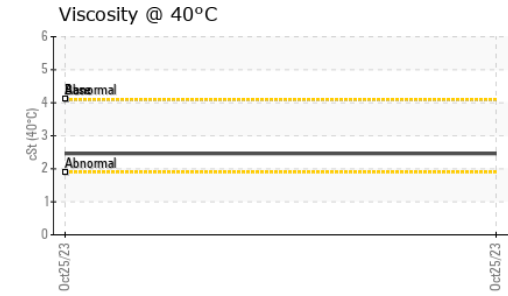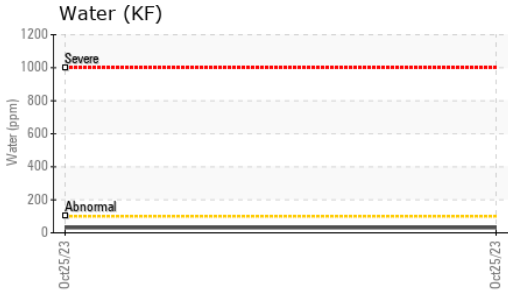

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0637186 **Received** : 20 Nov 2023  
**Lab Number** : 06012895 **Diagnosed** : 10 Dec 2023  
**Unique Number** : 10752039 **Diagnostician** : Doug Bogart  
**Test Package** : DF-5 ( Additional Tests: SCREEN )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NATIONAL POWER CORP**  
 4541 PRESLYN DR  
 RALEIGH, NC  
 US 27616  
 Contact: BRANDON RICE  
 brandon.rice@natpow.com  
 T:  
 F: (919)790-9714