



COOLANT REPORT

Sample Rating Trend

NORMAL



Area

[W123408]

Machine Id


GENERAC J50951 COD EAGLEVIEW

Component

Coolant

Fluid

CONVENTIONAL COOLANT (--- QTS)

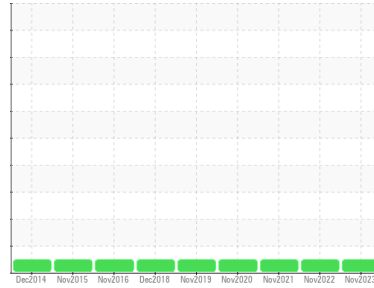

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.








SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0763341	WC0663245	WC0529235
Sample Date	Client Info			09 Nov 2023	09 Nov 2022	18 Nov 2021
Machine Age	hrs	Client Info		0	0	110
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL TEST RESULTS		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		1.066	1.067	---
pH	Scale 0-14	ASTM D1287		10.1	10.3	10.4
Nitrites	ppm	AP-053:2009		1388	1464	1428
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		49.1	49.6	49
Freezing Point	°F	ASTM D3321		-33	-33	-36
Total Dissolved Solids				342.0	388.5	328.0
Carboxylate				n/a	n/a	n/a

VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Pink	Pink	Pink
Coolant Appearance		*Visual	Clear	normal	normal	normal
Color						
Bottom						



COOLANT REPORT

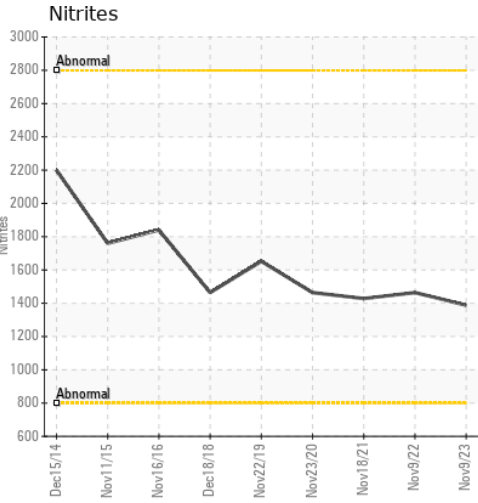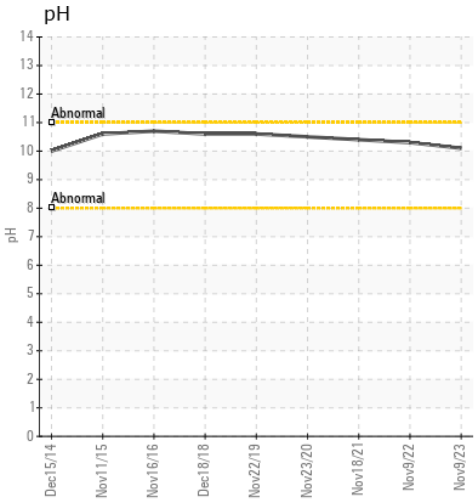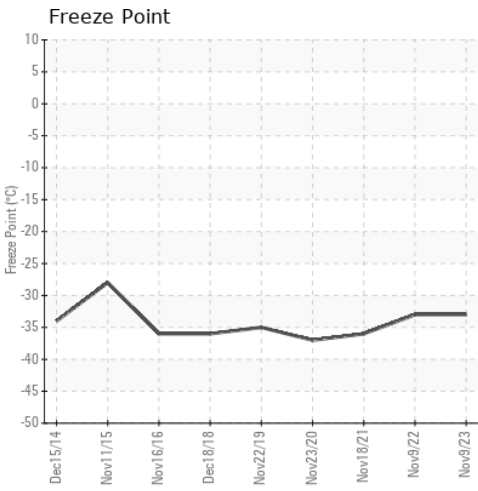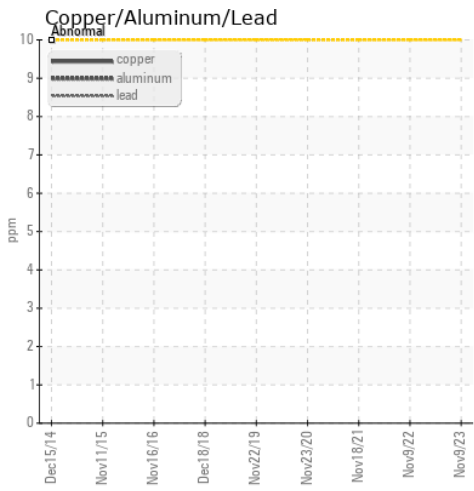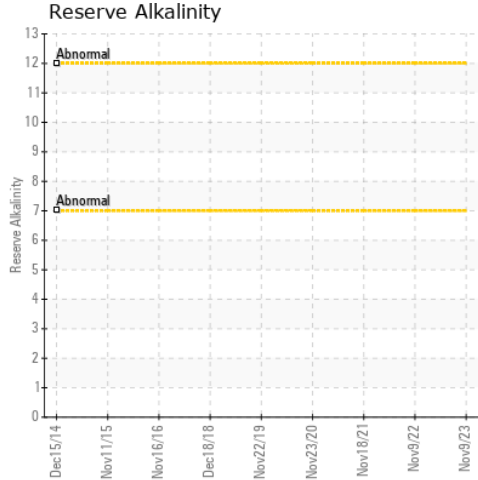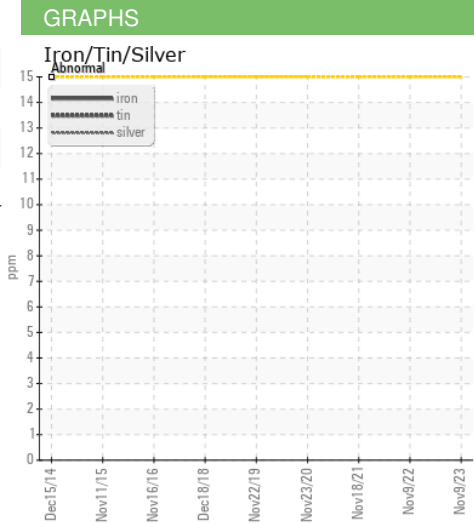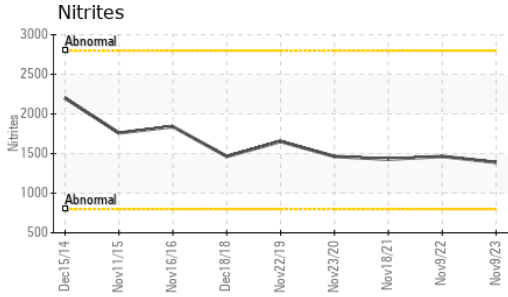

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0763341 **Received** : 20 Nov 2023
Lab Number : 06012903 **Diagnosed** : 22 Nov 2023
Unique Number : 10752047 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616
 Contact: BRANDON RICE
 brandon.rice@natpow.com
 T:
 F: (919)790-9714

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)