




PROBLEM SUMMARY


Sample Rating Trend

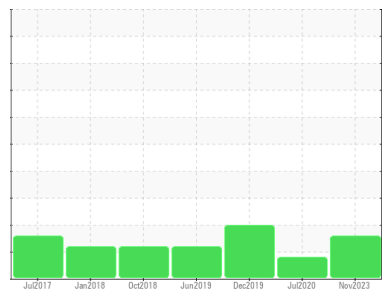

Machine Id
KAESER AIRCENTER SM 10 5805974 (S/N 2366)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

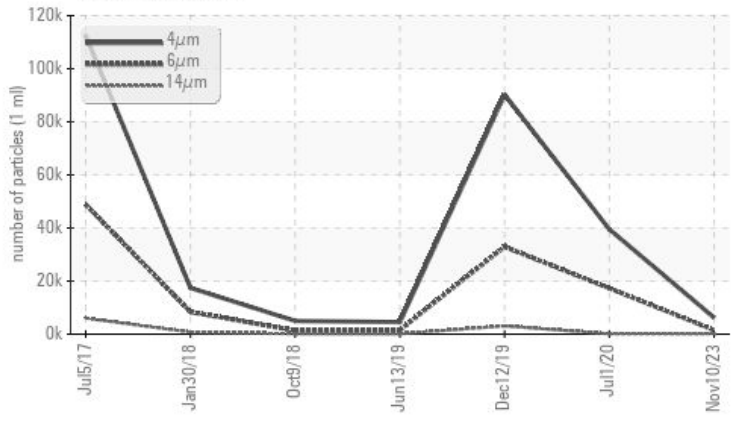


RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1514	▲ 17284	▲ 32907
Particles >14µm	ASTM D7647	>80	▲ 144	▲ 117	▲ 3090
Particles >21µm	ASTM D7647	>20	▲ 30	9	▲ 770
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 21/14	▲ 22/19

Customer Id: APCCHE
Sample No.: KCPA009061
Lab Number: 06013282
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

01 Jul 2020 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



12 Dec 2019 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Jun 2019 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER AIRCENTER SM 10 5805974 (S/N 2366)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

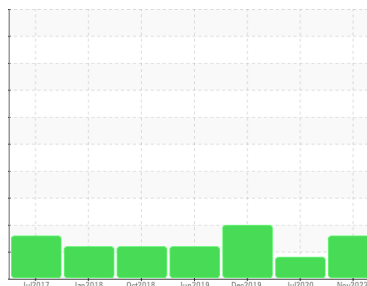

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA009061	KCP24616	KCP21036
Sample Date	Client Info			10 Nov 2023	01 Jul 2020	12 Dec 2019
Machine Age	hrs	Client Info		18172	11901	11667
Oil Age	hrs	Client Info		0	300	810
Oil Changed	Client Info			N/A	Changed	Not Changed
Sample Status				ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	<1	2	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2	0
Barium	ppm	ASTM D5185m	90	24	36	31
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	62	78	75
Calcium	ppm	ASTM D5185m	0	3	4	2
Phosphorus	ppm	ASTM D5185m	0	1	3	1
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	23500	20207	20115	18626

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	4	3
Sodium	ppm	ASTM D5185m		15	18	19
Potassium	ppm	ASTM D5185m	>20	1	2	2
Water	%	ASTM D6304	>0.05	0.013	0.040	0.019
ppm Water	ppm	ASTM D6304	>500	132.9	402.5	194.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6234	39512	90233
Particles >6µm		ASTM D7647	>1300	▲ 1514	▲ 17284	▲ 32907
Particles >14µm		ASTM D7647	>80	▲ 144	▲ 117	▲ 3090
Particles >21µm		ASTM D7647	>20	▲ 30	9	▲ 770
Particles >38µm		ASTM D7647	>4	1	0	▲ 60
Particles >71µm		ASTM D7647	>3	0	0	▲ 12
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 21/14	▲ 22/19

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.26	0.379	0.360

OIL ANALYSIS REPORT

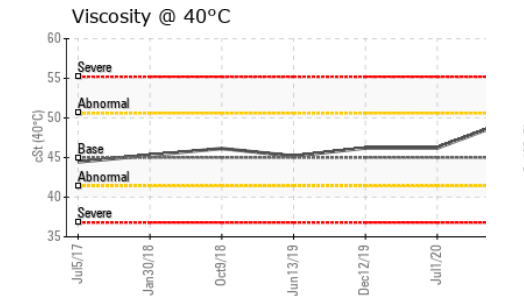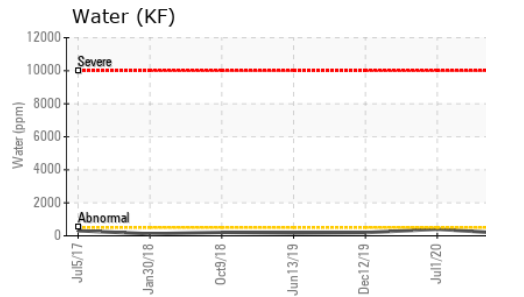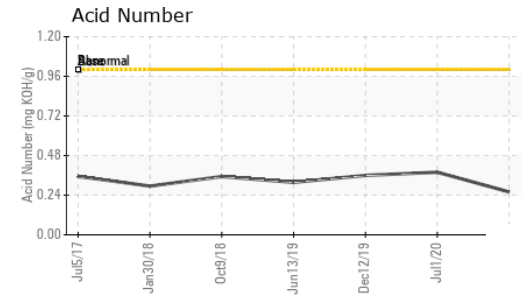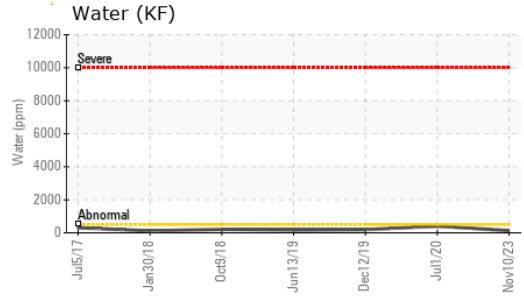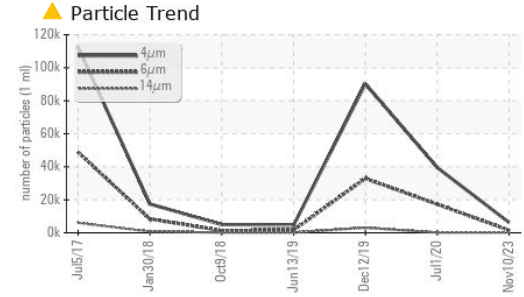





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	49.6	46.2	46.2

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

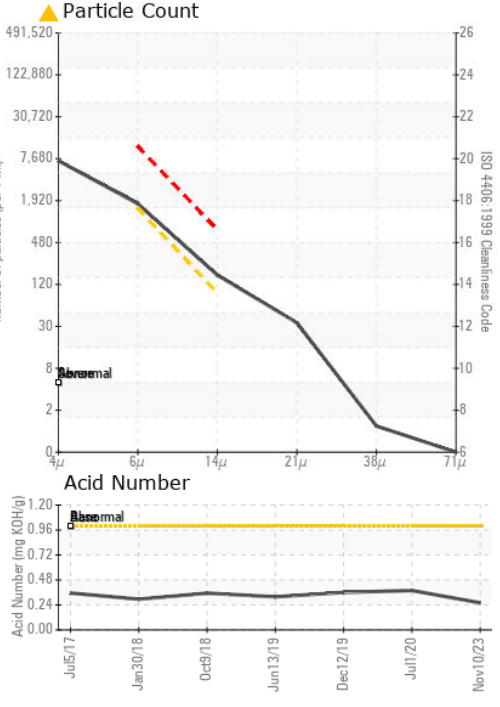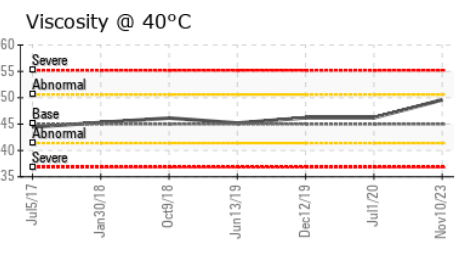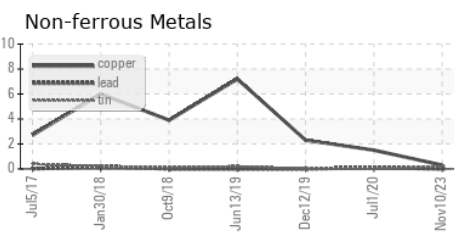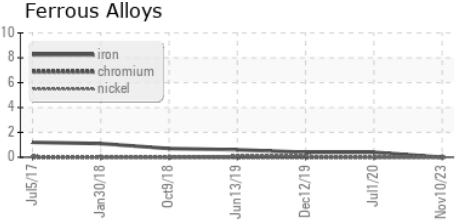

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009061
Lab Number : 06013282
Unique Number : 10752426
Test Package : IND 2 (Additional Tests: KF, PrtCount)

APC DIRECT
 770 SPIRIT OF ST LOUIS BLVD
 CHESTERFIELD, MO
 US 63005
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: