




PROBLEM SUMMARY

Sample Rating Trend

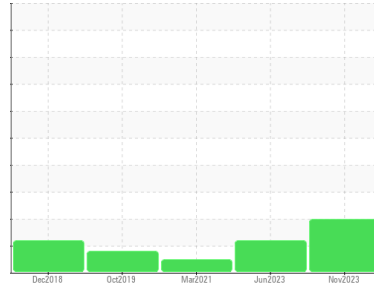

ISO




Machine Id
KAESER CSV 150 6063724 (S/N 1087)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

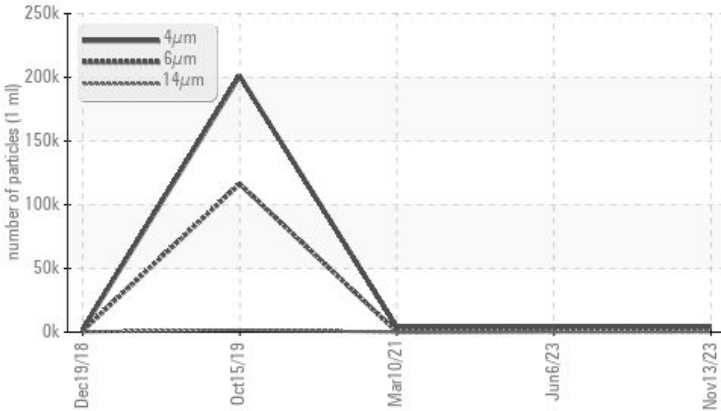

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1489	1221	311
Particles >14µm	ASTM D7647	>80	▲ 173	▲ 89	19
Particles >21µm	ASTM D7647	>20	▲ 56	▲ 24	7
Particles >38µm	ASTM D7647	>4	▲ 4	1	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/15	▲ 19/17/14	15/11

Customer Id: SEDMOU
Sample No.: KC111261
Lab Number: 06013289
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

06 Jun 2023 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



10 Mar 2021 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Oct 2019 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

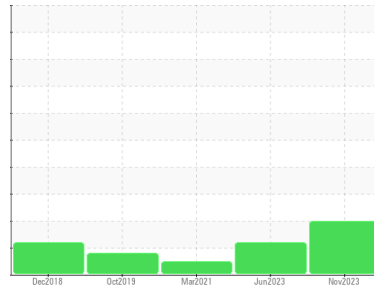

ISO



Machine Id
KAESER CSV 150 6063724 (S/N 1087)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC111261	KCP53992	KC73093
Sample Date	Client Info	13 Nov 2023	06 Jun 2023	10 Mar 2021
Machine Age	hrs	23595	20962	12121
Oil Age	hrs	3000	4000	3000
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		ABNORMAL	ATTENTION	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	<1	<1
Titanium	ppm	ASTM D5185m >3	0	0	<1
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	1	3	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	102	104	126
Molybdenum	ppm	ASTM D5185m	0	0	2
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	105	99	132
Calcium	ppm	ASTM D5185m 2	4	3	3
Phosphorus	ppm	ASTM D5185m	1	2	3
Zinc	ppm	ASTM D5185m	0	0	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	12	15	1
Sodium	ppm	ASTM D5185m	7	15	17
Potassium	ppm	ASTM D5185m >20	<1	2	26
Water	%	ASTM D6304 >0.05	0.011	0.026	0.019
ppm Water	ppm	ASTM D6304 >500	111.9	269.6	197.4






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4078	4472	4135
Particles >6µm	ASTM D7647 >1300	▲ 1489	1221	311
Particles >14µm	ASTM D7647 >80	▲ 173	▲ 89	19
Particles >21µm	ASTM D7647 >20	▲ 56	▲ 24	7
Particles >38µm	ASTM D7647 >4	▲ 4	1	0
Particles >71µm	ASTM D7647 >3	1	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/18/15	▲ 19/17/14	15/11

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.37	0.403


OIL ANALYSIS REPORT

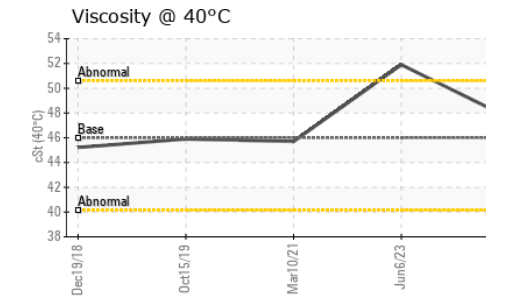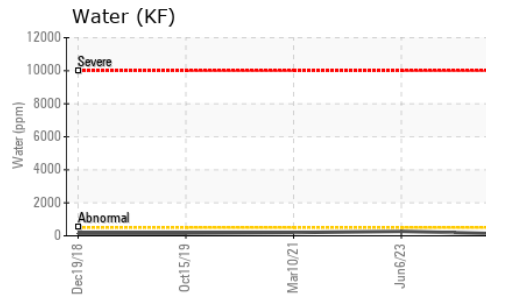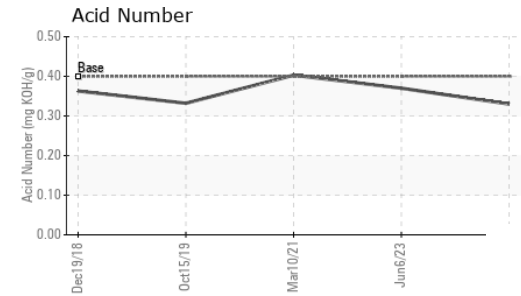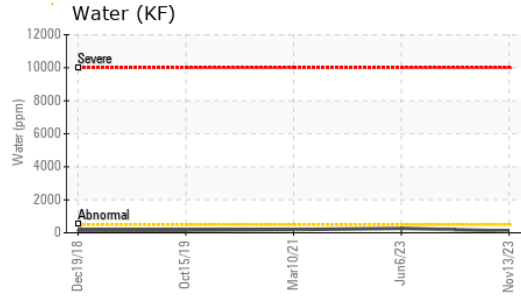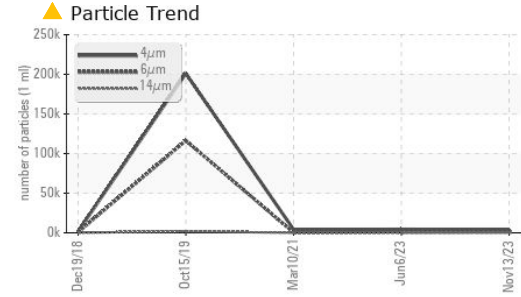





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.6	51.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

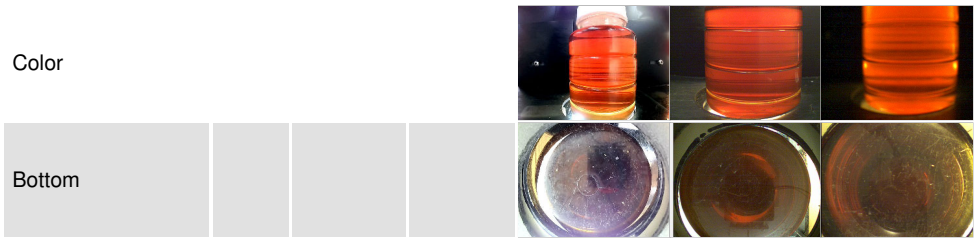

GRAPHS

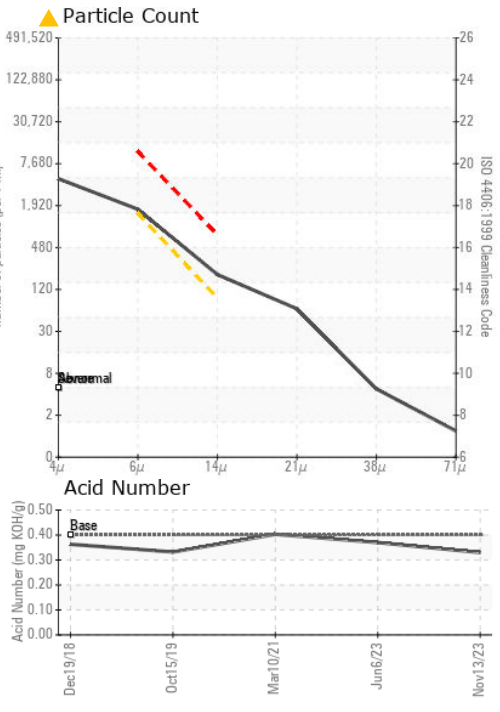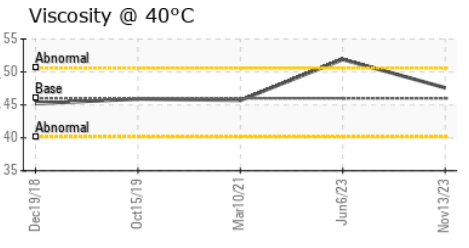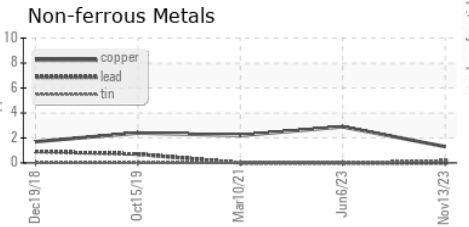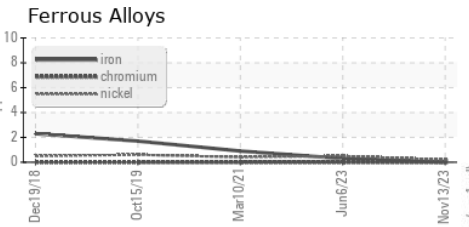

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC111261 **Received** : 20 Nov 2023
Lab Number : 06013289 **Diagnosed** : 22 Nov 2023
Unique Number : 10752433 **Diagnostician** : Don Baldrige
Test Package : IND 2

SEDA NORTH AMERICA INC
 12501 GLOBE DR
 MOUNT PLEASANT, WI
 US 53177
 Contact: JOSH KINN
 JOSH_KINN@SEDAGROUP.ORG
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)