

PROBLEM SUMMARY

Sample Rating Trend

ISO


7024294 (S/N 1106)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

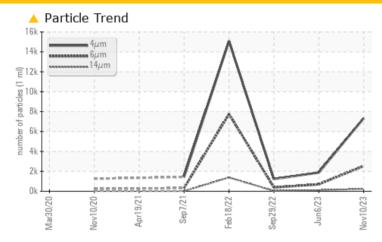

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	NORMAL				
Particles >6µm	ASTM D7647	>1300	<u>2531</u>	696	385				
Particles >14μm	ASTM D7647	>80	235	<u> </u>	36				
Particles >21µm	ASTM D7647	>20	<u> </u>	△ 31	10				
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/19/15	1 8/17/14	17/16/12				

Customer Id: ADVGAH Sample No.: KCPA011338 Lab Number: 06013338 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Jun 2023 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time.All component wear rates are normal. There is a moderate amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



29 Sep 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



18 Feb 2022 Diag: Angela Borella

150




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



ISO

7024294 (S/N 1106)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2020 N	lov2020 Apr2021 Sep20	21 Feb2022 Sep2022 Jun2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011338	KCP53691	KC106977
Sample Date		Client Info		10 Nov 2023	06 Jun 2023	29 Sep 2022
Machine Age	hrs	Client Info		34993	31255	25278
Oil Age	hrs	Client Info		0	5977	5347
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	<1	6
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	85	1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	17	83	2
Calcium	ppm	ASTM D5185m	2	1	0	0
Phosphorus	ppm	ASTM D5185m		1	0	2
Zinc	ppm	ASTM D5185m		26	0	0
Sulfur	ppm	ASTM D5185m		16798	19745	14947
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	15	<1
Sodium	ppm	ASTM D5185m		7	15	0
Potassium	ppm	ASTM D5185m	>20	3	1	0
Water	%	ASTM D6304	>0.05	800.0	0.005	0.010
ppm Water	ppm	ASTM D6304	>500	82.2	57.2	108.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		7341	1883	1224
Particles >6µm		ASTM D7647		<u>^</u> 2531	696	385
Particles >14µm		ASTM D7647	>80	<u>^</u> 235	<u>110</u>	36
Particles >21µm		ASTM D7647	>20	<u>^</u> 52	△ 31	10
Particles >38µm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/15	<u>18/17/14</u>	17/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.31



OIL ANALYSIS REPORT



Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.



Certificate L2367

T: F:

Contact: Service Manager