




PROBLEM SUMMARY

Sample Rating Trend


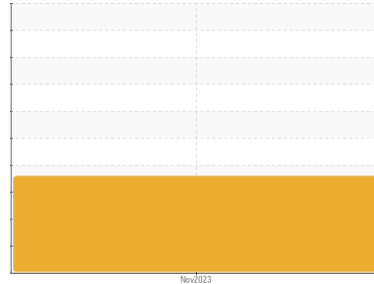


WATER



Machine Id
KAESER BSD.3 (S/N 5392)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

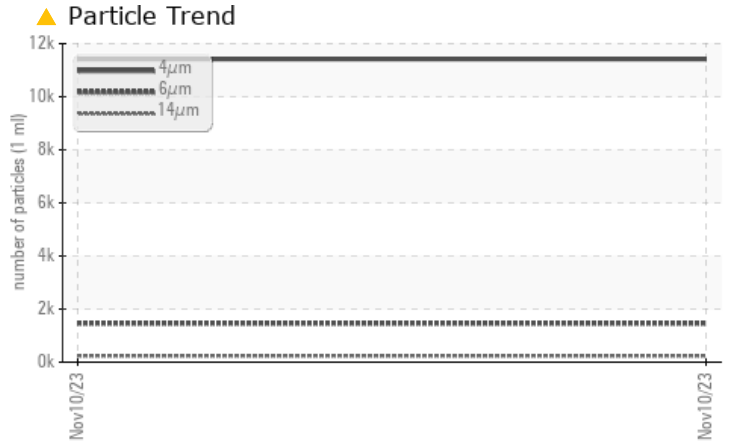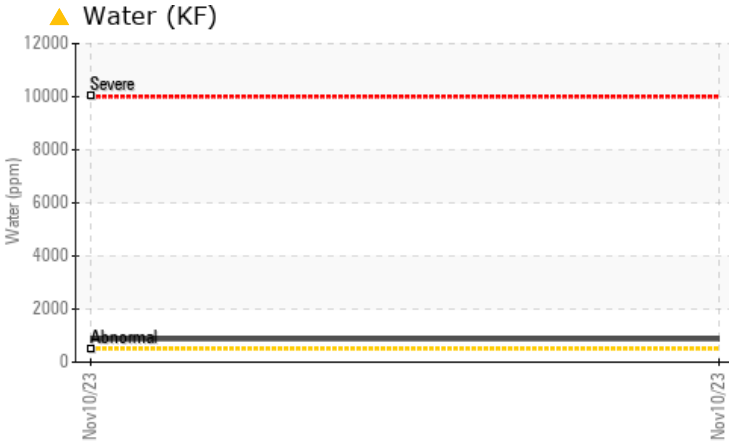

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Water	%	ASTM D6304	>0.05	▲ 0.087	---	---
ppm Water	ppm	ASTM D6304	>500	▲ 870	---	---
Particles >6µm		ASTM D7647	>1300	▲ 1464	---	---
Particles >14µm		ASTM D7647	>80	▲ 237	---	---
Particles >21µm		ASTM D7647	>20	▲ 96	---	---
Particles >38µm		ASTM D7647	>4	▲ 8	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/18/15	---	---

Customer Id: INTMILMI
 Sample No.: KC06013357
 Lab Number: 06013357
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

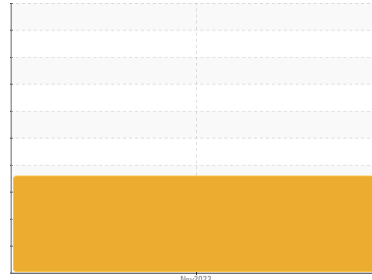

WATER



Machine Id
KAESER BSD.3 (S/N 5392)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06013357	---	---
Sample Date	Client Info	10 Nov 2023	---	---
Machine Age	hrs Client Info	4366	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	0	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	<1	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	<1	---	---
Lead ppm ASTM D5185m	>10	0	---	---
Copper ppm ASTM D5185m	>50	<1	---	---
Tin ppm ASTM D5185m	>10	<1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	0	0	---	---
Barium ppm ASTM D5185m	90	0	---	---
Molybdenum ppm ASTM D5185m	0	0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m	100	44	---	---
Calcium ppm ASTM D5185m	0	3	---	---
Phosphorus ppm ASTM D5185m	0	3	---	---
Zinc ppm ASTM D5185m	0	3	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	0	---	---
Sodium ppm ASTM D5185m		11	---	---
Potassium ppm ASTM D5185m	>20	2	---	---
Water % ASTM D6304	>0.05	▲ 0.087	---	---
ppm Water ppm ASTM D6304	>500	▲ 870	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		11417	---	---
Particles >6µm ASTM D7647	>1300	▲ 1464	---	---
Particles >14µm ASTM D7647	>80	▲ 237	---	---
Particles >21µm ASTM D7647	>20	▲ 96	---	---
Particles >38µm ASTM D7647	>4	▲ 8	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	▲ 21/18/15	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	1.0	0.30	---	---


OIL ANALYSIS REPORT

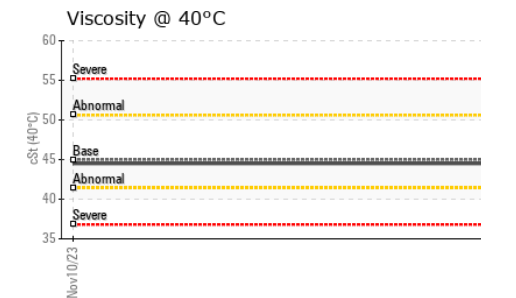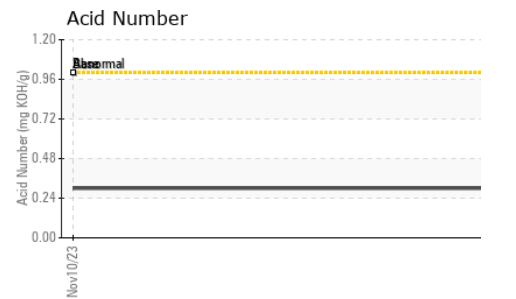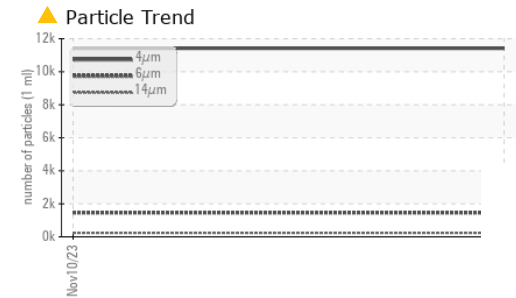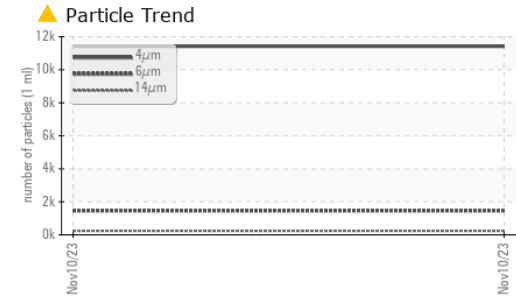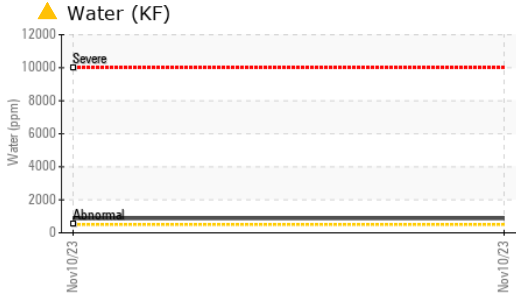





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

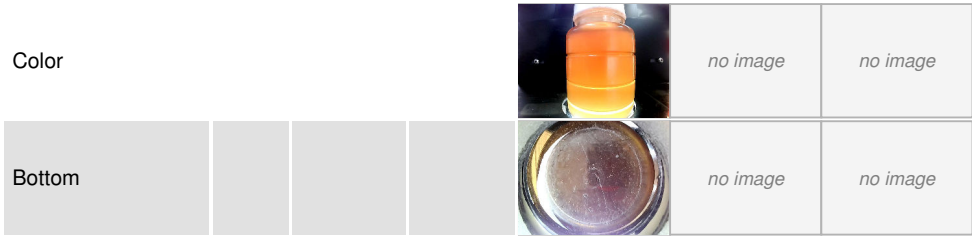

GRAPHS

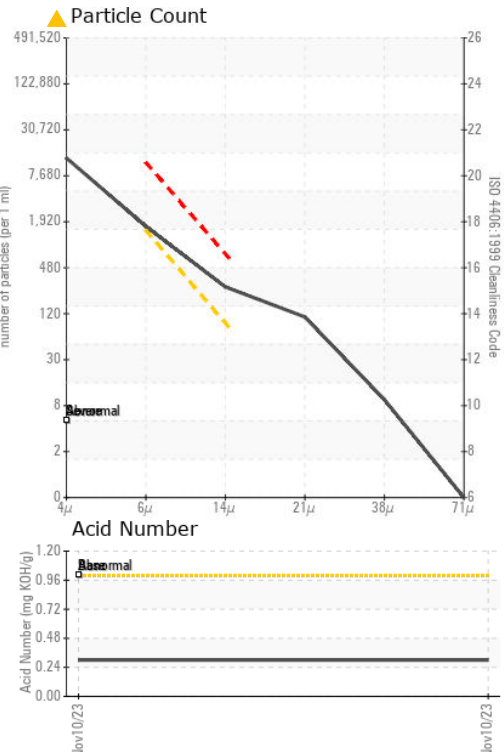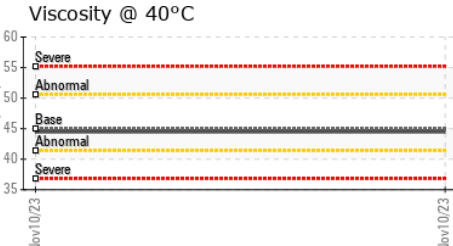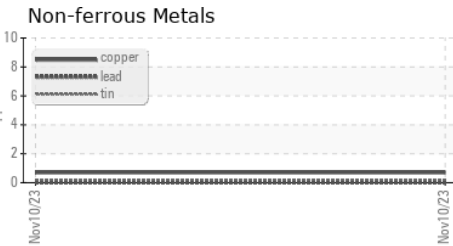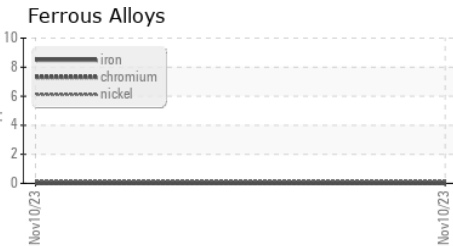

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06013357 **Received** : 20 Nov 2023
Lab Number : 06013357 **Diagnosed** : 29 Nov 2023
Unique Number : 10752501 **Diagnostician** : Jonathan Hester
Test Package : IND 2

INTEGRITY SALES AND SERVICE
 4512 INDUSTRIAL DR
 MILLINGTON, MI
 CA 48746
 Contact: JEFF
 JEFF@INTEGRITY-SALES.US
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)