


# **PROBLEM SUMMARY**

# KAESER SX 7.5 5009001 (S/N 3089)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# COMPONENT CONDITION SUMMARY

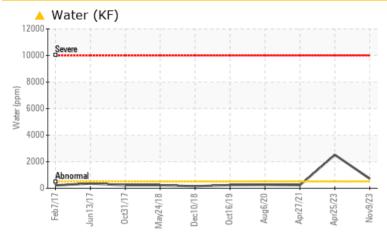

# RECOMMENDATION

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS								
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL		
Water	%	ASTM D6304	>0.05	<b>6.072</b>	<b>0.252</b>	0.023		
ppm Water	ppm	ASTM D6304	>500	<b>A</b> 720.7	▲ 2522.2	231.4		


Customer Id: AMASHE Sample No.: KCPA007677 Lab Number: 06013359 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Don Baldridge +1 <u>don.b505@comcast.net</u>

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

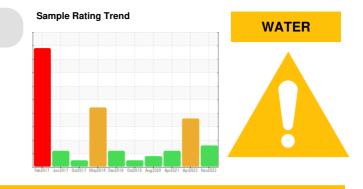

There are no recommended actions for this sample.

#### **HISTORICAL DIAGNOSIS**

#### 25 Apr 2023 Diag: Don Baldridge




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. We recommend an early resample in 500 hours to monitor this condition.All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. Confirm oil type. The AN level is acceptable for this fluid.

### 27 Apr 2021 Diag: Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

06 Aug 2020 Diag: Angela Borella







view report

# Report Id: AMASHE [WUSCAR] 06013359 (Generated: 11/22/2023 20:11:42) Rev: 1



# **OIL ANALYSIS REPORT**

# KAESER SX 7.5 5009001 (S/N 3089)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

# DIAGNOSIS

## Recommendation

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

# Wear


All component wear rates are normal.

# Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

## Fluid Condition

The AN level is acceptable for this fluid.

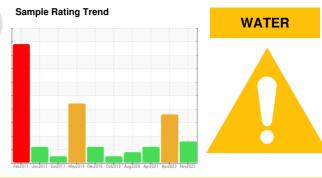

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007677	KCP53928	KCP33574
Sample Date		Client Info		09 Nov 2023	25 Apr 2023	27 Apr 2021
Machine Age	hrs	Client Info		53619	51314	39703
Oil Age	hrs	Client Info		0	3468	3200
Oil Changed	1110	Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
		una e tile e el	line it /le e e e	-		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		0	0	<1
Chromium	ppm	ASTM D5185m		0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	0	0	2
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m				<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	43	546	2
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	55	3	44
Calcium	ppm	ASTM D5185m	0	3	2	0
Phosphorus	ppm	ASTM D5185m	0	2	3	7
Zinc	ppm	ASTM D5185m	0	6	0	0
Sulfur	ppm	ASTM D5185m	23500	15642	2022	17725
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	2
Sodium	ppm	ASTM D5185m		25	20	9
Potassium	ppm	ASTM D5185m	>20	2	2	2
Water	%	ASTM D6304	>0.05	<b>0.072</b>	▲ 0.252	0.023
ppm Water	ppm	ASTM D6304	>500	<b>A</b> 720.7	▲ 2522.2	231.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3078	39376	19466
Particles >6µm		ASTM D7647	>1300	884	<b>1</b> 5326	6346
Particles >14µm		ASTM D7647	>80	66	<u> </u>	<b>4</b> 35
Particles >21µm		ASTM D7647	>20	17	<u> </u>	<b>▲</b> 78
Particles >38µm		ASTM D7647	>4	1	<b>5</b>	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	<b>2</b> 2/21/17	▲ 20/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 1.0


0.45 0.35 0.373 Contact/Location: SERVICE MANAGER ? - AMASHE


Report Id: AMASHE [WUSCAR] 06013359 (Generated: 11/22/2023 20:11:43) Rev: 1


I. SERVICE MANAGER ? - AMASH



# **OIL ANALYSIS REPORT**





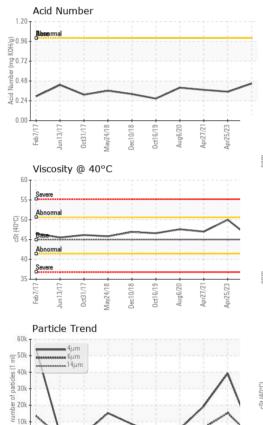

0

P/L/

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.2	50.0	47.0
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

Bottom

