

PROBLEM SUMMARY

Sample Rating Trend

WATER

Machine Id

KAESER ASD 30 7279947 (S/N 1130)


Component


Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





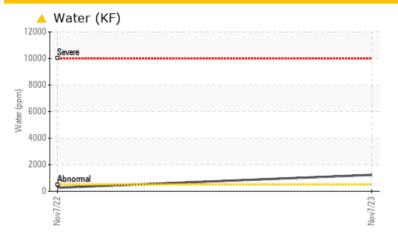

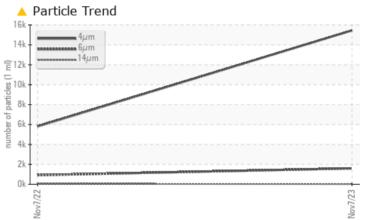

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS											
Sample Status				ABNORMAL	ABNORMAL						
Water	%	ASTM D6304	>0.05	△ 0.123	0.026						
ppm Water	ppm	ASTM D6304	>500	1230	267.5						
Particles >6µm		ASTM D7647	>1300	1596	918						
Oil Cleanliness		ISO 4406 (c)	>/17/13	21/18/12	20/17/13						

Customer Id: PAPWAS Sample No.: KCPA009398 Lab Number: 06013364 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

07 Nov 2022 Diag: Don Baldridge

WEAR




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER ASD 30 7279947 (S/N 1130)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. There is a light concentration of water present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2022	Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009398	KCP47189D	
Sample Date		Client Info		07 Nov 2023	07 Nov 2022	
Machine Age	hrs	Client Info		6682	2637	
Oil Age	hrs	Client Info		0	1852	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	4	<u> 11</u>	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	14	3	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	7	34	
Calcium	ppm	ASTM D5185m	0	1	1	
Phosphorus	ppm	ASTM D5185m	0	1	2	
Zinc	ppm	ASTM D5185m	0	153	137	
Sulfur	ppm	ASTM D5185m	23500	19110	24275	
CONTAMINANTS)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	
Sodium	ppm	ASTM D5185m		1	21	
Potassium	ppm	ASTM D5185m	>20	<1	14	
Water	%	ASTM D6304	>0.05	△ 0.123	0.026	
ppm Water	ppm	ASTM D6304	>500	1230	267.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		15454	5816	
Particles >6µm		ASTM D7647	>1300	1596	918	
Particles >14μm		ASTM D7647	>80	25	46	
Particles >21µm		ASTM D7647	>20	5	10	
Particles >38μm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/18/12	20/17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40	0.39	



OIL ANALYSIS REPORT

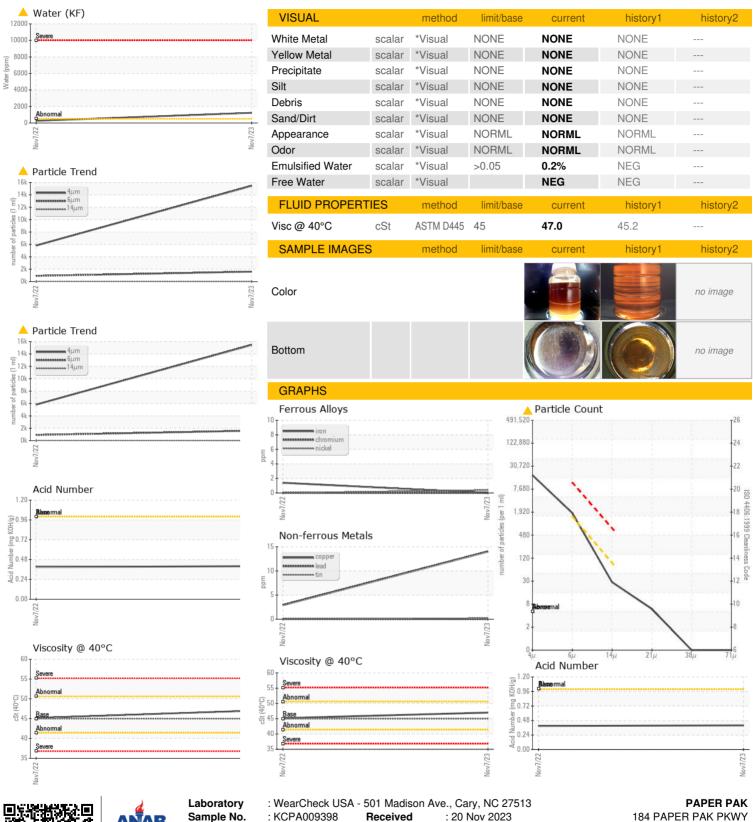



Sample No. Lab Number **Unique Number**

: 06013364

: KCPA009398 : 10752508

Received Diagnosed

: 29 Nov 2023 Diagnostician : Jonathan Hester

184 PAPER PAK PKWY WASHINGTON, GA US 30673

Contact: SERVICE MANAGER

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: